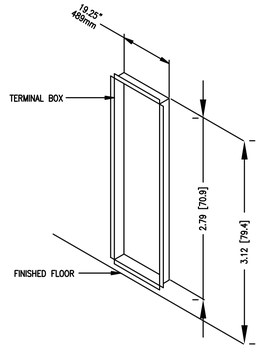

A1 WALL BOX MOUNTING DETAIL
SCALE: N.T.S.



B1 WARNING LIGHT DIAGRAM
SCALE: N.T.S.

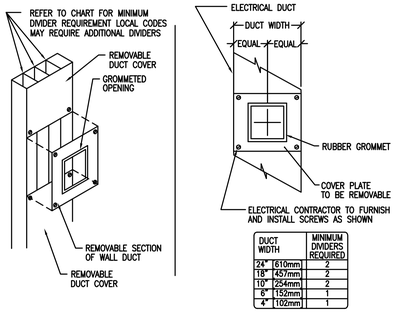

DUCT WIDTH	MINIMUM DIVIDERS REQUIRED
24" (610mm	2
18" (457mm	2
10" (254mm	2
6" (152mm	1
4" (102mm	1

C1 TYPICAL VERTICAL WALL DUCT DETAIL
SCALE: N.T.S.

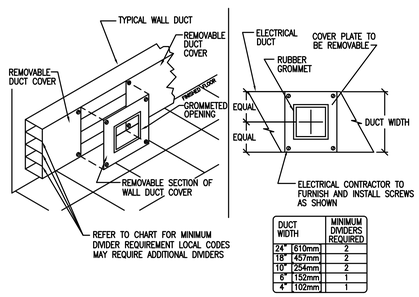

DUCT WIDTH	MINIMUM DIVIDERS REQUIRED
24" 610mm	2
18" 457mm	2
10" 254mm	2
6" 152mm	1
4" 102mm	1

D1 TYPICAL HORIZONTAL WALL DUCT DETAIL
SCALE: N.T.S.

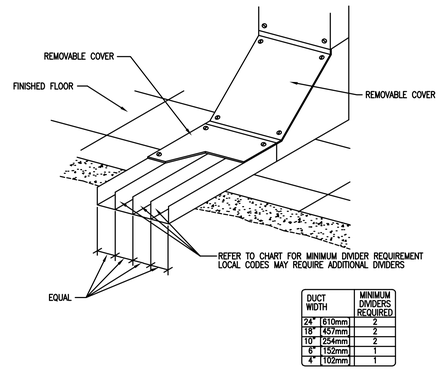

DUCT WIDTH	MINIMUM DIVIDERS REQUIRED
24" 610mm	2
18" 457mm	2
10" 254mm	2
6" 152mm	1
4" 102mm	1

E1 TYPICAL SURFACE FLOOR DUCT DETAIL
SCALE: N.T.S.

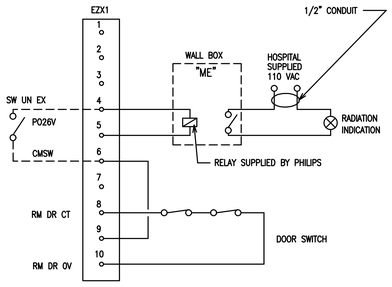

A2 DETAIL FOR CONNECTION OF X-RAY ON LIGHT AND DOOR SWITCH
SCALE: N.T.S.

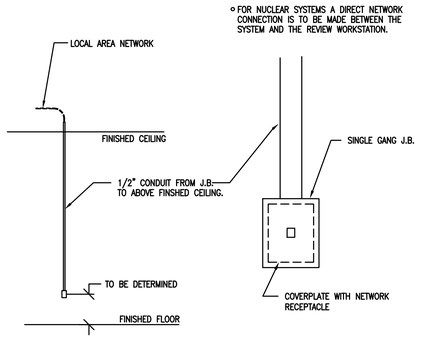

B2 TYPICAL NETWORK CONNECTION DETAIL
SCALE: N.T.S.

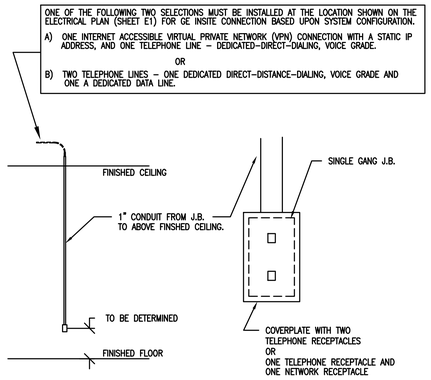

C2 TYPICAL INSITE CONNECTION DETAIL
SCALE: N.T.S.

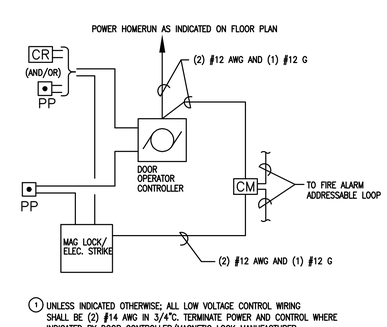

D2 TYPICAL AUTOMATIC DOOR WIRING DETAIL
SCALE: NONE

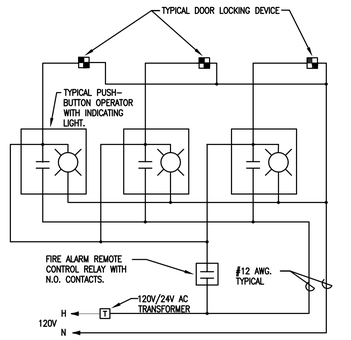

E2 PSYCHIATRIC DOOR ALARM SYSTEM WIRING SCHEMATIC DETAIL
SCALE: N.T.S.

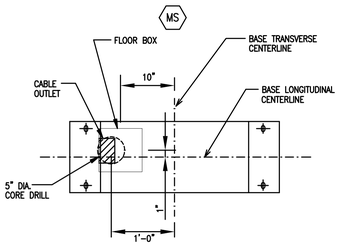

PROVIDE A 5" DIA. CORE DRILL IF THE FLOOR CANNOT ACCOMODATE A STANDARD 8"W x 8"L x 4"D FLOOR BOX FOR "MS."

A3 DIAGNOST TH TABLE BASE DETAIL
SCALE: N.T.S.

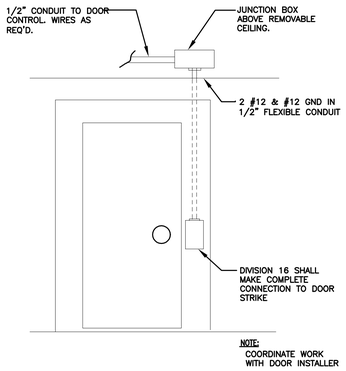

B3 TYPICAL ELECTRICALLY OPERATED DOOR DETAIL
SCALE: N.T.S.

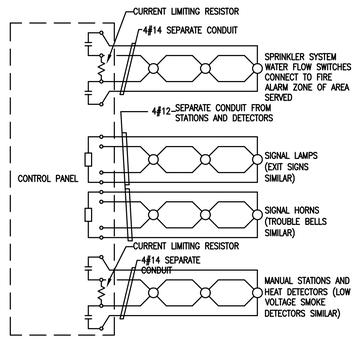

C3 TYPICAL FIRE ALARM WIRING DIAGRAM NFPA STYLE D & Z
SCALE: N.T.S.

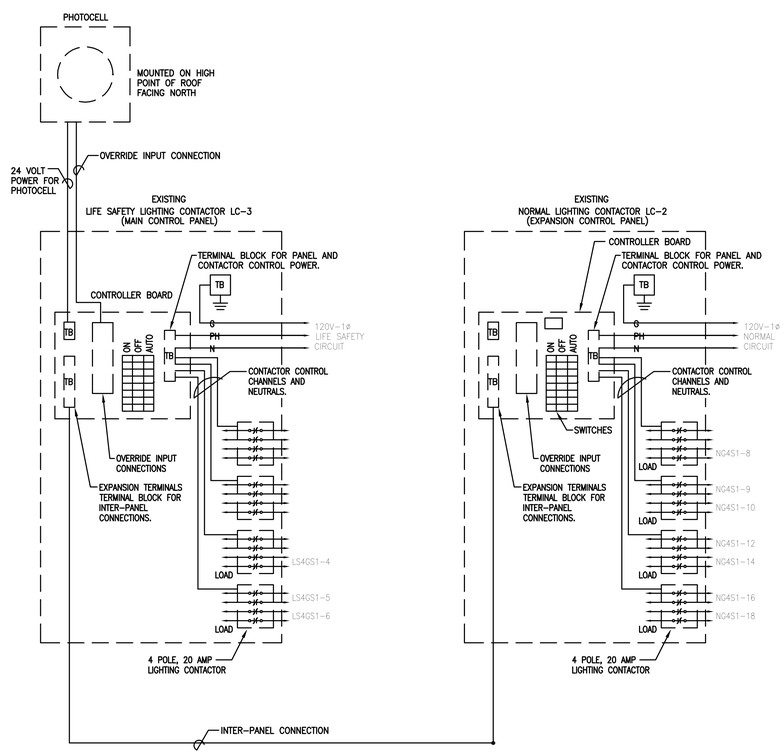

D3 EXISTING EXTERIOR LIGHTING WIRING DIAGRAM
SCALE: N.T.S.

General Notes:

MARK	ISSUE DATE	DESCRIPTION
BID	12/14/07	BID SET

Issue Log



Key Plan

TRO Jung|Brannen
ARCHITECTURE INTERIOR DESIGN ENGINEERING MASTER PLANNING
22 Boston Wharf Road, Boston, Massachusetts 02210
Tel 617.502.9400 Fax 617.502.3402 www.trojungbrannen.com

Maine Medical Center
ED Expansion and Renovation
Portland, Maine MMC Project No. 21843

Drawing Title
ELECTRICAL DETAILS SHEET 2 OF 2

Drawn By	AB	Commission No.	4696
Approved By	DS	Date Issued	12/14/07

Phase / Package Number	Sheet Number
	E801

Copyright © 2007 TRO Jung|Brannen

4696-E800