


- General Notes:**
- COORDINATE WITH HVAC AND ELECTRICAL CONTRACTOR TO AVOID OBSTRUCTION WITH DUCTWORK, LIGHTING, AND PIPING ABOVE CEILING. CONTRACTOR RESPONSIBLE FOR OFFSETTING AND RELOCATING EXISTING MAINS AS REQUIRED TO AVOID THE AFOREMENTIONED.
  - INSTALL WATER HAMMER ARRESTER AT ALL WATER CLOSET AND CLINIC SINK LOCATIONS.
  - REFER TO BULLETIN #30 UNDER THE CHARLES STREET PROJECT FOR THE UNDERSLAB PIPE TO ED.
- KEY NOTES:**
- PROVIDE 1/2" CW, 1/2" HW, 2" V CAPPED AND VALVED FOR FUTURE QT.
  - RUN 1/2" HW, 1/2" CW TO EIMV-2. RUN 1/2" TW FROM EIMV-2 TO EEW-3. EIMV-2 SHALL BE LOCATED UNDERNEATH COUNTER IN SOIL UTL. B572-ER.

MARK	ISSUE DATE	DESCRIPTION
A01	01/10/08	ADDENDUM NO. 01
BID	12/14/07	BID SET

Issue Log

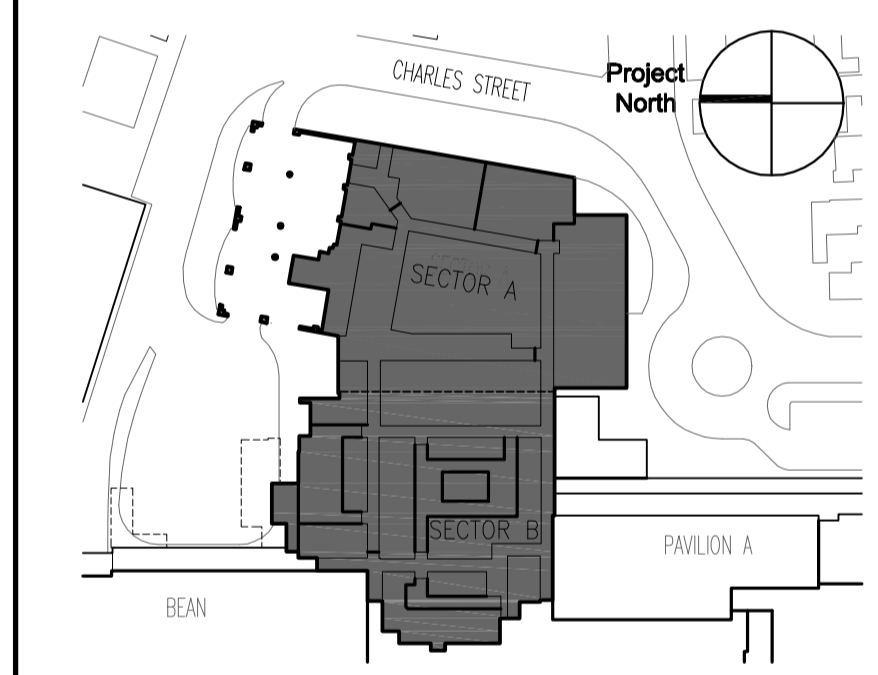

**TRO Jung|Brannen**  
 ARCHITECTURE INTERIOR DESIGN ENGINEERING MASTER PLANNING  
 22 Boston Wharf Road, Boston, Massachusetts 02210  
 Tel: 617.552.9400 Fax: 617.552.3402 www.trojungbrannen.com

**Maine Medical Center**  
 ED Expansion and Renovation  
 Portland, Maine MMC Project No. 21843

Drawing Title  
**PLUMBING BASEMENT - RENOVATION SECTOR A**

Drawn By: JAR Commission No. 4696  
 Approved By: MLT Date Issued: 12/14/07

Phase / Package Number Sheet Number  
**P20B.A**