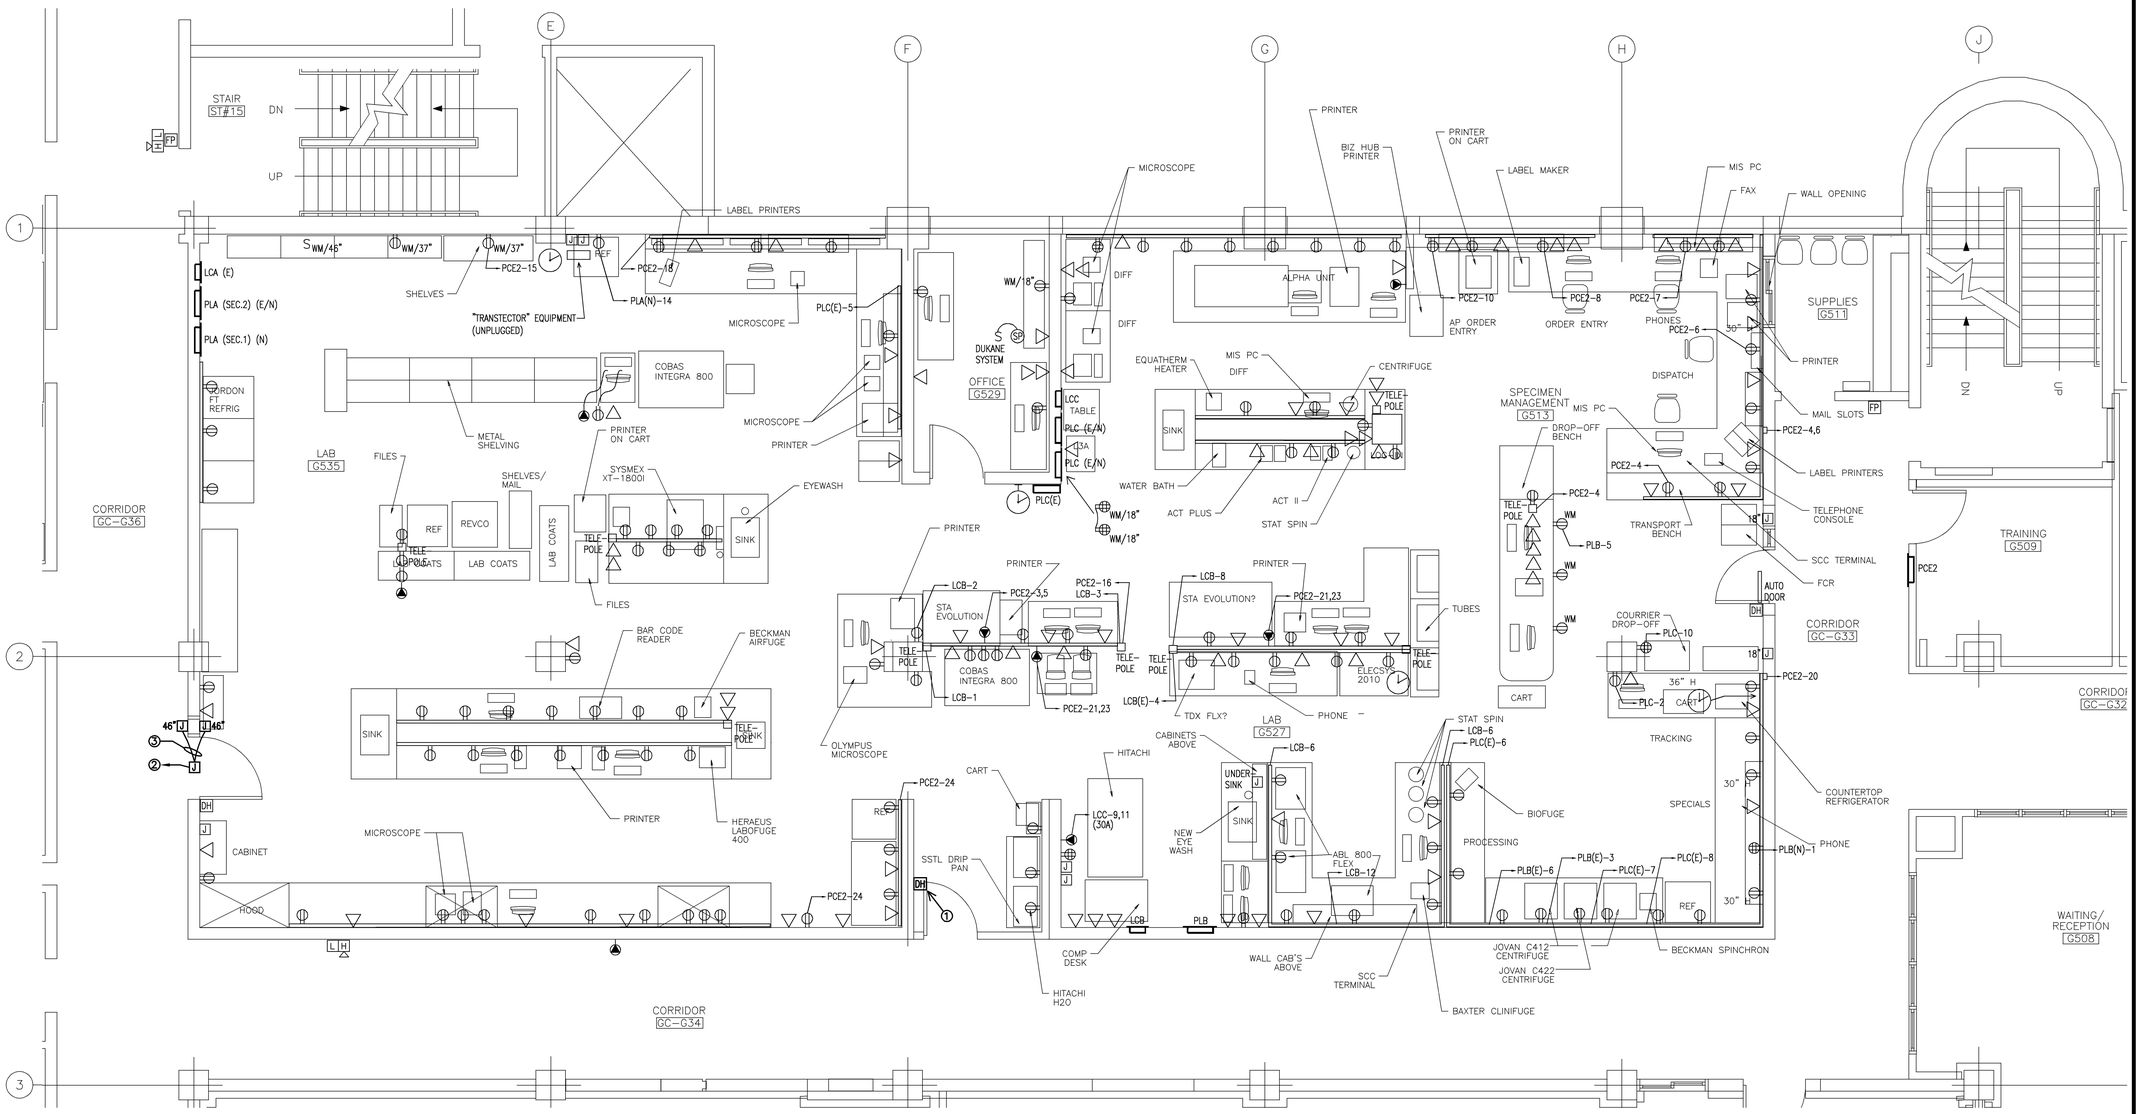

LABRATORY FIRST FLOOR

Scale: 1/4" = 1'-0"

DEMOLITION KEY NOTES

1. REMOVE EXISTING DOOR HOLDER AND METAL PLATE. REMOVE CONDUIT AND CONDUCTORS BACK TO SOURCE OR NEAREST JUNCTION POINT.
2. CONNECT TO AVAILABLE 120VOLT CIRCUIT.
3. PROVIDE CONDUITS AND CONDUCTORS PER MANUFACTURERS REQUIREMENTS FOR AUTOMATIC DOOR AND PUSHPADS. COORDINATE WITH HOSPITAL FOR FINAL LOCATION OF PUSHPAD BACKBOXES.

GENERAL NOTES

1. NO CONDUIT OR CONDUCTORS SHALL BE ABANDONED IN PLACE.
2. NOT ALL BRANCH CIRCUIT HOMERUNS SERVING THIS AREA ARE IDENTIFIED. EXISTING HOMERUNS IDENTIFIED ON DRAWING SHALL BE VERIFIED BY THE CONTRACTOR IN THE FIELD BEFORE BEGINNING WORK.
3. NOT ALL EXISTING RECEPTACLES, DATA DEVICES, EXIT SIGNS AND FIRE ALARM SIGNALING DEVICES ARE SHOWN.

HARRIMAN

Architects + Engineers

Auburn Business Park
46 Harriman Drive
Auburn, Maine 04210
207.784.5100 tel
207.782.3017 fax

123 Middle Street
Portland, Maine 04101
207.775.0653 tel
207.775.0460 fax

www. harriman.com

© 2008

STATE OF MAINE WILLIAM R. HAK No. 7880 LICENSED PROFESSIONAL ENGINEER

Project Title

MAINE MEDICAL CENTER HVAC, LAB RENOVATIONS

PORTLAND, MAINE

HA Project No. 08101

Key Plan

Mark	Date	Description
–	10-31-08	ISSUED FOR BID
–	10-10-08	75% REVIEW

Issue Dates

Drawing Status

Drawing Title

ELECTRICAL POWER & SYSTEMS FIRST FLOOR PLAN

PA / PE: WRH

Drawn By: RJB

Drawing Number

E06.1