


NOTES:

1. SEE SHEET PL001 FOR LEGEND AND ABBREVIATIONS.

144 Fore Street, P.O. Box 618
Portland, Maine 04104
Tel: (207) 775-3846
Fax: (207) 775-1070
www.araminc.com

ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING

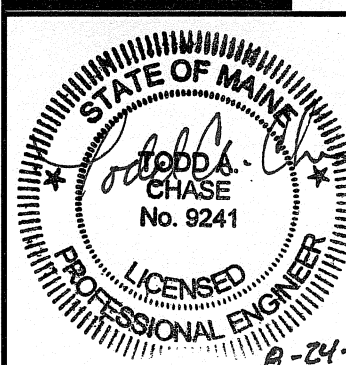


0-24-10

Bramhall Radiology
ANGIO RENOVATIONS
PORTLAND, ME

ISSUED FOR CONSTRUCTION	8.24.10	DATE
ISSUED FOR CONSTRUCTION	0	REV
DESCRIPTION		

GRAPHIC SCALE:	0" = 1"
SCALE:	AS INDICATED
PROJECT MANAGER:	DW
JO/DRAWN BY:	KPB
A/E OF RECORD:	TAC
PROJECT NO.:	09022-01
DATE:	8.24.10
SHEET TITLE:	PLUMBING DETAILS
SHEET No.:	PL501

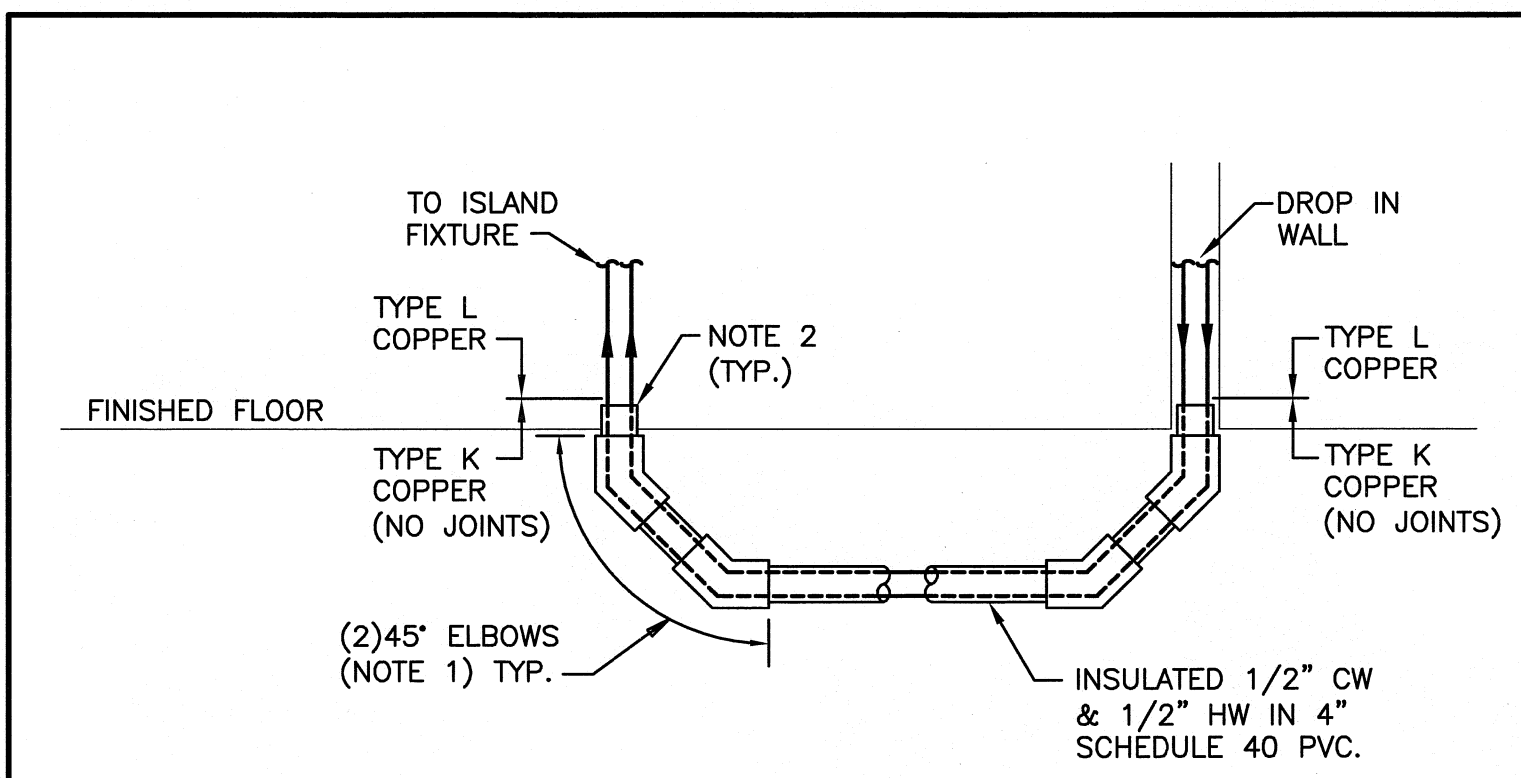


NOTES:

1. OTHER ACCEPTABLE OPTIONS INCLUDE USING LONG SWEEP ELECTRICAL CONDUIT 90° ELBOW OR TWO PIECE SPLIT 90° ELBOWS, (GEORGE FISCHER "CONTAIN IT" PRODUCT LINE, OR EQUAL).
2. TERMINATE PVC 1" ABOVE FINISHED FLOOR. CAULK ANNULAR SPACE BETWEEN WATER LINE INSULATION AND PVC LIQUID TIGHT.


G10 SUPPLY PIPING TO ISLAND FIXTURE

NOT TO SCALE

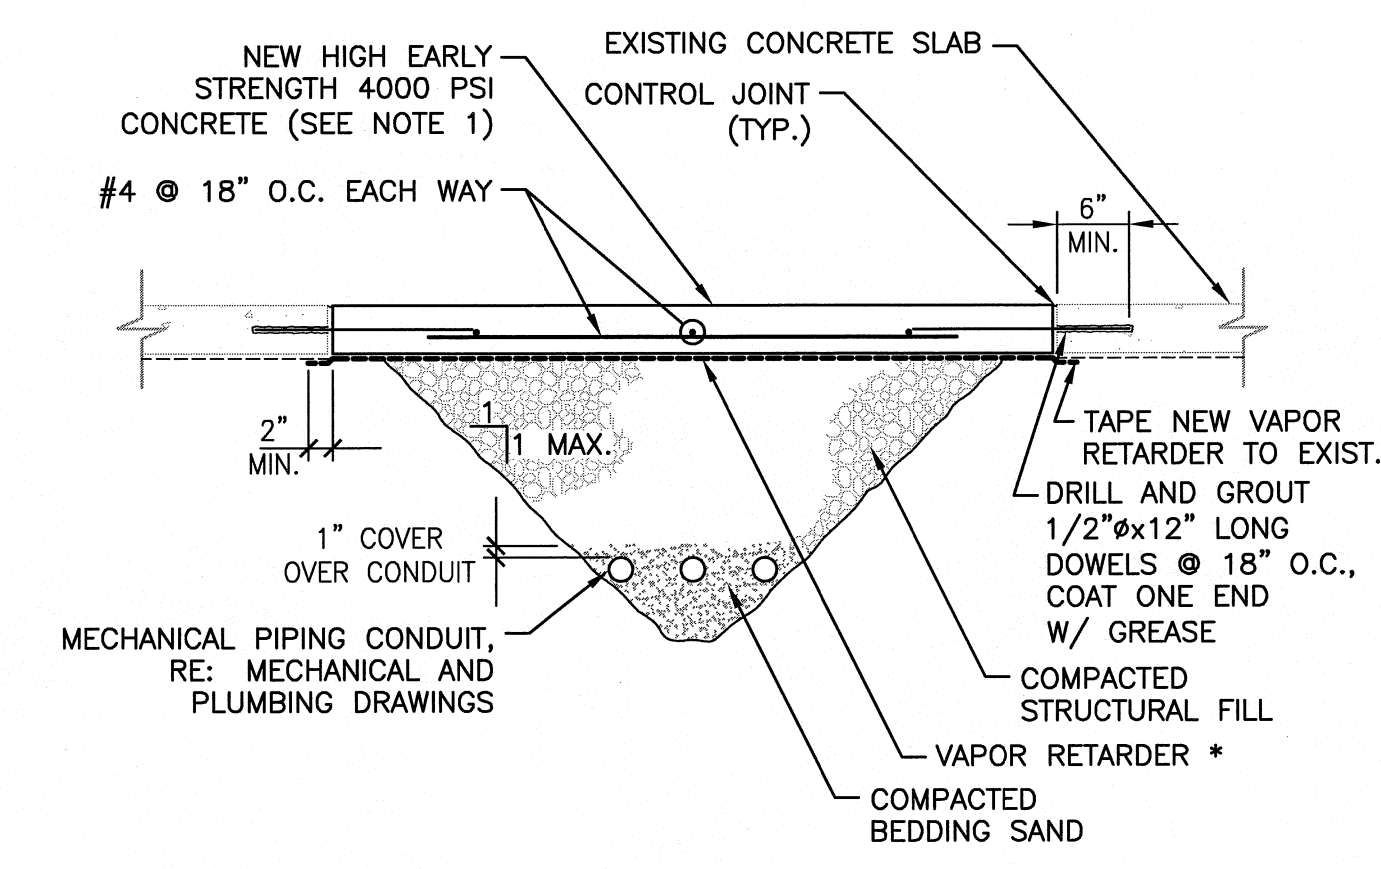

NOTES:

1. CONCRETE SHALL BE LOW SLUMP (<4"), HIGH EARLY STRENGTH WITH RAPID SETTING CEMENT BY CTS OR EQUAL.
2. NEW CONCRETE SLAB THICKNESS SHALL MATCH EXISTING.
3. PROVIDE TRANSVERSE SAW CUT CONTROL JOINTS THAT ARE 1/4 OF THE SLAB DEPTH AND ARE SPACED 1.5x THE TRENCH WIDTH.
4. PROVIDE CONTROL JOINTS AT INTERFACE BETWEEN NEW AND EXISTING CONCRETE.
5. WET CURE FOR 7 DAYS MINIMUM.
6. * VAPOR RETARDER REQUIRED ONLY IF THERE IS A VAPOR RETARDER UNDER EXISTING SLAB.

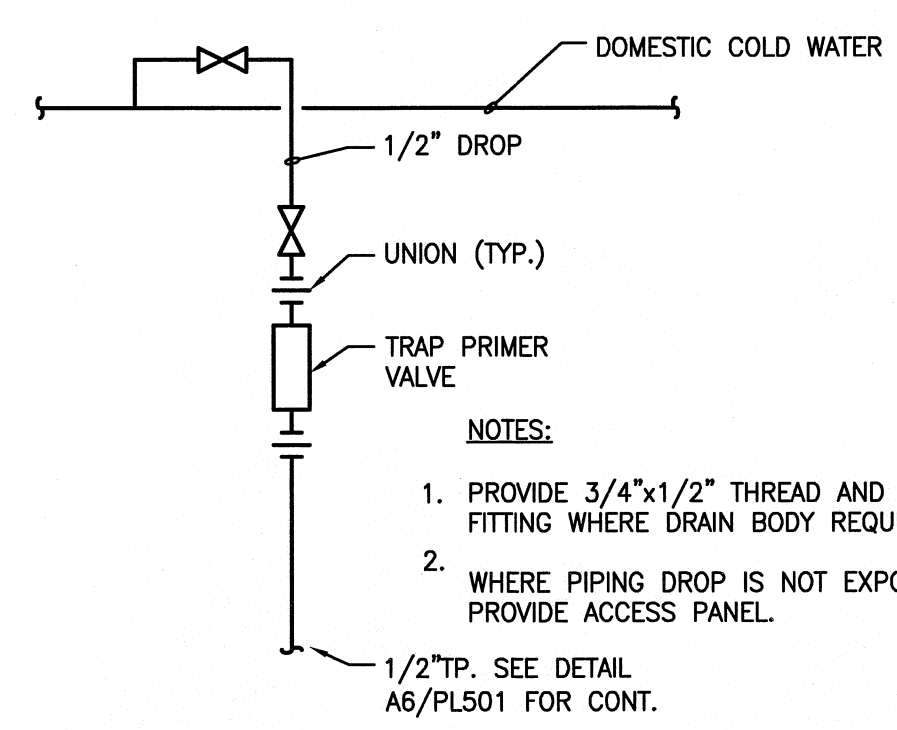


NOTES:

1. PROVIDE 3/4"x1/2" THREAD AND SWEAT FITTING WHERE DRAIN BODY REQUIRES.
2. WHERE PIPING DROP IS NOT EXPOSED, PROVIDE ACCESS PANEL.

D6 TRAP SEAL PRIMER DETAIL

NOT TO SCALE

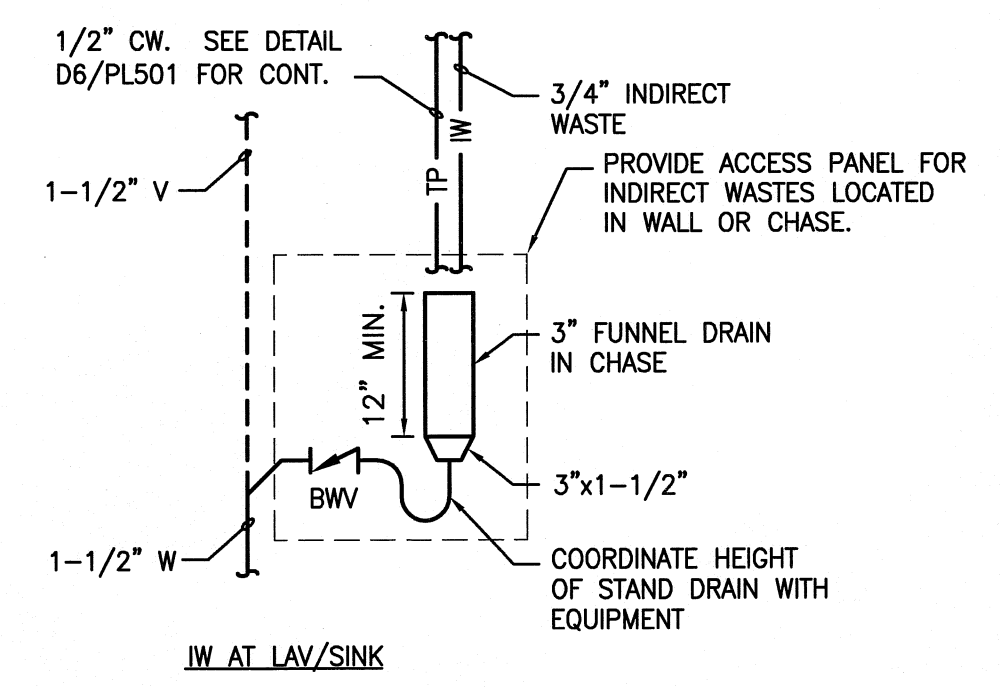

A6 INDIRECT WASTE CONNECTION

NOT TO SCALE

A10 TYPICAL TRENCHING DETAIL

3/4" = 1'-0"