

**PLUMBING FIXTURE SCHEDULE**

TAG	DESCRIPTION	FIXTURE	FAUCET/DRAIN	TRIM	SUPPORT	NOTES
WC-A	WALL HUNG WATER CLOSET - ADA	AMERICAN STANDARD #3355.160 "AFWALL", VITREOUS CHINA, SIPHON JET TYPE, 1-1/2" TOP SPUD, 1.6 GPF, "EVERCLEAN" SURFACE.	SLOAN OPTIMA #111-ES-S TMO-YO SENSORED FLUSH VALVE, 1.6 GPF	CHURCH #9500SSC SEAT - WHITE	ZURN #Z1204-N-X 500LB. RATED	
LAV-A	WALL HUNG LAVATORY - ADA	AMERICAN STANDARD #0356.421 "LUCERNE" VITREOUS CHINA, 20"x18", CENTER HOLE ONLY.	CHICAGO #116.121.21.1 0.5 GPM SENSORED FAUCET, CHICAGO #327-XCP GRID DRAIN, OFFSET TAILPIECE, CHROME PLATED	MCGUIRE LOOSE KEY ANGLE STOPS, ESCUTCHEONS AND RISERS-CHROME PLATED	JAY R. SMITH #0710-Z	①②③
SK-A	STAINLESS STEEL COUNTER MOUNTED GENERAL PURPOSE - ADA	ELKAY #LRAD20220365, 20"x22"x8-1/2" DEPTH, 18 GAUGE, 304 SS, (3) HOLES ON 4" CENTERS.	CHICAGO #201-AGN8A-317CP FAUCET, OMNI PRODUCTS SERIES L-200 0.5 GPM OUTLET, ELKAY #LKAD18 DRAIN AND OFFSET TAIL, CP FINISHES	MCGUIRE LOOSE KEY ANGLE STOPS, ESCUTCHEONS AND RISERS-CHROME PLATED	-	①③
SK-B	STAINLESS STEEL WALL MOUNTED SCRUB SINK	ELKAY #EWS2520SACC, 25"x19-1/2"x10-1/2" DEPTH, 14 GAUGE, 304 SS, CENTER HOLE IN BACKSPLASH.	CHICAGO #116.224.AB.1 SENSORED FAUCET, 0.5 GPM OUTLET, ELKAY #LKAD18 DRAIN AND OFFSET TAIL, CP FINISHES	MCGUIRE LOOSE KEY ANGLE STOPS, ESCUTCHEONS AND RISERS-CHROME PLATED	-	②
SS-A	FLUSHING RIM CLINIC SERVICE SINK	AMERICAN STANDARD #9512.013 VITREOUS CHINA, 24"x1/2"x20", 4" OUTLET, QTY(3) #7832017.075 10" STAINLESS STEEL GUARDS.	CHICAGO #910G-777-19K BEDPAN WASHER, SLOAN ROYAL #117-H 6.5 GPF EXPOSED FLUSH VALVE, CHROME PLATED FINISHES	MCGUIRE LOOSE KEY ANGLE STOPS, ESCUTCHEONS AND RISERS-CHROME PLATED. APOLLO BATH "THE SHIELD" BACKSPLASH PROTECTOR.	ZURN #Z-1217-B	
MR-A	MOP RECEPTOR	FIAT #TSB-3000 TERRAZZO BASIN, 24"x24"x12" DEEP, #MSG 2424 WALL GUARDS.	CHICAGO #445-RCB97SXKCP SERVICE SINK FAUCET, INTEGRAL CHECK STOPS	FIAT #832-AA HOSE AND BRACKET, #889-CC MOP HANGER, ALL WALL GUARDS	-	

NOTES: ① TRUEBRO #103 E-Z HANDI LAV-GUARD INSULATION KIT AND EXTENSIONS AS REQUIRED FOR ALL EXPOSED PIPING BENEATH SINK BASIN.  
 ② PROVIDE WATTS SERIES #600 BRONZE CHECK VALVES ON CW AND HW INLETS TO MIXING VALVE.  
 ③ PROVIDE OFFSET TAILPIECE FOR ADA ACCESSIBILITY

**PLUMBING PUMP SCHEDULE**

TAG	LOCATION	SERVICE	GPM	HD (FT.)	ELECTRICAL DATA				TYP. UNIT MANUF. & MODEL NO.	NOTES
					HP	RPM	VOLTS	PH		
CP-1	EQUIPMENT ROOM B451	CONDENSATE	48 GPH	10	1/30	-	115	1	LITTLE GIANT #554425 #VCM-20ULS SERIES	

NOTES:

**SHOCK ABSORBER SCHEDULE**

TYPE	FIXTURE UNIT RATING	BASIS OF DESIGN	
		MANUF.	FIGURE NO.
'A'	1-10	ZURN	100
'B'	12-32	ZURN	200
'C'	33-60	ZURN	300
'D'	61-113	ZURN	400
'E'	114-154	ZURN	500
'F'	155-330	ZURN	600

**PLUMBING FIXTURE CONNECTION SCHEDULE**

FIXTURE	CW	HW	WASTE	VENT	NOTES
FLUSH VALVE WATER CLOSET	1"	-	4"	2"	①
LAVATORY	1/2"	1/2"	1-1/2"	1-1/2"	②
SINK	1/2"	1/2"	1-1/2"	1-1/2"	②
SERVICE SINK/MOP RECEPTOR	3/4"	3/4"	3"	2"	②
SHOWER	1/2"	1/2"	-	-	②
FLUSHING RIM SERVICE SINK	3/4" 1"	3/4" -	4"	2"	①③

NOTES: ① PROVIDE SHOCK ABSORBER W/ ISOLATION VALVE, ACCESSIBLE.  
 ② PROVIDE AIR CHAMBERS ON HW & CW CONNECTIONS.  
 ③ 3/4" CW AND HW CONNECTION TO BEDPAN WASHER, 1" CW CONNECTION TO FLUSH VALVE.

**PLUMBING SPECIALTIES SCHEDULE**

TAG	APPLICATION	TYPICAL UNIT MFG & MODEL NO.	DESCRIPTION	NOTES
EE-A	EMERGENCY EYE-FACE WASH MIXING VALVE	LEONARD #TA-300-CP-IT-TOP	FAIL COLD, 10 PSIG MAX. DROP AT 4 GPM FLOWING, CHROME PLATED, TOP INLETS, INLET THERMOMETERS	
EE-B	EMERGENCY EYE FACE WASH	GUARDIAN #CS026BP	WALL MOUNTED EYEWASH/DRENCH HOSE UNIT, STAY OPEN VALVE, BACKFLOW PREVENTER, MOUNTING BRACKET	①
HB-A	HOSE BIBB	CHICAGO #998-RCF	3/4" MALE OUTLET, ROUGH CHROME FINISH, VACUUM BREAKER	



NOTES: ① PROVIDE "EMERGENCY EYEWASH" SIGN

**NOTES:**

1. SEE SHEET PLO01 FOR LEGEND AND ABBREVIATIONS.

144 Fore Street, P.O. Box 618  
 Portland, Maine 04104  
 tel: (207) 772-3846  
 fax: (207) 772-1070  
 www.smartinc.com

ARCHITECTURE  
 ENGINEERING  
 PLANNING  
 INTERIOR DESIGN  
 CONSTRUCTION

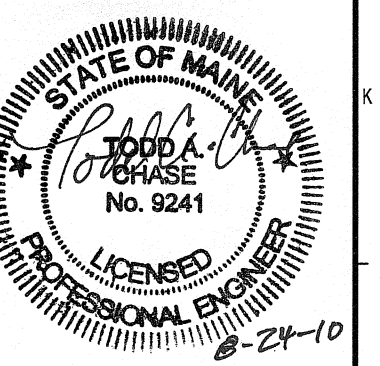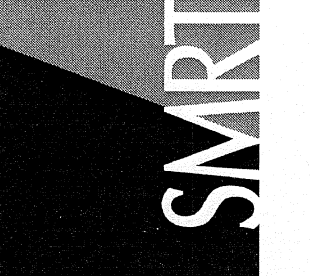

ISSUED FOR CONSTRUCTION  
 8.24.10

Bramhall Radiology  
 ANGIO RENOVATIONS  
 PORTLAND, ME  
 CURRENT ISSUE STATUS

REV	DATE	DESCRIPTION
0	8.24.10	ISSUED FOR CONSTRUCTION

GRAPHIC SCALE:  
 0" 1"  
 SCALE: NOT TO SCALE  
 PROJECT MANAGER: DTY  
 I/C/DRAWN BY: KPB  
 A/E OF RECORD: TAC  
 PROJECT NO: 09022-01  
 DATE: 8.24.10  
 SHEET TITLE:  
**PLUMBING SCHEDULES**  
 SHEET No. **PL601**