
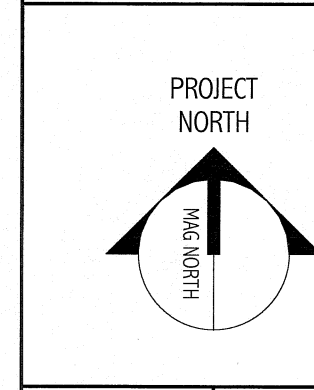
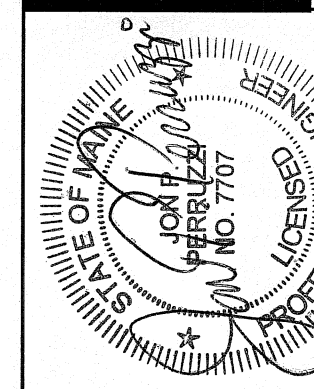


144 Fore Street, P.O. Box 618
 Portland, Maine 04104
 Tel: (207) 773-3846
 Fax: (207) 773-1070
 www.smrtinc.com

ARCHITECTURE
 ENGINEERING
 PLANNING
 INTERIOR DESIGN
 COMMISSIONING

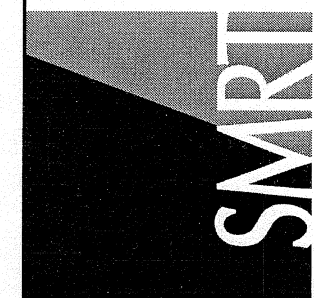

Bramhall Radiology
 ANGIO RENOVATIONS
 PORTLAND, ME

ISSUED FOR CONSTRUCTION
 08.24.10

CURRENT ISSUE STATUS

REV	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	8.24.10

GRAPHIC SCALE:
 0" 1"

SCALE: 1/8" = 1'-0"
 PROJECT MANAGER: DIV
 DRAWN BY: CDS
 A/E OF RECORD: JPP
 PROJECT NO.: 09022-01
 DATE: 8.24.10

SHEET TITLE:
 ANGIO BASEMENT
 SYSTEMS PLAN


SHEET No.
 EY101

NOTES:

- SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.
- NEW FIRE ALARM DEVICES SHALL BE COMPATIBLE WITH EXISTING HONEYWELL SYSTEM. EXTEND EXISTING INITIATION AND NOTIFICATION APPLIANCE CIRCUITS AS REQUIRED. PROVIDE PROGRAMMING FOR ADDITIONAL DEVICES.
- NURSE CALL SIGNALS GO TO THE RADIO NURSE STATION.

KEYED NOTES:

- INSTALL 8" ABOVE COUNTER TO CENTER.
- VOICE/DATA MOUNTED IN CEILING PANEL. CEILING PANEL PROVIDED BY MECHANICAL CONTRACTOR.
- VOICE/DATA MOUNTED IN FLOOR BOX. BOX PROVIDED BY MECHANICAL CONTRACTOR.
- INSTALL 48" AFF TO CENTER.
- INSTALL 60" AFF TO CENTER.
- EXISTING DUCT SMOKE DETECTORS MAY BE RE-USED IF IN GOOD CONDITION.

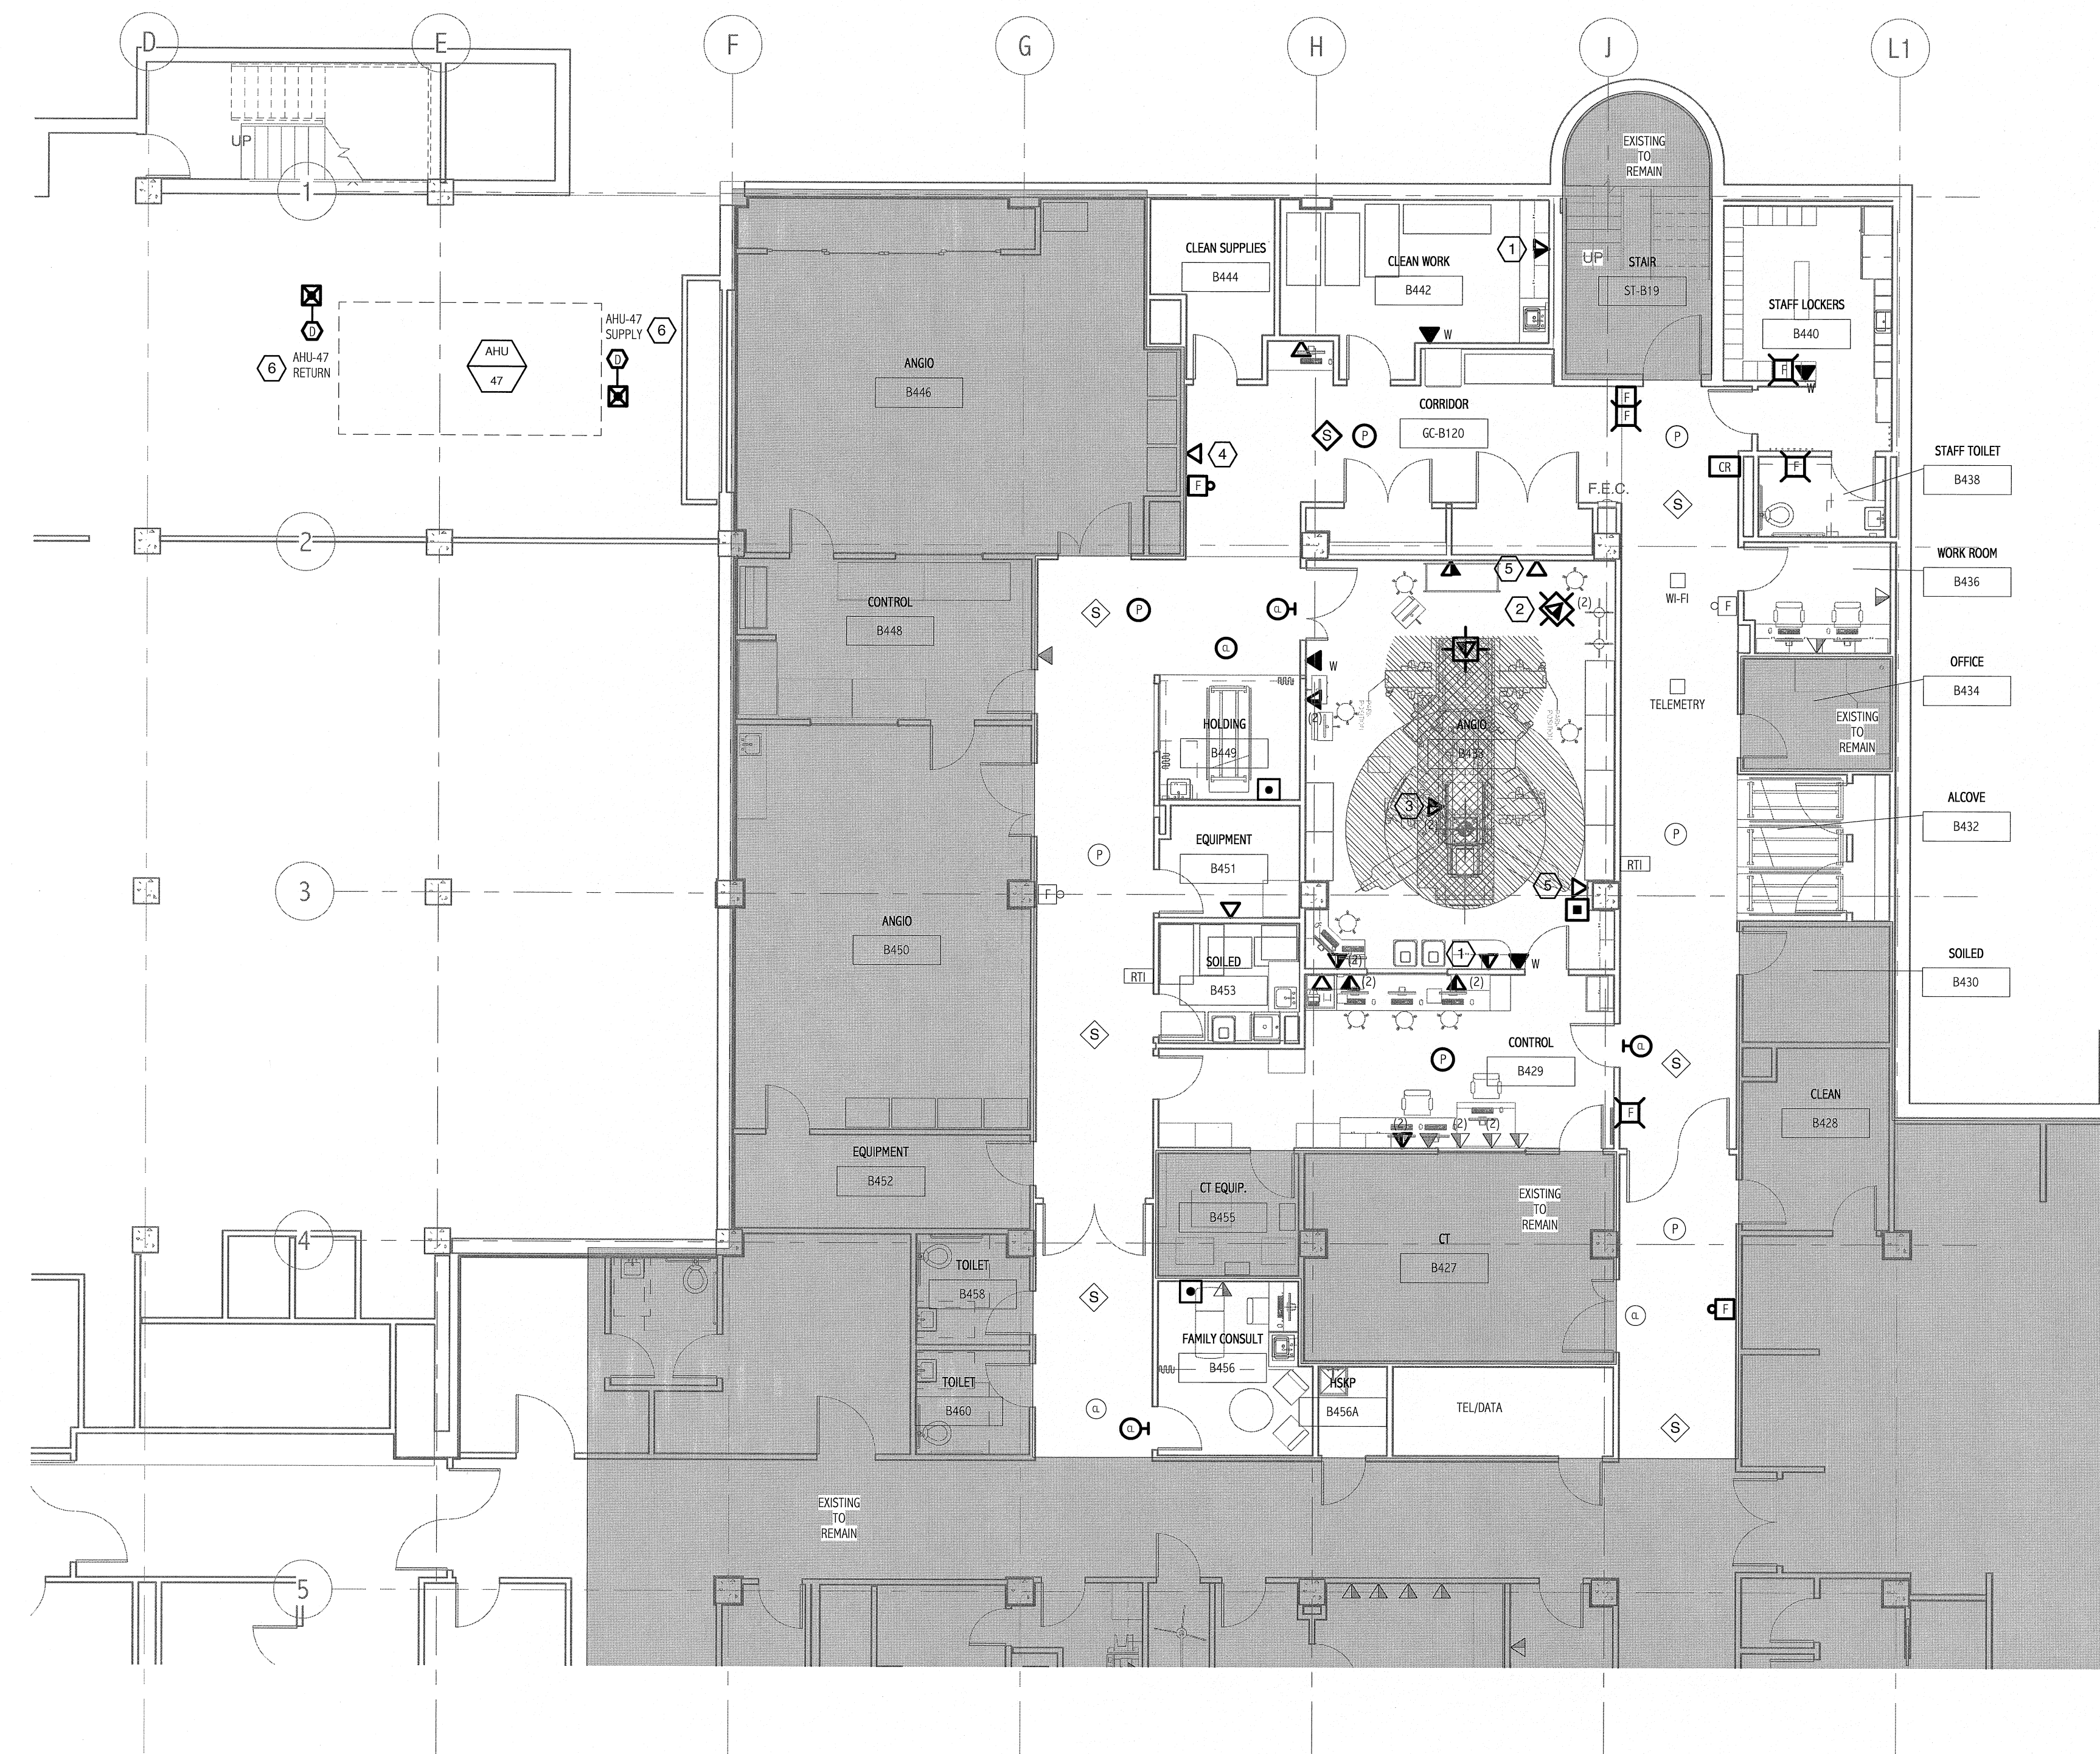

1 ANGIO BASEMENT SYSTEMS PLAN
 1/8" = 1'-0"