


## J6 HVAC PIPING DEMOLITION PLAN

1/4" = 1'-0"

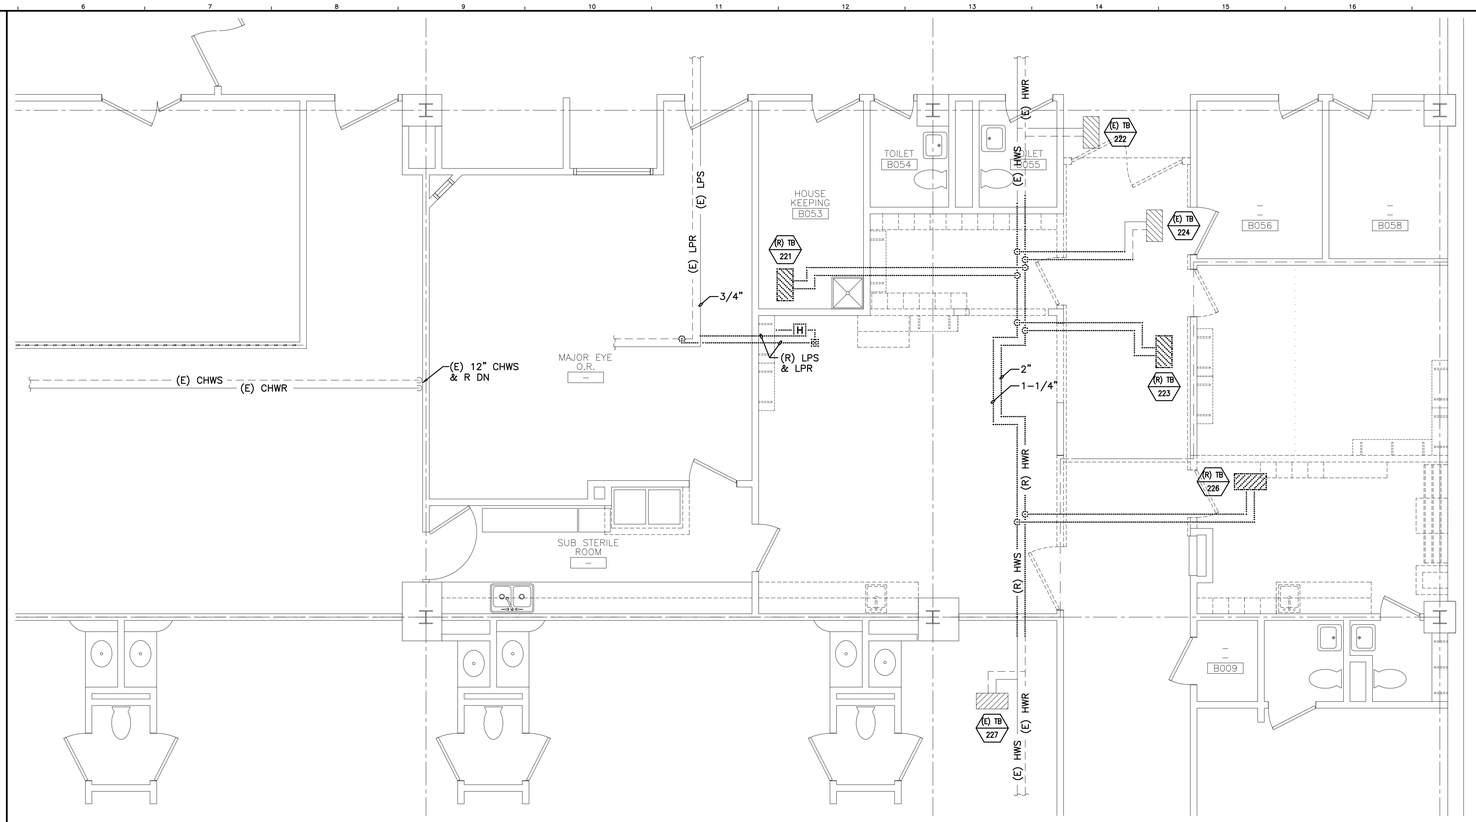


## A6 HVAC PIPING PLAN

1/4" = 1'-0"

## NOTE:

1. SEE M-001 FOR LEGEND AND ABBREVIATIONS.
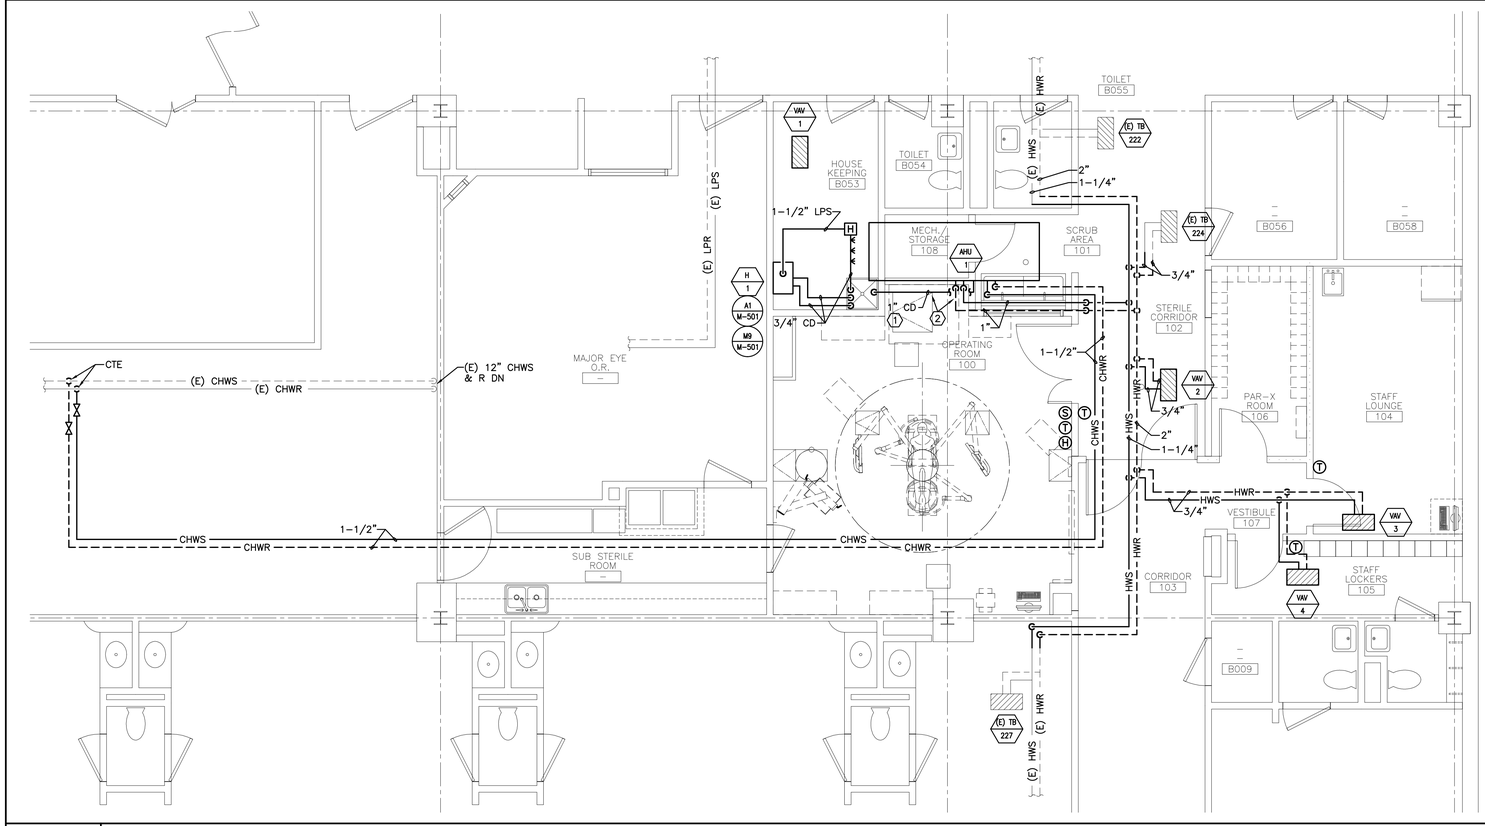
## KEYED NOTES:

1. 1" CD FROM AHU-1 COOLING COIL, ROUTE INDIRECT WASTE TO SERVICE SINK IN HOUSEKEEPING B053. COORDINATE WITH CEILING ACCESS.
2. MAINTAIN CLEARANCE FOR FILTER REMOVAL AND SERVICING AHU-1.

| REV. | DESCRIPTION | DATE |
|---|---|---|
| 0 | ISSUED FOR CONSTRUCTION | 7-29-04 |

**ISSUED FOR CONSTRUCTION**
**7-29-04**

CURRENT ISSUE STATUS:

PROJECT NORTH


SMRT
ARCHITECTURE ENGINEERING PLANNING
SMRT
144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070


PROJECT: MAINE MEDICAL CENTER
O.R. RENOVATION
Portland, Maine

SHEET TITLE: DEMOLITON AND HVAC PIPING PLANS

| | | | |
|---|---|---|---|
| SCALE: | AS NOTED | DATE: | 7-29-04 |
| PROJECT MANAGER: | CFG | GRAPHIC SCALE: | 0" 1" |
| JOB CAP/DRAWN: | SDL/BGG | | |
| A/E OF RECORD: | LPA | SHEET No. | M-102 |
| SMRT CAD FILE: | M-102-03122 | | |
| PROJECT No. | 03122 | | |

© COPYRIGHT 2003 SMRT INC.