

# MECHANICAL KEYNOTE


REFRIGERANT PIPE SIZING SHALL BE COORDINATED WITH CONDENSING UNIT MANUFACTURER.

## MECHANICAL GENERAL KEYNOTES

- 1 PROVIDE BID ALTERNATE (ALTERNATE #4), FOR DELETION OF AIR HANDLING UNIT AHU—085 AND ALL ASSOCIATED DUCTWORK, PIPING, EQUIPMENT AND ACCESSORIES. ALL EXISTING HVAC TO REMAIN. INCLUDE NEW EXHAUST FANS EXH—188, & EXH—189 IN BOTH BASE AND ALTERNATE #4 BIDS.
- PROVIDE BID ALTERNATE (ALTERNATE #5)
  FOR DX COOLING IN LIEU OF CHILLED
  WATER, INCLUDING AIR—COOLED
  CONDENSING UNITS ACCU—1, ACCU—2,
  AND ALL ASSOCIATED PIPING &
  ACCESSORIES. CHILLER CHILL—20, AND
  ALL ASSOCIATED PIPING & ACCESSORIES
  SHALL BE INCLUDED IN BASE BID. DO NOT
  INCLUDE WITH BID ALTERNATE #5.
- 3 PROVIDE BID ALTERNATE (ALTERNATE #9)
  FOR CHILLED WATER SYSTEM SIZED TO
  SUPPORT EXISTING PAVILION "A" AIR
  HANDLER REPLACEMENT, INCLUDING
  ALTERNATE CHILL—20 AND CHWP—1 & —2
  (SEE SCHEDULES, DWG. 3M30.0) AND 4"
  CHILLED WATER SUPPLY & RETURN MAINS
  (WITH CAPS FOR FUTURE) IN LIEU OF
  2—1/2" RUN—OUT PIPING TO PAVILION "A"
  ROOF.

## GENERAL MECHANICAL NOTES:

- PROVIDE PRE-FABRICATED ROOF PIPING SUPPORTS EVERY 10 FT. REFER TO DETAILS 15617-12 & 15676-05, DWG. 3M4.1.
- PROVIDE PRE-FABRICATED ROOF DUCTWORK SUPPORTS EVERY 10 FT. REFER TO DETAILS 15616-01 & 15676-05, DWG. 3M4.1.

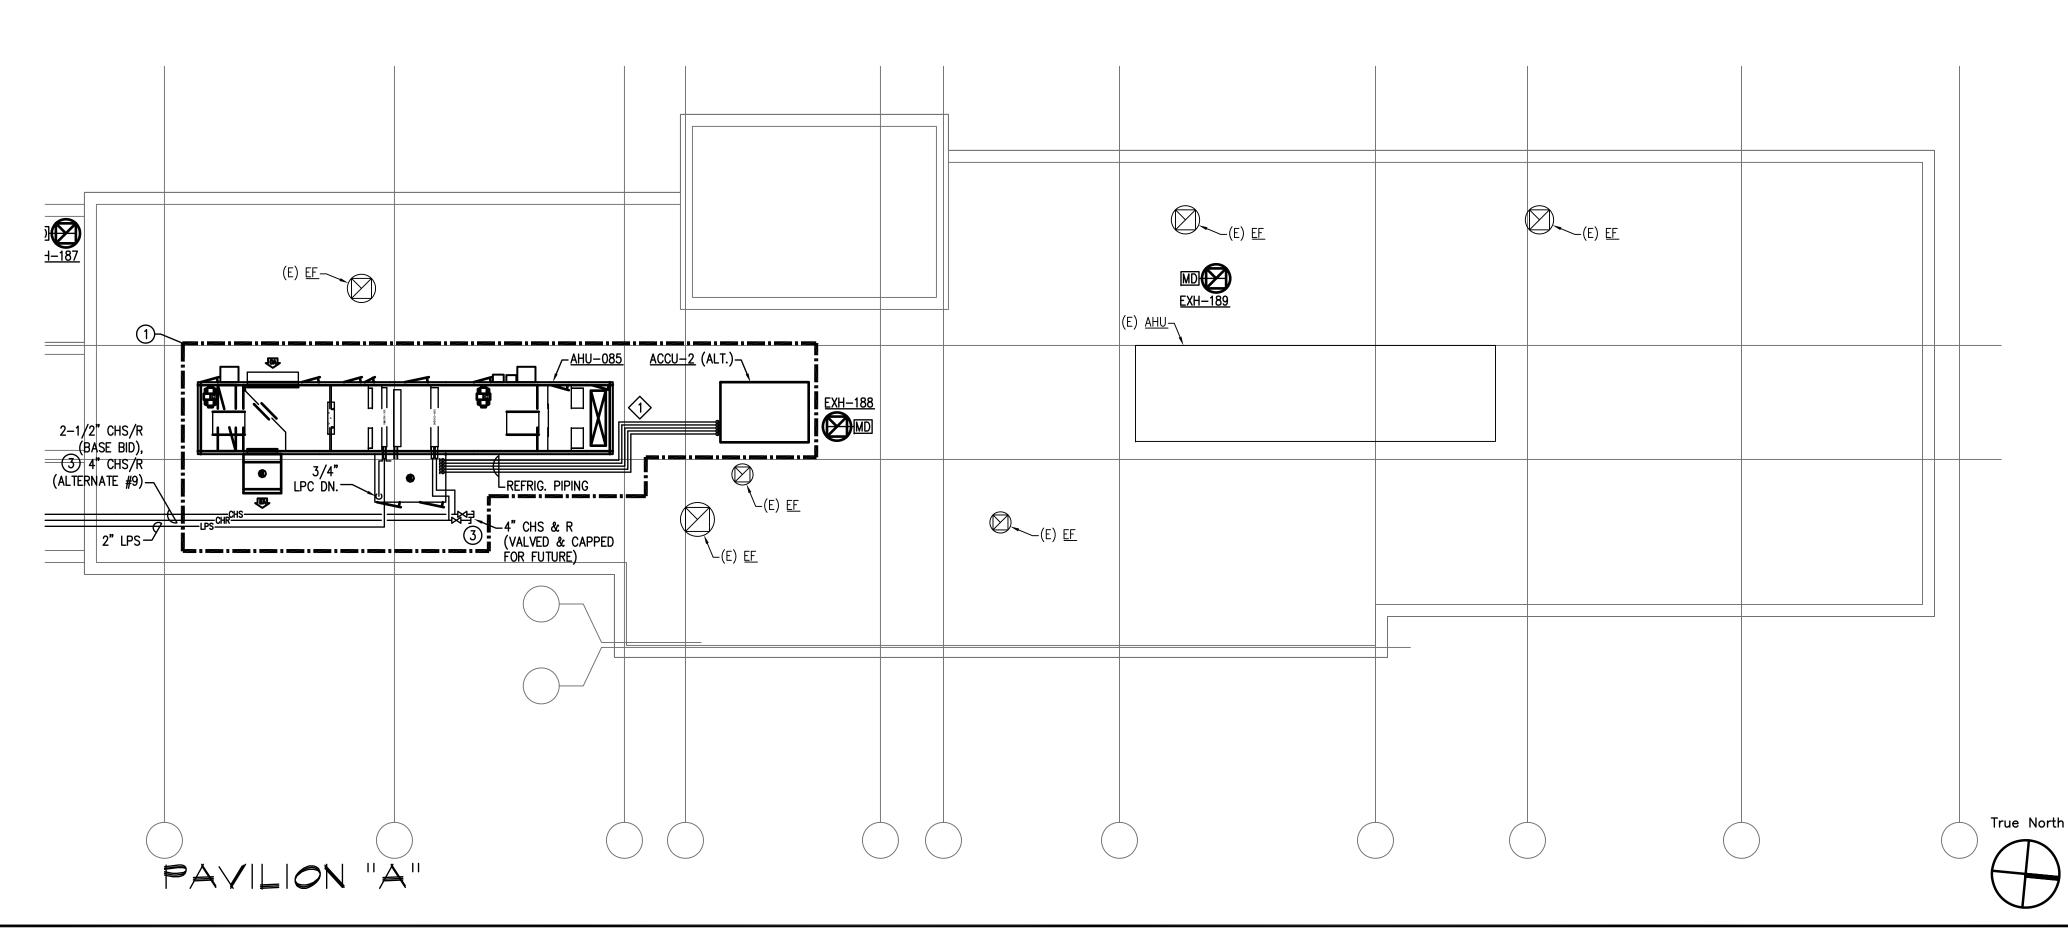


# Morris Switzer Environments for Health

Williston, Vermont Boston, Massachusetts Portland, Maine One Dana Street Portland, ME 04101 t 207.773.8841 f 207.773.8840

morrisswitzer.com

© 2009 MorrisSwitzer



# BECKER structural engineers, inc.


75 York Street Tel 207-879-1838 Portland, ME 04101-4701 Fax 207-879-1822 info@beckerstructural.com www.beckerstructural

#### Consultant



### Consultant

Revision

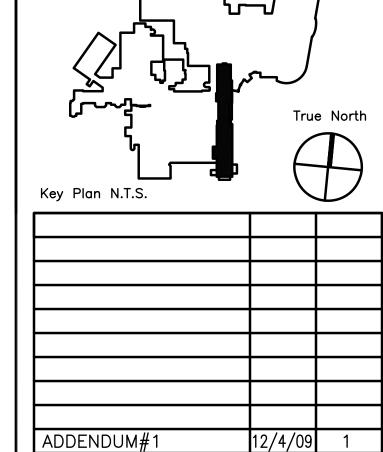



Date No

# MAINE MEDICAL CENTER

**PAVILION 6 RENOVATIONS** 

MorrisSwitzer Project Number	28034
Date	11/19/09
Scale	1/8" = 1'-0"
Sheet Title and Number	

SIXTH FLOOR PAVILIONS
"A" & "C" MECHANICAL
NEW WORK ROOF PLAN

3M2.2