NOTE:

1. SEE SHEET M-001 FOR LEGEND AND ABBREVIATIONS.

KEYED NOTES:

1. INSULATE SA AND RA DUCTS WITH 1-1/2" FIBERGLASS, OVER-WRAP WITH MASS LOADED VINYL SOUND BARRIER, STC RATING 26, THICKNESS 0.100", 1 LB/SF.

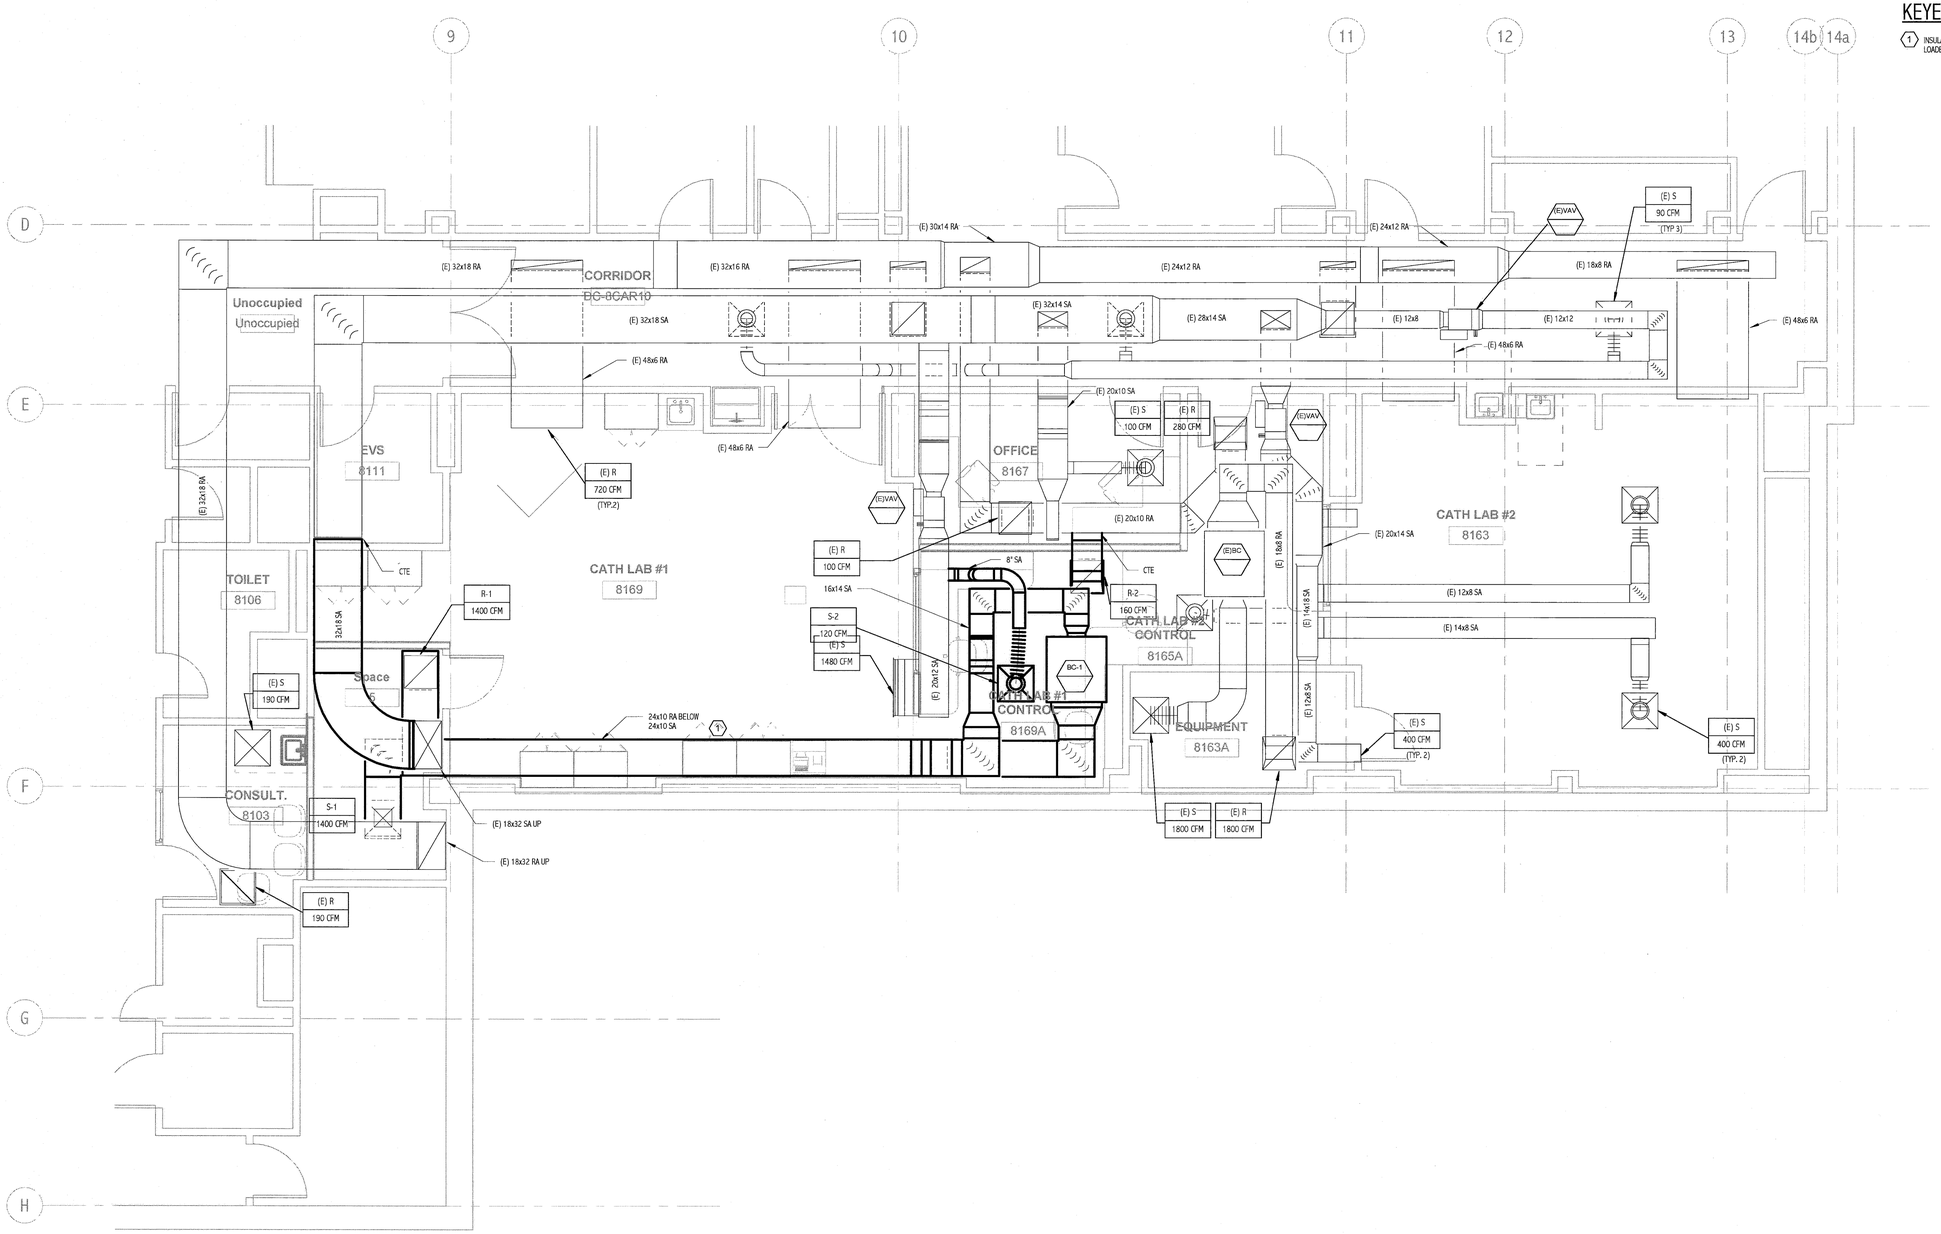

1 Cath Lab 1 Hvac Ductwork
1/4" = 1'-0"

144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070
www.smrtinc.com

ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING

SMRT

STATE OF MAINE
PETER W. BROWN
No. 5743
LICENSED PROFESSIONAL ENGINEER
12/21/10

PROJECT NORTH
TRUE NORTH

MAINE MEDICAL CENTER
CATH LAB #1
PORTLAND, ME

ISSUED FOR CONSTRUCTION
12-21-10
CURRENT ISSUE STATUS:

REV	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	12-21-10

GRAPHIC SCALE: 0" 1"

SCALE:	1/4" = 1'-0"
PROJECT MANAGER:	KD
JC/DRAWN BY:	BAL
A/E OF RECORD:	PMB
PROJECT NO:	10113-00
DATE:	12-21-10

SHEET TITLE:
CATH LAB 1 HVAC DUCTWORK PLAN

SHEET No.
MH 101

©COPYRIGHT 2008 SMRT, INC.