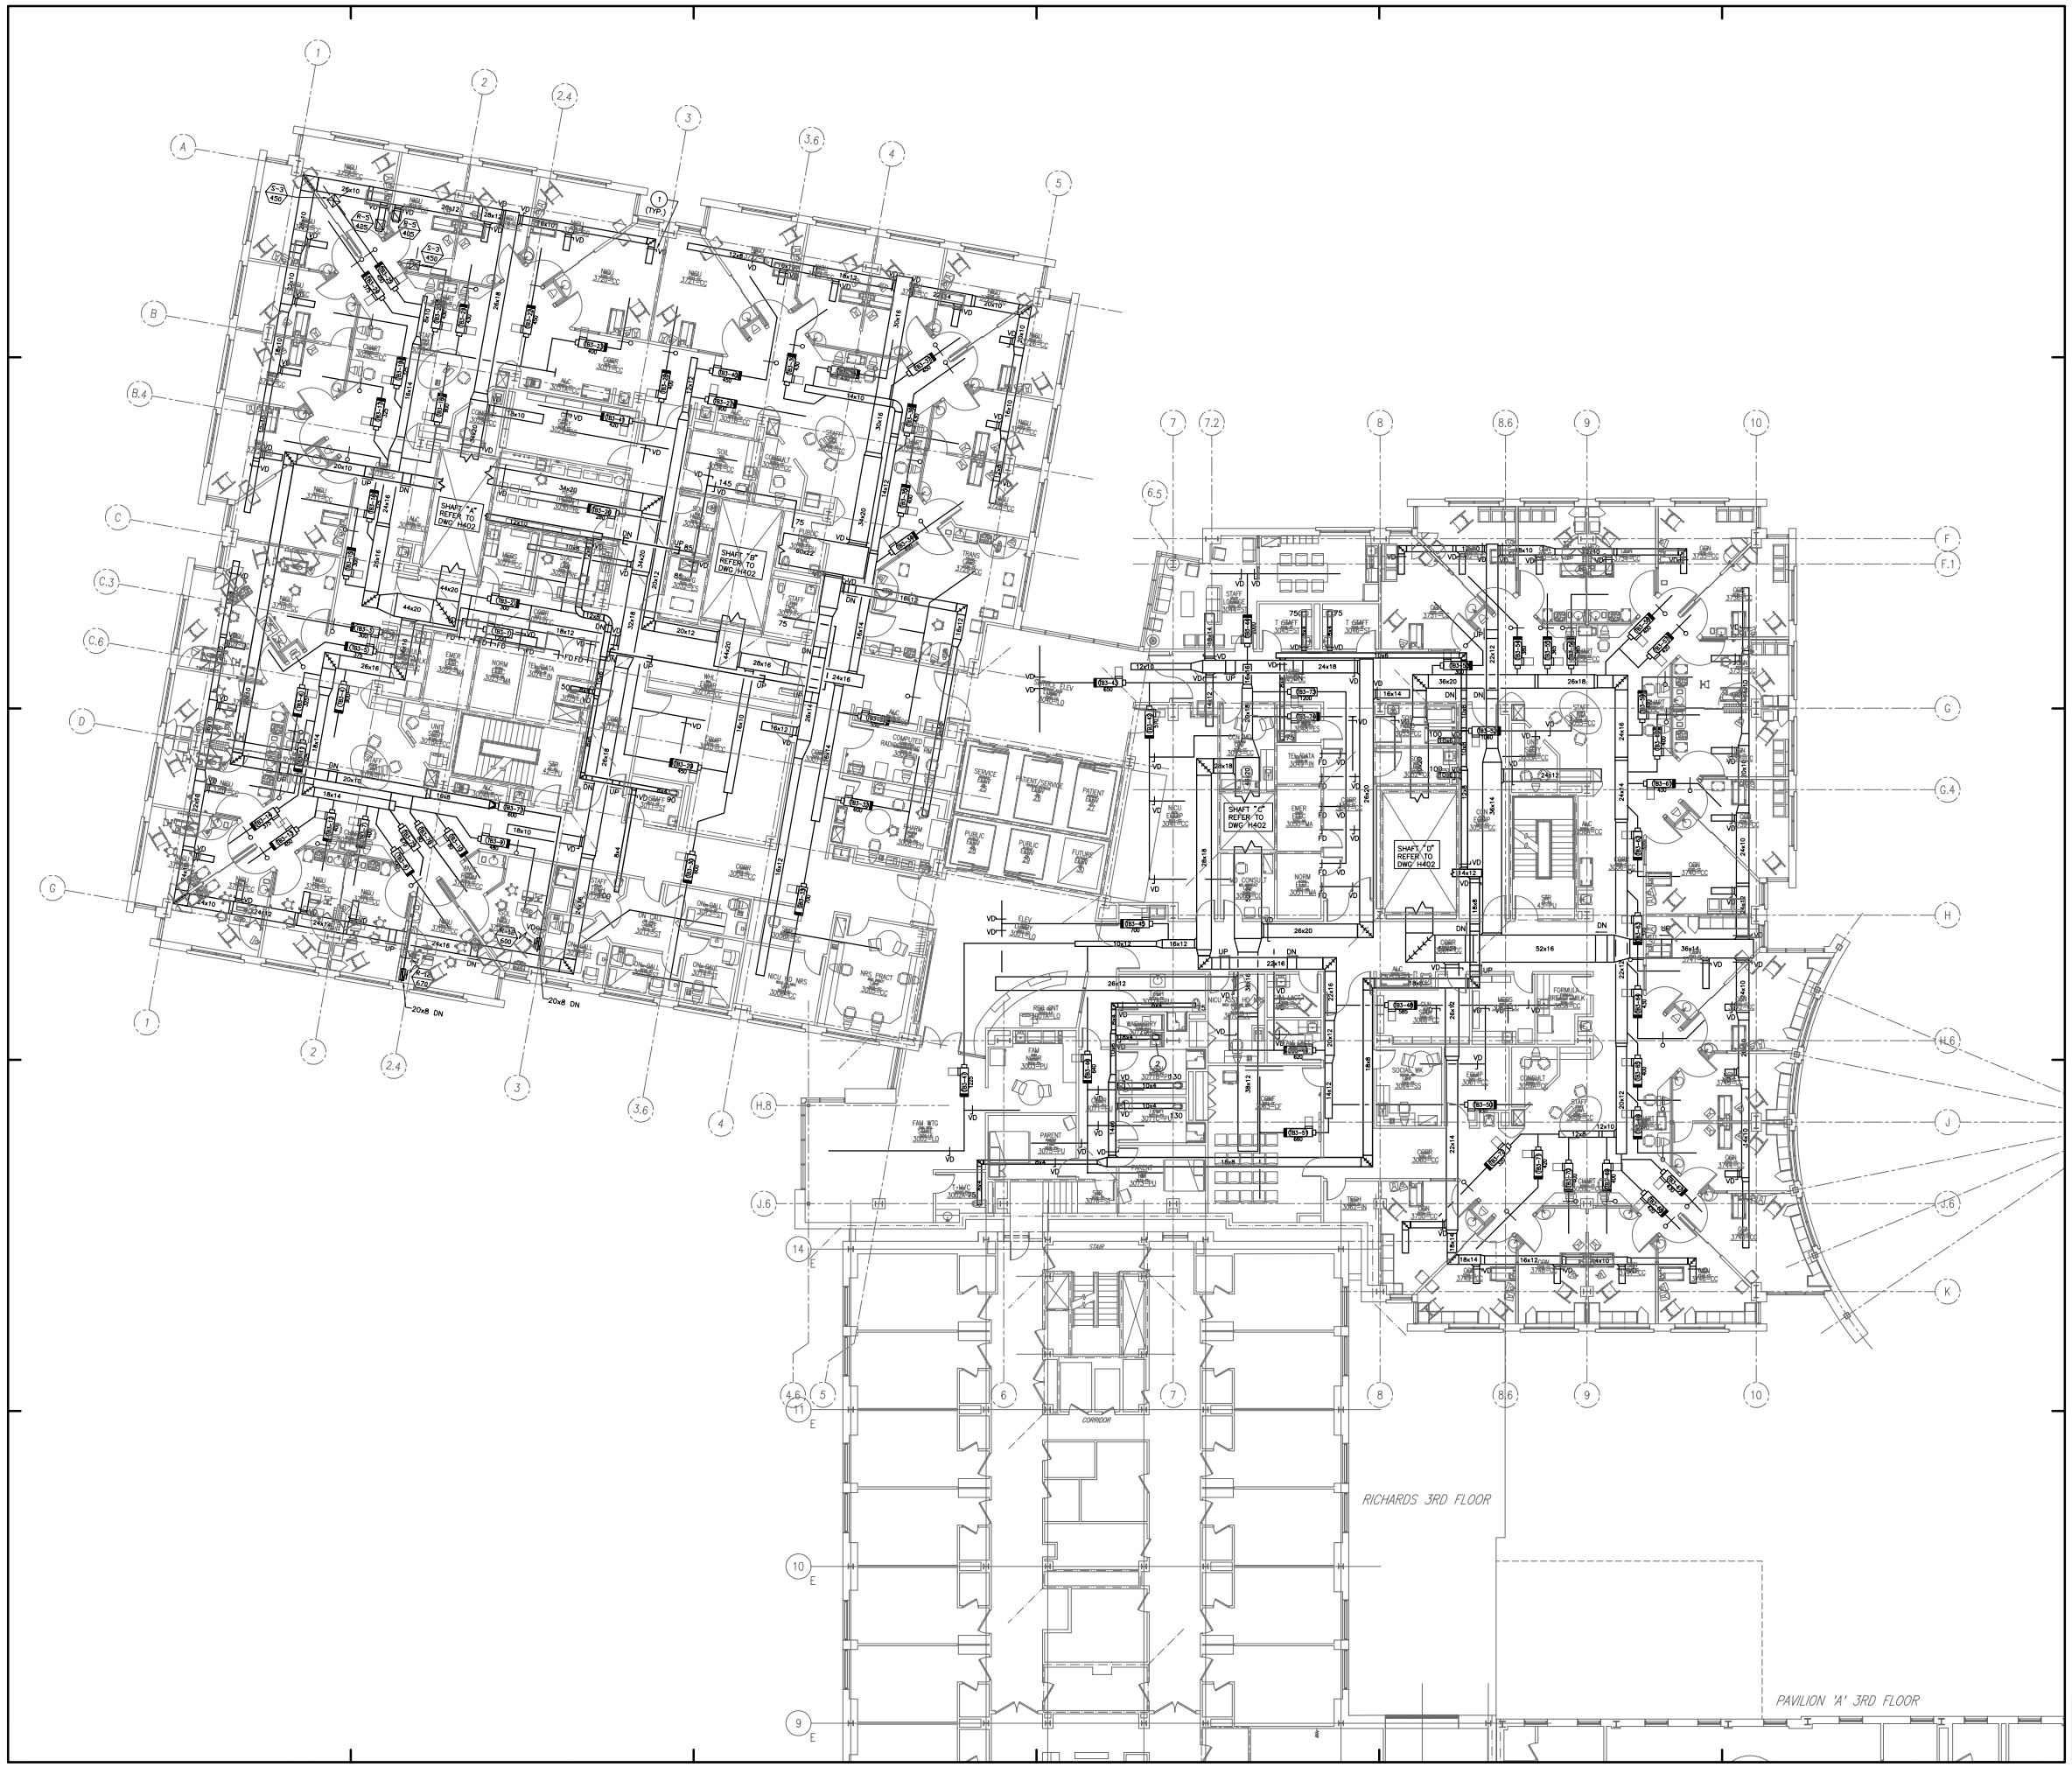

General Notes:

1. VOLUME DAMPERS SHALL BE PROVIDED ON ALL LOW PRESSURE SUPPLY, RETURN AND EXHAUST DUCT BRANCHES (TYP.)
2. REMOVABLE LINT TRAP FILTER. FILTER PRESSURE DROP SHALL BE <0.25".

MARK	ISSUE DATE	DESCRIPTION
PERMIT	09/24/04	PERMIT SET - NOT FOR CONSTRUCTION

FOR PERMIT ONLY - NOT FOR CONSTRUCTION

Issue Log



Key Plan

TRO
Architecture
Planning
Engineering
Interior Design
The Fitkin Organization
80 Bridge Street
Newton, MA 02465-1134
617-969-9400

Maine Medical Center
Charles Street Project
Portland, Maine
MMC Project No. 21841

Drawing Title
HVAC
THIRD FLOOR PLAN
DUCTWORK

0' 0 0 0 0

Commission No.	4673	Date Issued	
Scale	1/8"=1'-0"	Sheet Number	
Drawn By	FMC		H203
Approved By	GW		
Filename	4673H203.dwg		

Copyright © 2004 The Fitkin Organization