

FOOTING SCHEDULE					
MARK	FOOTING		DEPTH	REINFORCEMENT	
	LONG	SHORT		LONG	SHORT
F-1	20'-0"	20'-0"	4'-0"	22-#10	22-#10
F-2	18'-0"	18'-0"	3'-6"	18-#10	18-#10
F-3	17'-0"	17'-0"	3'-6"	20-#9	20-#9
F-4	16'-0"	16'-0"	3'-6"	18-#9	18-#9
F-5	15'-0"	15'-0"	3'-0"	17-#9	17-#9
F-6	14'-0"	14'-0"	3'-0"	14-#9	14-#9
F-7	13'-0"	13'-0"	2'-0"	12-#9	12-#9
F-8	8'-0"	8'-0"	2'-0"	8-#8	8-#8
F-9	23'-0"	18'-0"	4'-0"	22-#11	16-#11
F-10	24'-0"	20'-0"	4'-0"	26-#11	22-#11
F-11	6'-0"	6'-0"	2'-0"	6-#7	6-#7

PIER SCHEDULE					
MARK	SIZE		REINFORCEMENT	TIES	REMARKS
	L1	L2			
P1	2'-0"	2'-0"	8-#9	#4@12"	See DETAIL 1/S403
P2	3'-4"	2'-4"	12-#9	#4@4"	See DETAIL 2/S403
P3	3'-4"	2'-8"	12-#9	#4@4"	See DETAIL 3/S403
P4	3'-4"	2'-8"	12-#9	#4@4"	See DETAIL 4/S403
P5	2'-0"	2'-4"	8-#9	#4@12"	See DETAIL 5/S403
P6	2'-0"	1'-8"	10-#9	#4@12"	See DETAIL 6/S403
P7	2'-0"	2'-0"	8-#9	#4@12"	See DETAIL 7/S403
P8	3'-4"	2'-4"	12-#9	#4@4"	See DETAIL 8/S403

- Notes:
- Portions of existing construction adjacent to new construction may require underpinning/demolition.
 - Field verify location of all existing utilities prior to excavation.
 - Refer to drawings by others for size and location of concrete housekeeping pads in sub-basement.
 - Concrete mat below elevator pit is 52'-0"x46'-0"x3'-6" thick.
 - Deduct Alternate #1: Elevator pit to be decreased in size by eliminating pit for 2 future elevators. Pit wall shifts to grid 6.5.
 - Refer to Typical Details for footing subgrade requirements.
 - Deduct Alternate #4: Areaway to be eliminated from scope of work.

THIS IS A COPY OF THE DD DRAWINGS BEING ISSUED FOR EXCAVATION BID PURPOSES ONLY.


SGH
Simpson Gumpertz & Heger Inc.
Consulting Engineers

Boston, MA 41 Sejan Street, Building 1, Suite 500, Waltham, MA 02453
San Francisco, CA 222 Sutter Street, Suite 300, San Francisco, CA 94108-4445
Washington, DC 1365 Piccard Drive, Suite 220, Rockville, MD 20850

Telephone: (781) 907-9000
Facsimile: (781) 907-9009
Telephone: (415) 408-3700
Facsimile: (415) 408-3550
Telephone: (301) 417-0999
Facsimile: (301) 417-9825

FOR PERMIT ONLY - NOT FOR CONSTRUCTION

PERMIT: 09/24/04 PERMIT SET - NOT FOR CONSTRUCTION
Issue Log

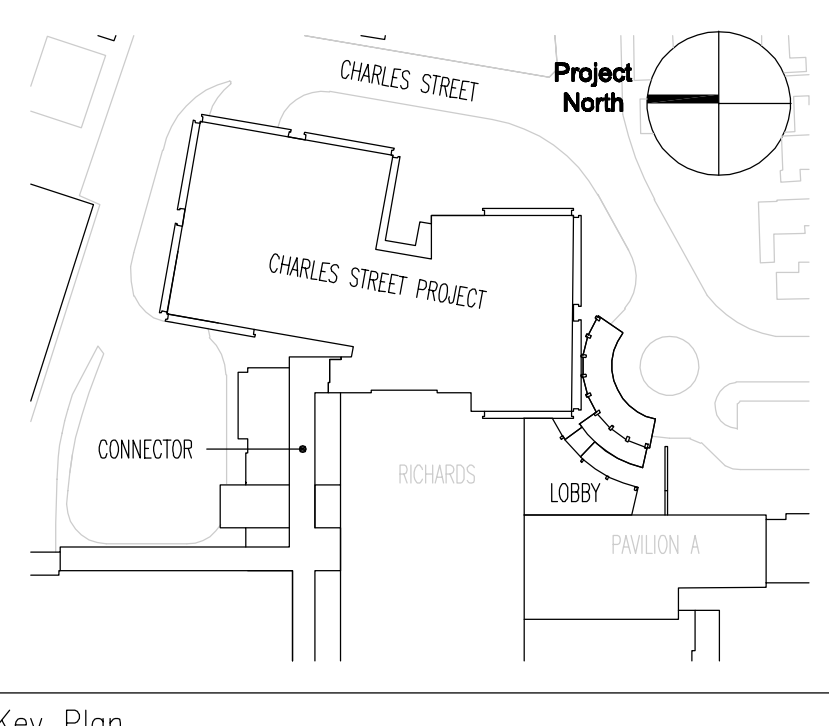


TRO
ARCHITECTURE
PLANNING
ENGINEERING
INTERIOR DESIGN

The Ritchie Organization
80 Bridge Street
Newton, MA 02458-1134
617-969-9400

Maine Medical Center
Charles Street Project
Portland, Maine MMC Project No. 21841

Drawing Title
SUB-BASEMENT PLAN

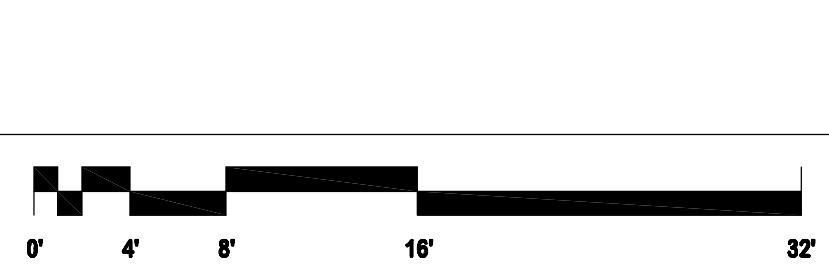

Commission No. 4673 Date Issued
Scale AS NOTED Sheet Number
Drawn By KMG/SK
Approved By JHT/JAM
Revision: L/2000/20684.00/

S2SB