



Project Title
**MAINE HEART SURGICAL ASSOC.
 NEW OFFICE BLDG.**
 PORTLAND, ME

HA Project No. **04180**

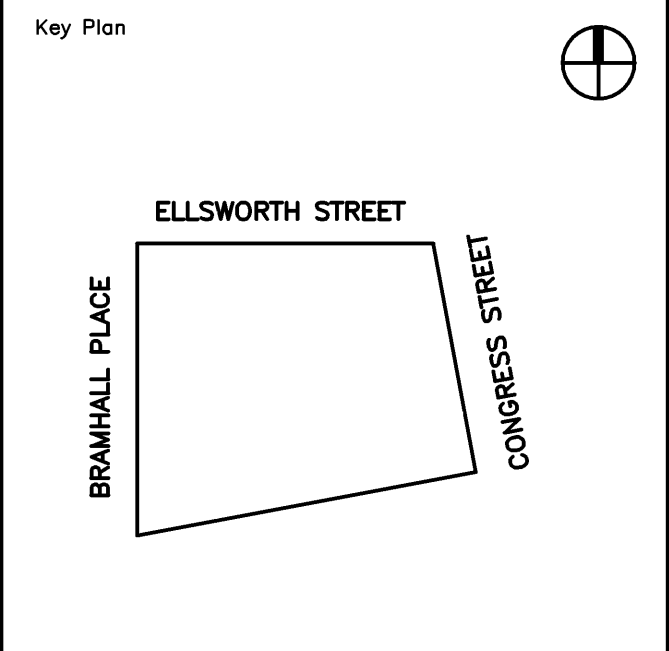

KEY NOTES:
 L01... MINIMUM WIRE SIZE SHALL BE #10 A.W.G. SEE DETAIL (LIGHTING CONTROLS) ON DRAWING E10.1 FOR CIRCUITING. CONDUITS SHALL BE CONCEALED FOR ENTRYWAY LIGHTING AND TWO TYPE K LIGHTING FIXTURES ON SECOND LEVEL PARKING.
 L06... COORDINATE LIGHTING FIXTURES WITH MECHANICAL PIPING, DUCT WORK AND EQUIPMENT.
 POS... CEILING SPACE ABOVE THE SECOND FLOOR PARKING LEVEL IS USED AS AN AIR PLENUM.

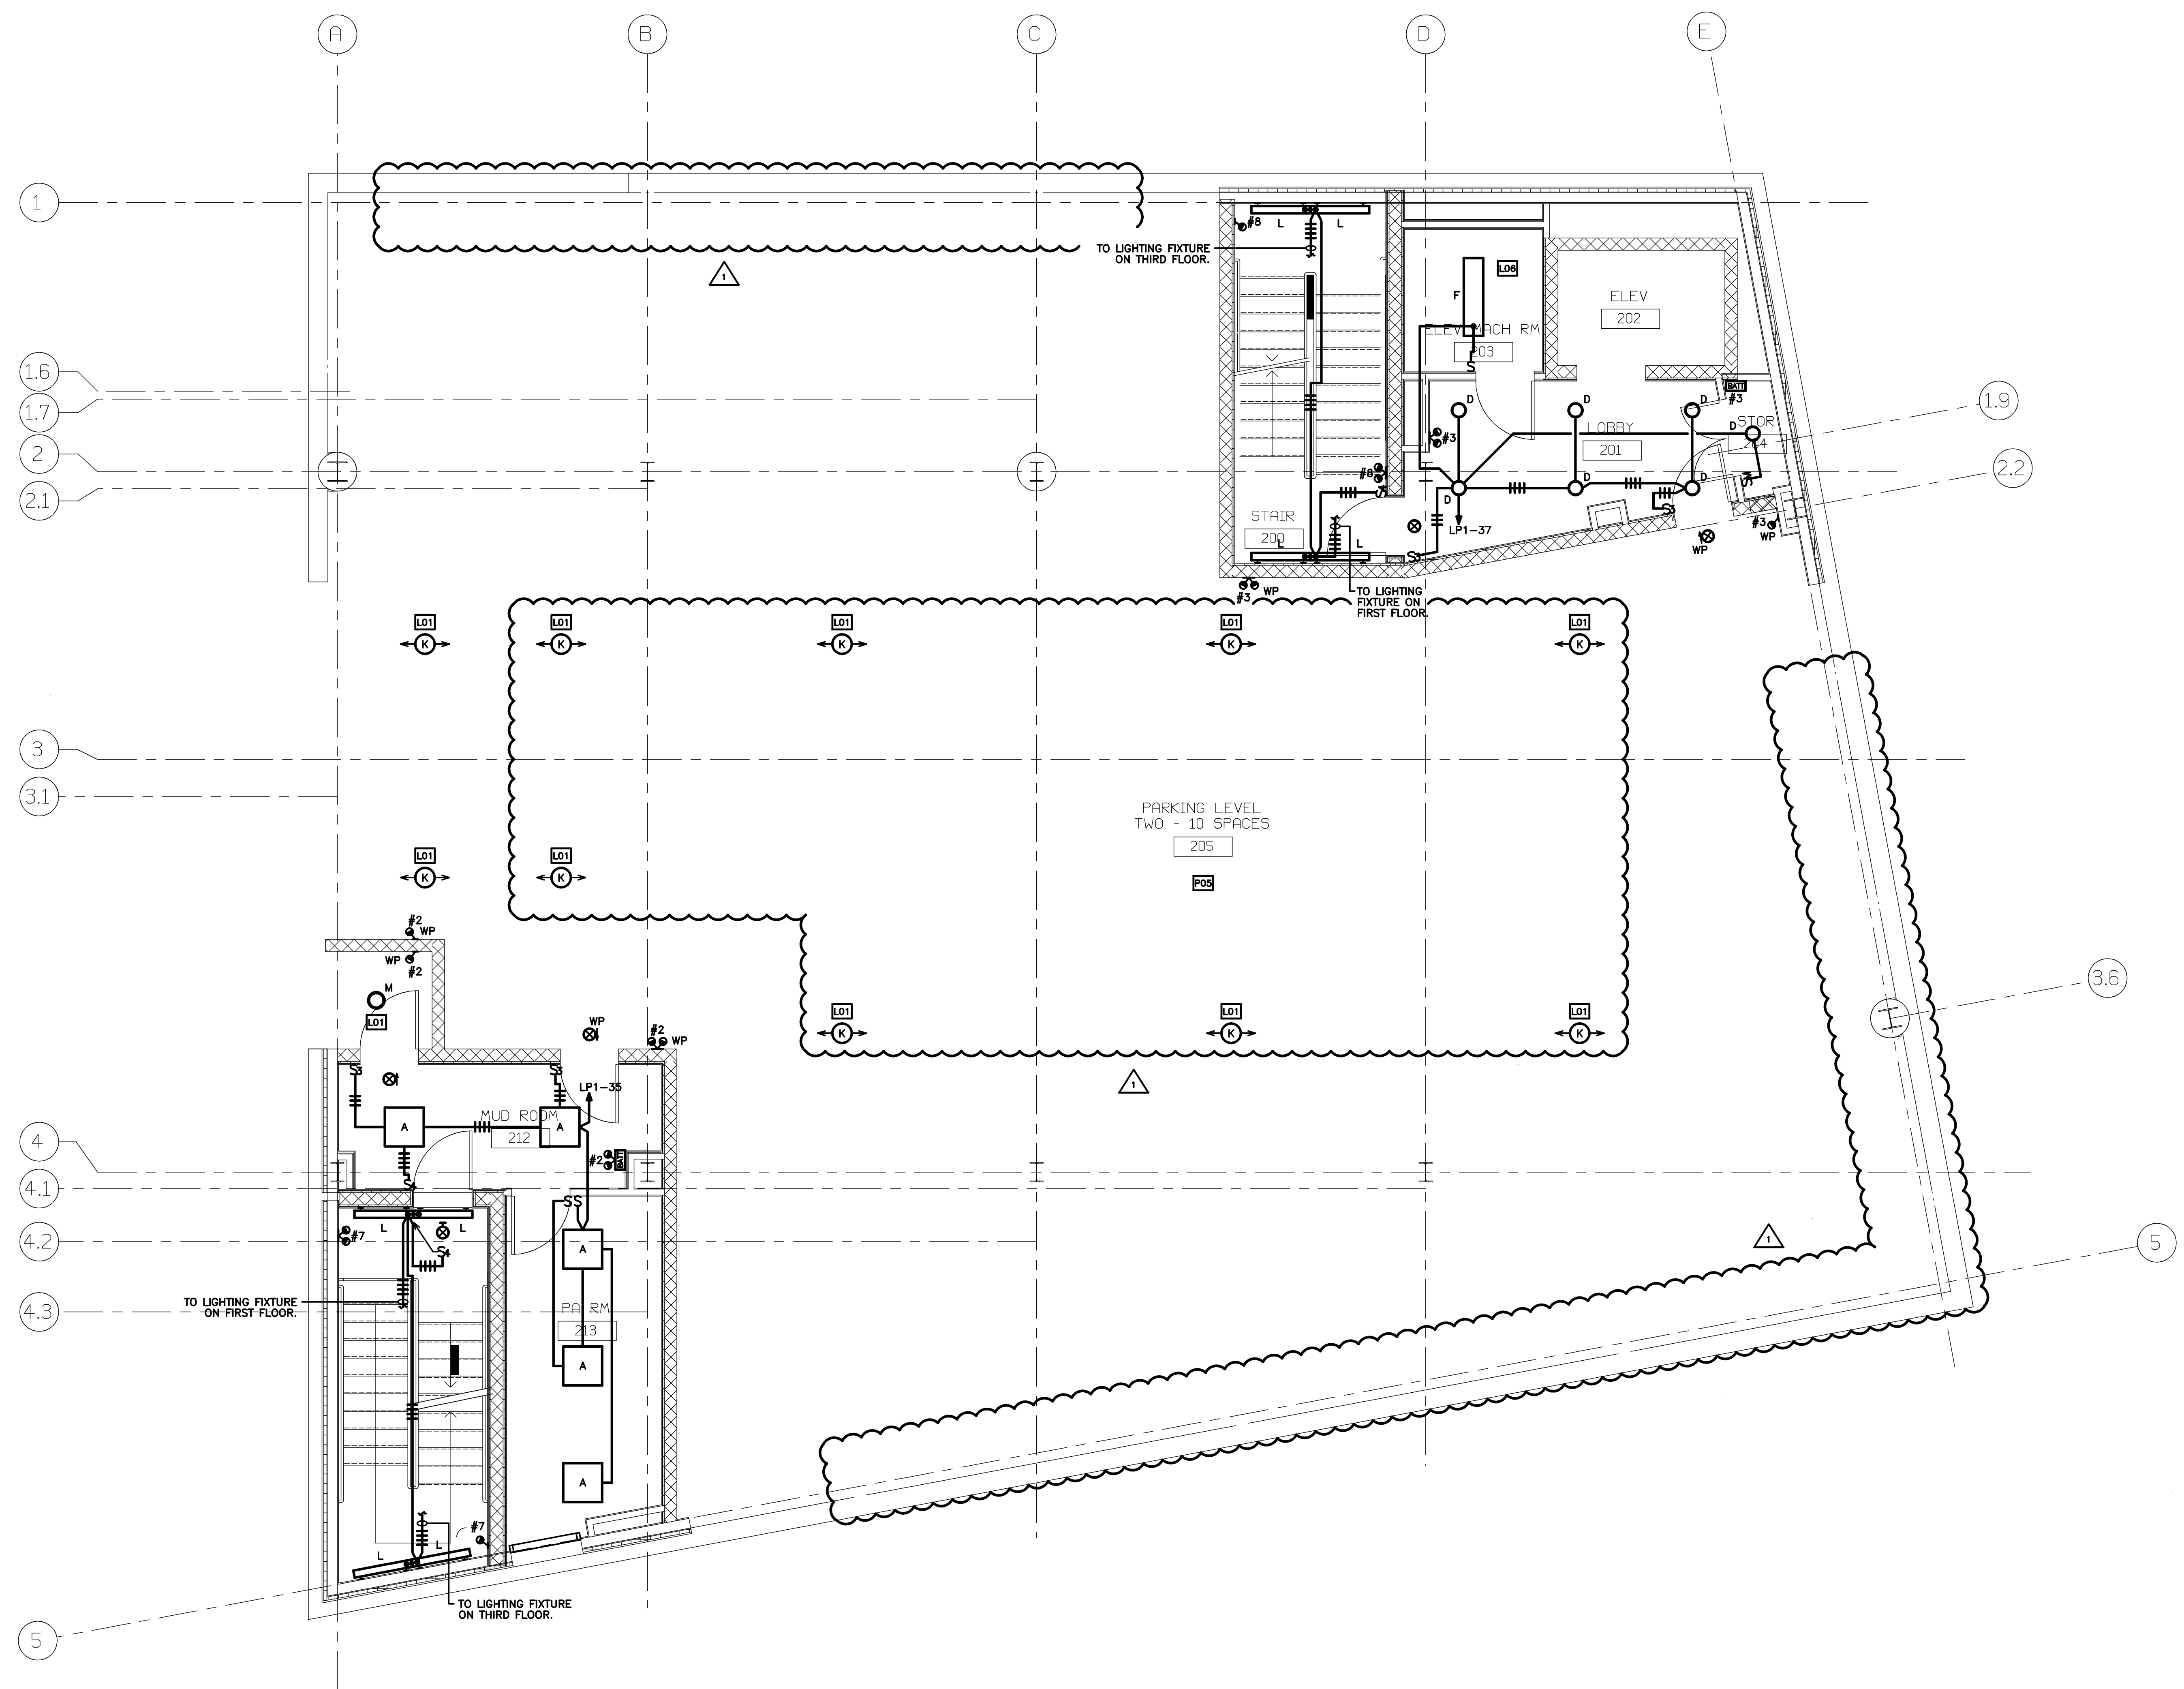

△	06-15-05	FOR PRICING
-	04-28-05	ISSUED FOR BID
-	04-11-05	100% REVIEW
-	01-10-05	DD REVIEW
Mark	Date	Description
Issue Dates		

Drawing Status

Drawing Title
**SECOND FLOOR
 PLAN - LIGHTING**

PA / PE: **PRM** Drawn By: **JMB/KRM**

Drawing Number
E10.2