

G. DIAGRAMS FOR SIDEWALL VENTING

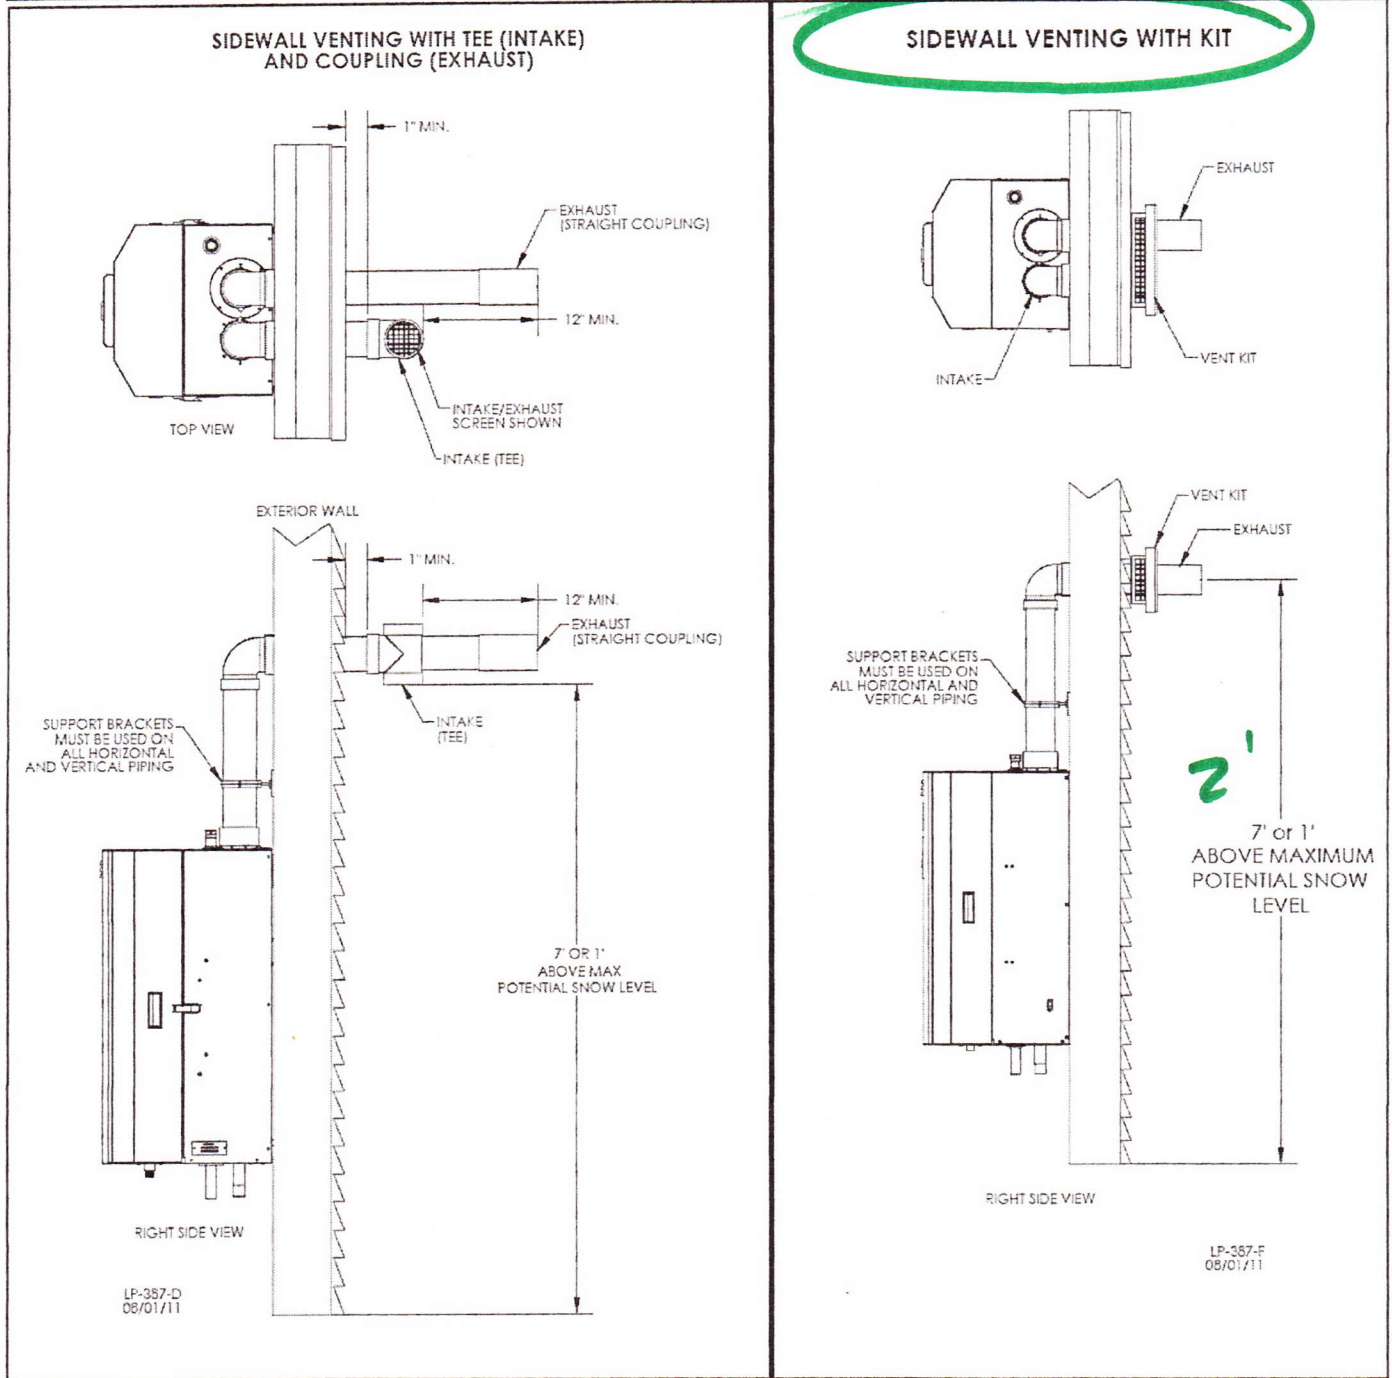


Figure 19 – Sidewall Venting with Tee (Intake) and Coupling (Exhaust) (Standard Equipment) and with Optional Kit

NOTE: Vent piping should be 12" over anticipated maximum snow level.

NOTE: Drawing is meant to demonstrate system venting ONLY.

⚠ WARNING

All vent pipes must be glued, properly supported, and the exhaust must be pitched a minimum of 1/4" per foot back to the boiler to allow drainage of condensate. When placing support brackets on vent piping, the first bracket must be within 1 foot of the boiler and the balance at 4 foot intervals on the vent pipe. Boiler venting must be readily accessible for visual inspection for the first three feet from the boiler.