


Overall Length: 16 0 0

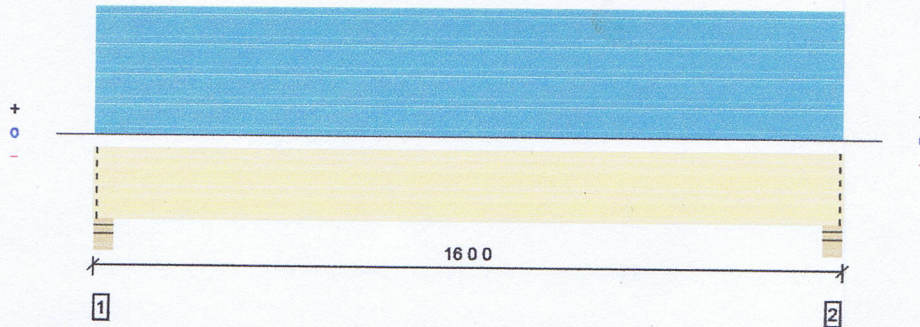

LVL #1

*4 TAILER
 5 SINK
 10 TAILER
 25 SINK*

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	11802 @ 0 4 0	12272 (5.50")	Passed (96%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	9159 @ 1 9 8	15960	Passed (57%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	43354 @ 8 0 0	46671	Passed (93%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.403 @ 8 0 0	0.511	Passed (L/457)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.571 @ 8 0 0	0.767	Passed (L/322)	--	1.0 D + 1.0 L (All Spans)

System : Floor
 Member Type : Drop Beam
 Building Use : Residential
 Building Code : IBC
 Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Bracing (Lu): All compression edges (top and bottom) must be braced at 4 5 0 o/c unless detailed otherwise. Proper attachment and positioning of lateral bracing is required to achieve member stability.


Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Total	
1 - Stud wall - SPF	5.50"	5.50"	5.29"	3482	8320	11802	Blocking
2 - Stud wall - SPF	5.50"	5.50"	5.29"	3482	8320	11802	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location	Tributary Width	Dead (0.90)	Floor Live (1.00)	Comments
1 - Uniform (PSF)	0 0 0 to 16 0 0	13 0 0	12.0	40.0	Residential - Living Areas
2 - Uniform (PLF)	0 0 0 to 16 0 0	N/A	100.0	-	wall
3 - Uniform (PSF)	0 0 0 to 16 0 0	13 0 0	12.0	40.0	2nd floor

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Refer to current Weyerhaeuser literature for installation details. (www.woodbywy.com) Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports refer to http://www.woodbywy.com/services/s_CodeReports.aspx.



The product application, input design loads, dimensions and support information have been provided by Forte Software Operator

Forte Software Operator	Job Notes
Santo Ruzzi Bluelinx (207) 432-6741 Santo.Ruzzi@bluelinxco.com	Butman