

**HOOD INFORMATION - Job#1841019**


HOOD NO.	MODEL	LENGTH	MAX. COOKING TEMP.	TOTAL EXH. CFM	EXHAUST PLENUM RISE(S)			HOOD CONSTRUCTION	HOOD CONFIG.	
					EXH. DIA.	LENG.	CFM		END TO END	ROW
1	4824 ND-2	5' 000"	600 Deg	1125	12"	12"	1125	430 SS	ALONE	ALONE

**HOOD INFORMATION**

HOOD NO.	TYPE	FILTER(S)			LIGHT(S)			WIRE GUARD	LOCATION	FIRE SYSTEM		ELECTRICAL MODEL #	SWITCHES QUANTITY	FIRE SYSTEM/CHANGING PIPING	HOOD WEIGHT
		QTY	HEIGHT	LENGTH	QTY	TYPE	SIZE			TYPE	SIZE				
1	SS Baffle with Handles	3	16"	20"	2	Screw In Compact	ND							ND	244 LBS

**HOOD OPTIONS**

HOOD NO.	OPTION
1	RIGHT QUARTER END PANEL 23" Top Width, 0" Bottom Width, 23" High 430 SS
	LEFT QUARTER END PANEL 23" Top Width, 0" Bottom Width, 23" High 430 SS

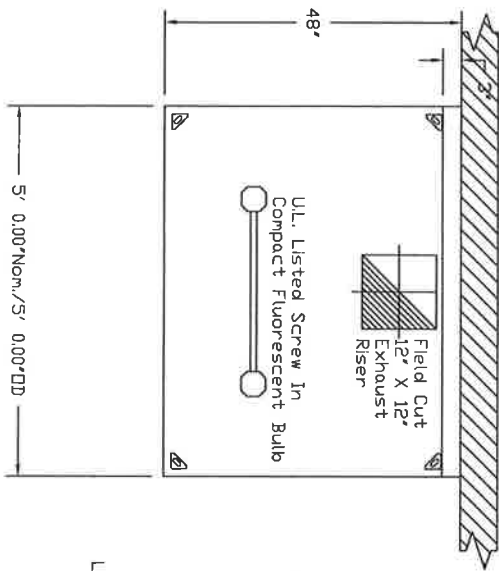


**PLAN VIEW - Hood #1**  
5' 0.00" LONG 4824ND-2

FIELD CUT EXHAUST RISER  
HANGING ANGLE  
16" SS BAFFLE WITH HANDLES AND HOOD  
3" INTERNAL STANDOFF

IT IS THE RESPONSIBILITY OF THE ARCHITECT/DRAWER TO ENSURE THAT THE HOOD CLEARANCE FROM LIMITED-COMBUSTIBLE AND COMBUSTIBLE MATERIALS IS IN COMPLIANCE WITH LOCAL CODE REQUIREMENTS.

GREASE DRAIN WITH REMOVABLE CUP  
LEFT AND RIGHT QUARTER END PANELS

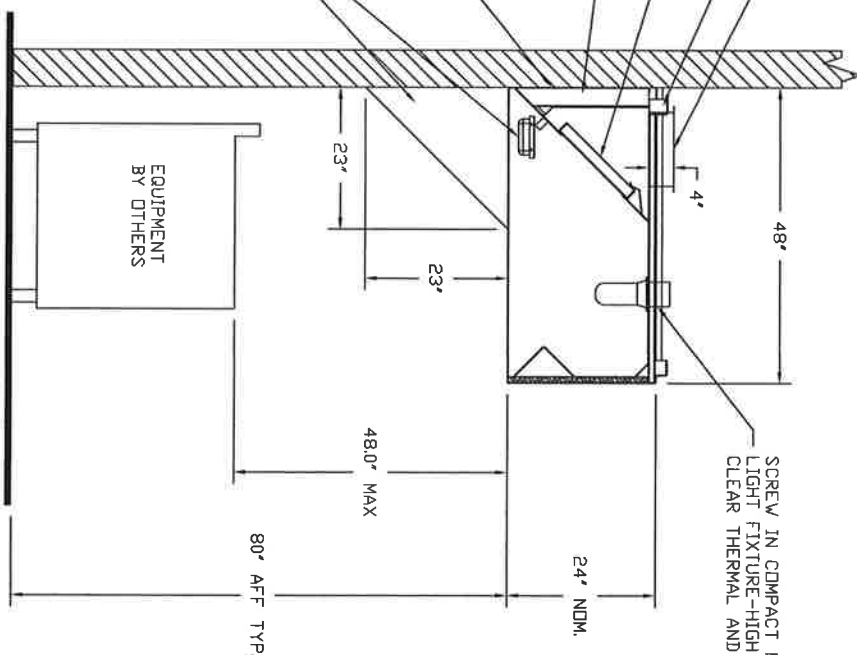

SCREW IN COMPACT FLUORESCENT BULB, INCANDESCENT LIGHT FIXTURE-HIGH TEMP ASSEMBLY, INCLUDES CLEAR THERMAL AND SHOCK RESISTANT GLOBE

CUSTOMER APPROVAL TO MANUFACTURE:

Approved as Noted

Approved with ND Exception Taken

Revise and Resubmit

SIGNATURE \_\_\_\_\_ Date \_\_\_\_\_

Your Title \_\_\_\_\_

**SECTION VIEW - MODEL 4824ND-2**

**HOOD - #1**



**CAPTIVEAIRE**

JOB Aurora Provisions R1	
LOCATION	Lewiston, ME
DATE	8/8/2013
DWG #	1
REV.	
JOB #	1841019
DRAWN BY	BFC-21
SCALE	3/8" = 1'-0"