

(1) GENERAL NOTES:

- A. FIRE ALARM SYSTEM WIRING SHALL COMPLY WITH THE NATIONAL ELECTRICAL CODE, APPLICABLE STATE AND LOCAL CODES, AND SHALL BE COORDINATED WITH THE LOCAL AUTHORITY HAVING JURISDICTION.
- B. CAUTION: DO NOT CONNECT ANY POWER TO THE CONTROL PANEL (BATTERIES OR 120V AC) UNTIL ALL OTHER FIELD WIRING IS TESTED AND CONNECTED.
- C. DO NOT INSTALL FIRE ALARM CONTROL PANEL, NAC POWER SUPPLY PANEL, SMOKE DETECTORS OR ANY ADDRESSABLE DEVICES IN UNHEATED SPACES.
- D. DO NOT INSTALL ANY AC CURRENT-CARRYING CONDUCTORS CLOSE TO OR IN THE SAME RACEWAY WITH FIRE ALARM SYSTEM CONDUCTORS.
- E. SOLID LINES REPRESENT CONNECTIONS TO BE MADE BY THE SYSTEM INSTALLER.
- F. ALL RELAYS ARE SHOWN IN NORMAL SUPERVISORY CONDITION. ALL RELAYS ARE FORM "C" TYPE.

(2) INSTALLATION NOTES

- A. SMOKE DETECTORS SHALL NOT BE MOUNTED ANY CLOSER THAN 3' FROM ANY AIR DUCT OPENINGS
- B. ELEVATOR LOBBY SMOKE DETECTORS SHALL BE MOUNTED WITHIN 10' OF THE ELEVATOR DOOR
- C. MANUAL PULL STATIONS SHALL BE MOUNTED PER ADA REQUIREMENTS: 48" AFF OR 42" AFF TO COMPLY WITH SIDE/FRONT REACH REQUIREMENTS
- D. WALL MOUNTED HORN/STROBES & STROBES SHALL BE MOUNTED 6" FROM CEILING, OR 96" TO 80" AFF TO THE CENTER OF STROBE.
- E. HORN/STROBES & STROBES SHALL BE MOUNTED 15' FROM THE CORNER OF THE WALL. IF THIS IS NOT POSSIBLE, DEVICE SHALL BE CENTERED ON THAT WALL.
- F. CEILING MOUNTED HALLWAY DEVICES SHALL BE LOCATED IN A SYMMETRICAL MANNER DOWN CENTER OF HALLWAY WHEN POSSIBLE.
- G. MONITORING REQUIRES TWO FAIRPOINT PHONE LINES UNLESS OTHER ARRANGEMENTS HAVE BEEN MADE.

(3) SEE INITIATION CIRCUITS AND NAC CIRCUITS FOR INTEGRATION OF BOTH SLC AND NAC CIRCUITS


(4) ALL CABLING IS 14/2 FOR THE NAC CIRCUITS UNLESS OTHERWISE SHOWN

(5) ALL CABLING IS 16/2 FOR THE SLC CIRCUITS UNLESS OTHERWISE SHOWN

(6)

- | | |
|--------------------------------------|--|
| AC = ALARM CONTROL MODULE | K = KNOX BOX |
| R = ARM = ADDRESSABLE RELAY MODULE | LA = LOW AIR |
| AV = AUDIO VISUAL DEVICE | MM = MINI MODULE |
| (SET TO 15cd UNLESS NOTED OTHERWISE) | P = PULL STATION |
| B = EXTERIOR BEACON | PS = PRESSURE SWITCH |
| CO = CO DETECTOR | RI = REMOTE INDICATOR |
| D = DUAL MODULE | S = SMOKE |
| DUCT=DUCT DETECTOR | SA = SMOKE WITH AUDIBLE BASE |
| F = FLOW | T = TAMPER |
| FACP = MAIN FIRE PANEL | TS = TEST SWITCH |
| H = HEAT DETECTOR | V = VISUAL DEVICE ONLY |
| I = ISOLATION MODULES | (SET TO 15cd UNLESS NOTED OTHERWISE) |
| T.S. = TWISTED SHIELDED | MH = MINI HORN |
| S/CO = SMOKE/CO DETECTOR | RTS = REMOTE TEST MODULE |
| RL = REMOTE LIGHT | PS = PULL STATION |
| | CL = CORRIDOR LIGHT |
| | CO = CO DETECTOR (MAY REQUIRES 24 VDC POWER) |
| | SCM = INPUT MODULE |
- Ⓢ = FIRE EXTINGUISHER MONITORING

NOTE:
Wireless heat detectors in all of the apartments

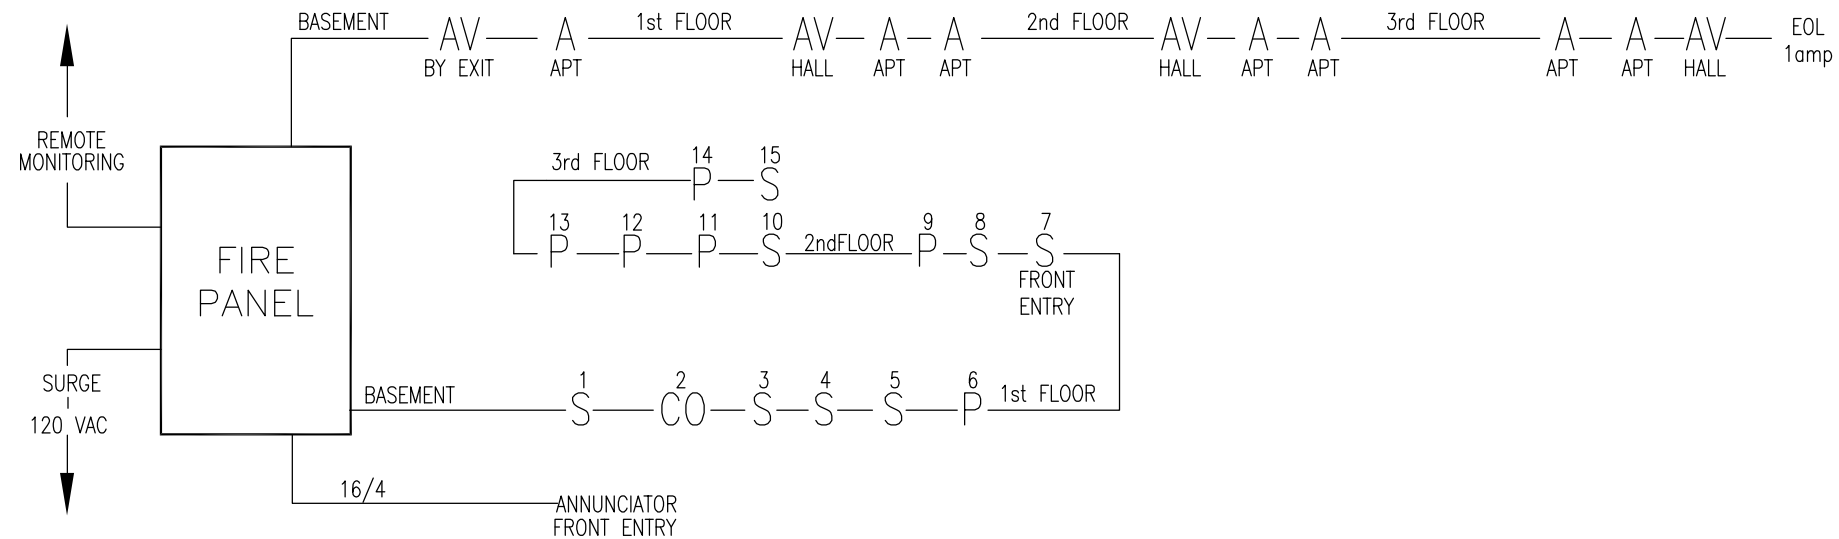

CONSULTANT: Rich Brobst, JR.

21 RICE STREET, UNIT #2
PORTLAND, MAINE 04103

Phone: (207) 536-4800
Cell: (207) 699-6800

PROJECT:
22 Cushman Street
POTLAND, Maine

DRAWING:
RISER

REVISIONS

DATE: 01/06/18
SCALE: NTS
DRAWN BY: SSA
APPROVED BY: -
SHEET: 1