




Install Date: 2017  
Little Giant Portland  
211 Danforth Street  
Portland, ME 04102

Allstate Fire Equipment  
44 Garden Street  
Danvers, MA 01923  
Linc Mulno  
781-224-1001  
lmulno@lfpfire.com  
MACR 4612

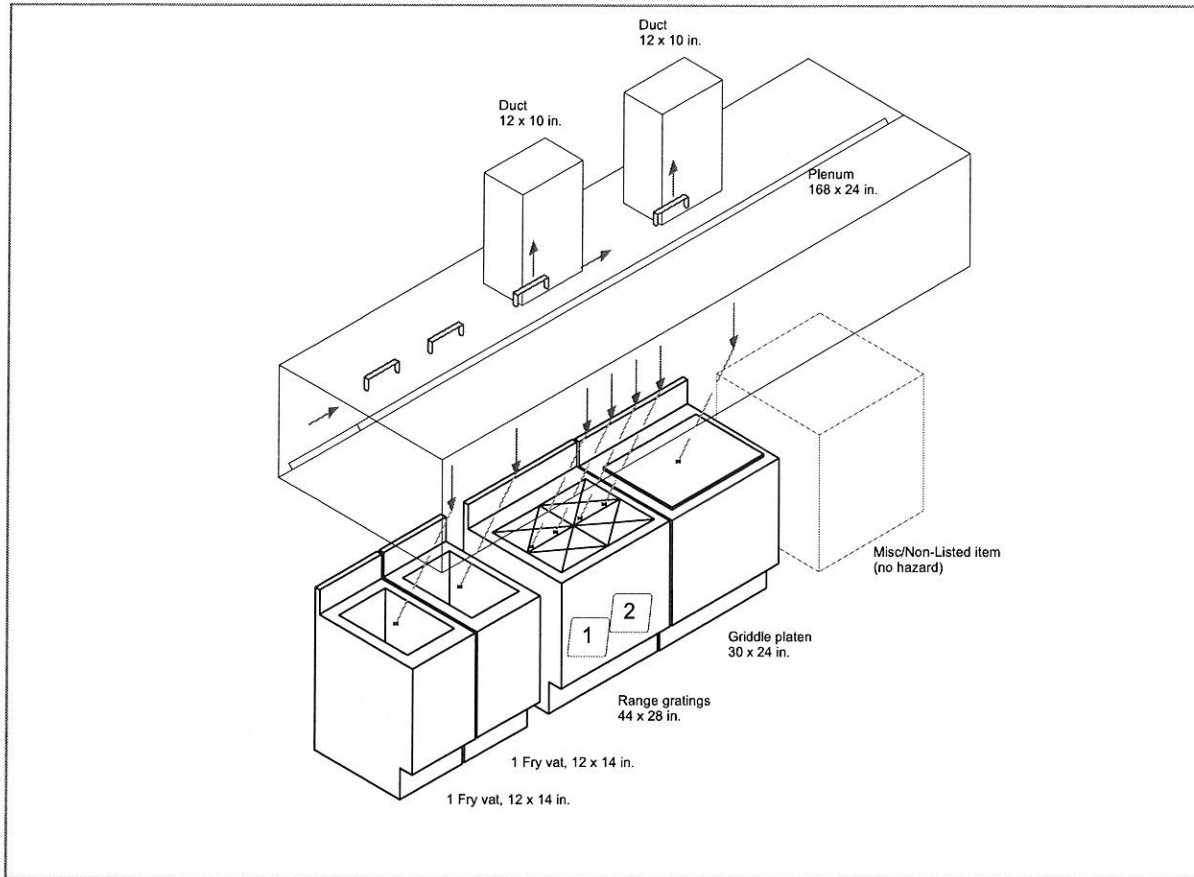

#### Flow Summary:

Coverage	Overall Dimensions	Nozzle	Flows	Nozzle Location
Hood: Single Bank	168 x 54 in.	1N x2	2	2-4 in. from filter face, center of height dimension, aimed down filter length.
Duct: Square	12 x 10 in.	1W	1	2-8 in. into center of duct opening, aimed up
Duct: Square	12 x 10 in.	1W	1	2-8 in. into center of duct opening, aimed up
Fryer: 1 vat	14 x 16 in.	3N	3	25-35 in., FRONT HALF of perimeter, aimed at center
Fryer: 1 vat	16 x 16 in.	3N	3	25-35 in., FRONT HALF of perimeter, aimed at center
Range: 2 burners	48 x 32 in.	1F x4	4	40-48 in., front edge of burner, nozzle flats parallel with burner front-to-rear ... See Note 2
Griddle	34 x 27 in.	1N	1	35-40 in., 0-2 in. inside perimeter, aimed at center
Total Flow Points			15	