



**NOTES:**


1. SEE SHEET FA-001 FOR LEGEND, ABBREVIATIONS, AND GENERAL NOTES.
2. REMOVE ALL FIRE ALARM EQUIPMENT COMPLETELY UNLESS OTHERWISE INDICATED, AND WHETHER EXPLICITLY SHOWN ON THIS SHEET OR NOT. REMOVE ALL WIRING, AND EQUIPMENT SUPPORTS. CONDUIT IS ALLOWED TO BE RE-USED IF IT IS IN SUITABLE CONDITION.

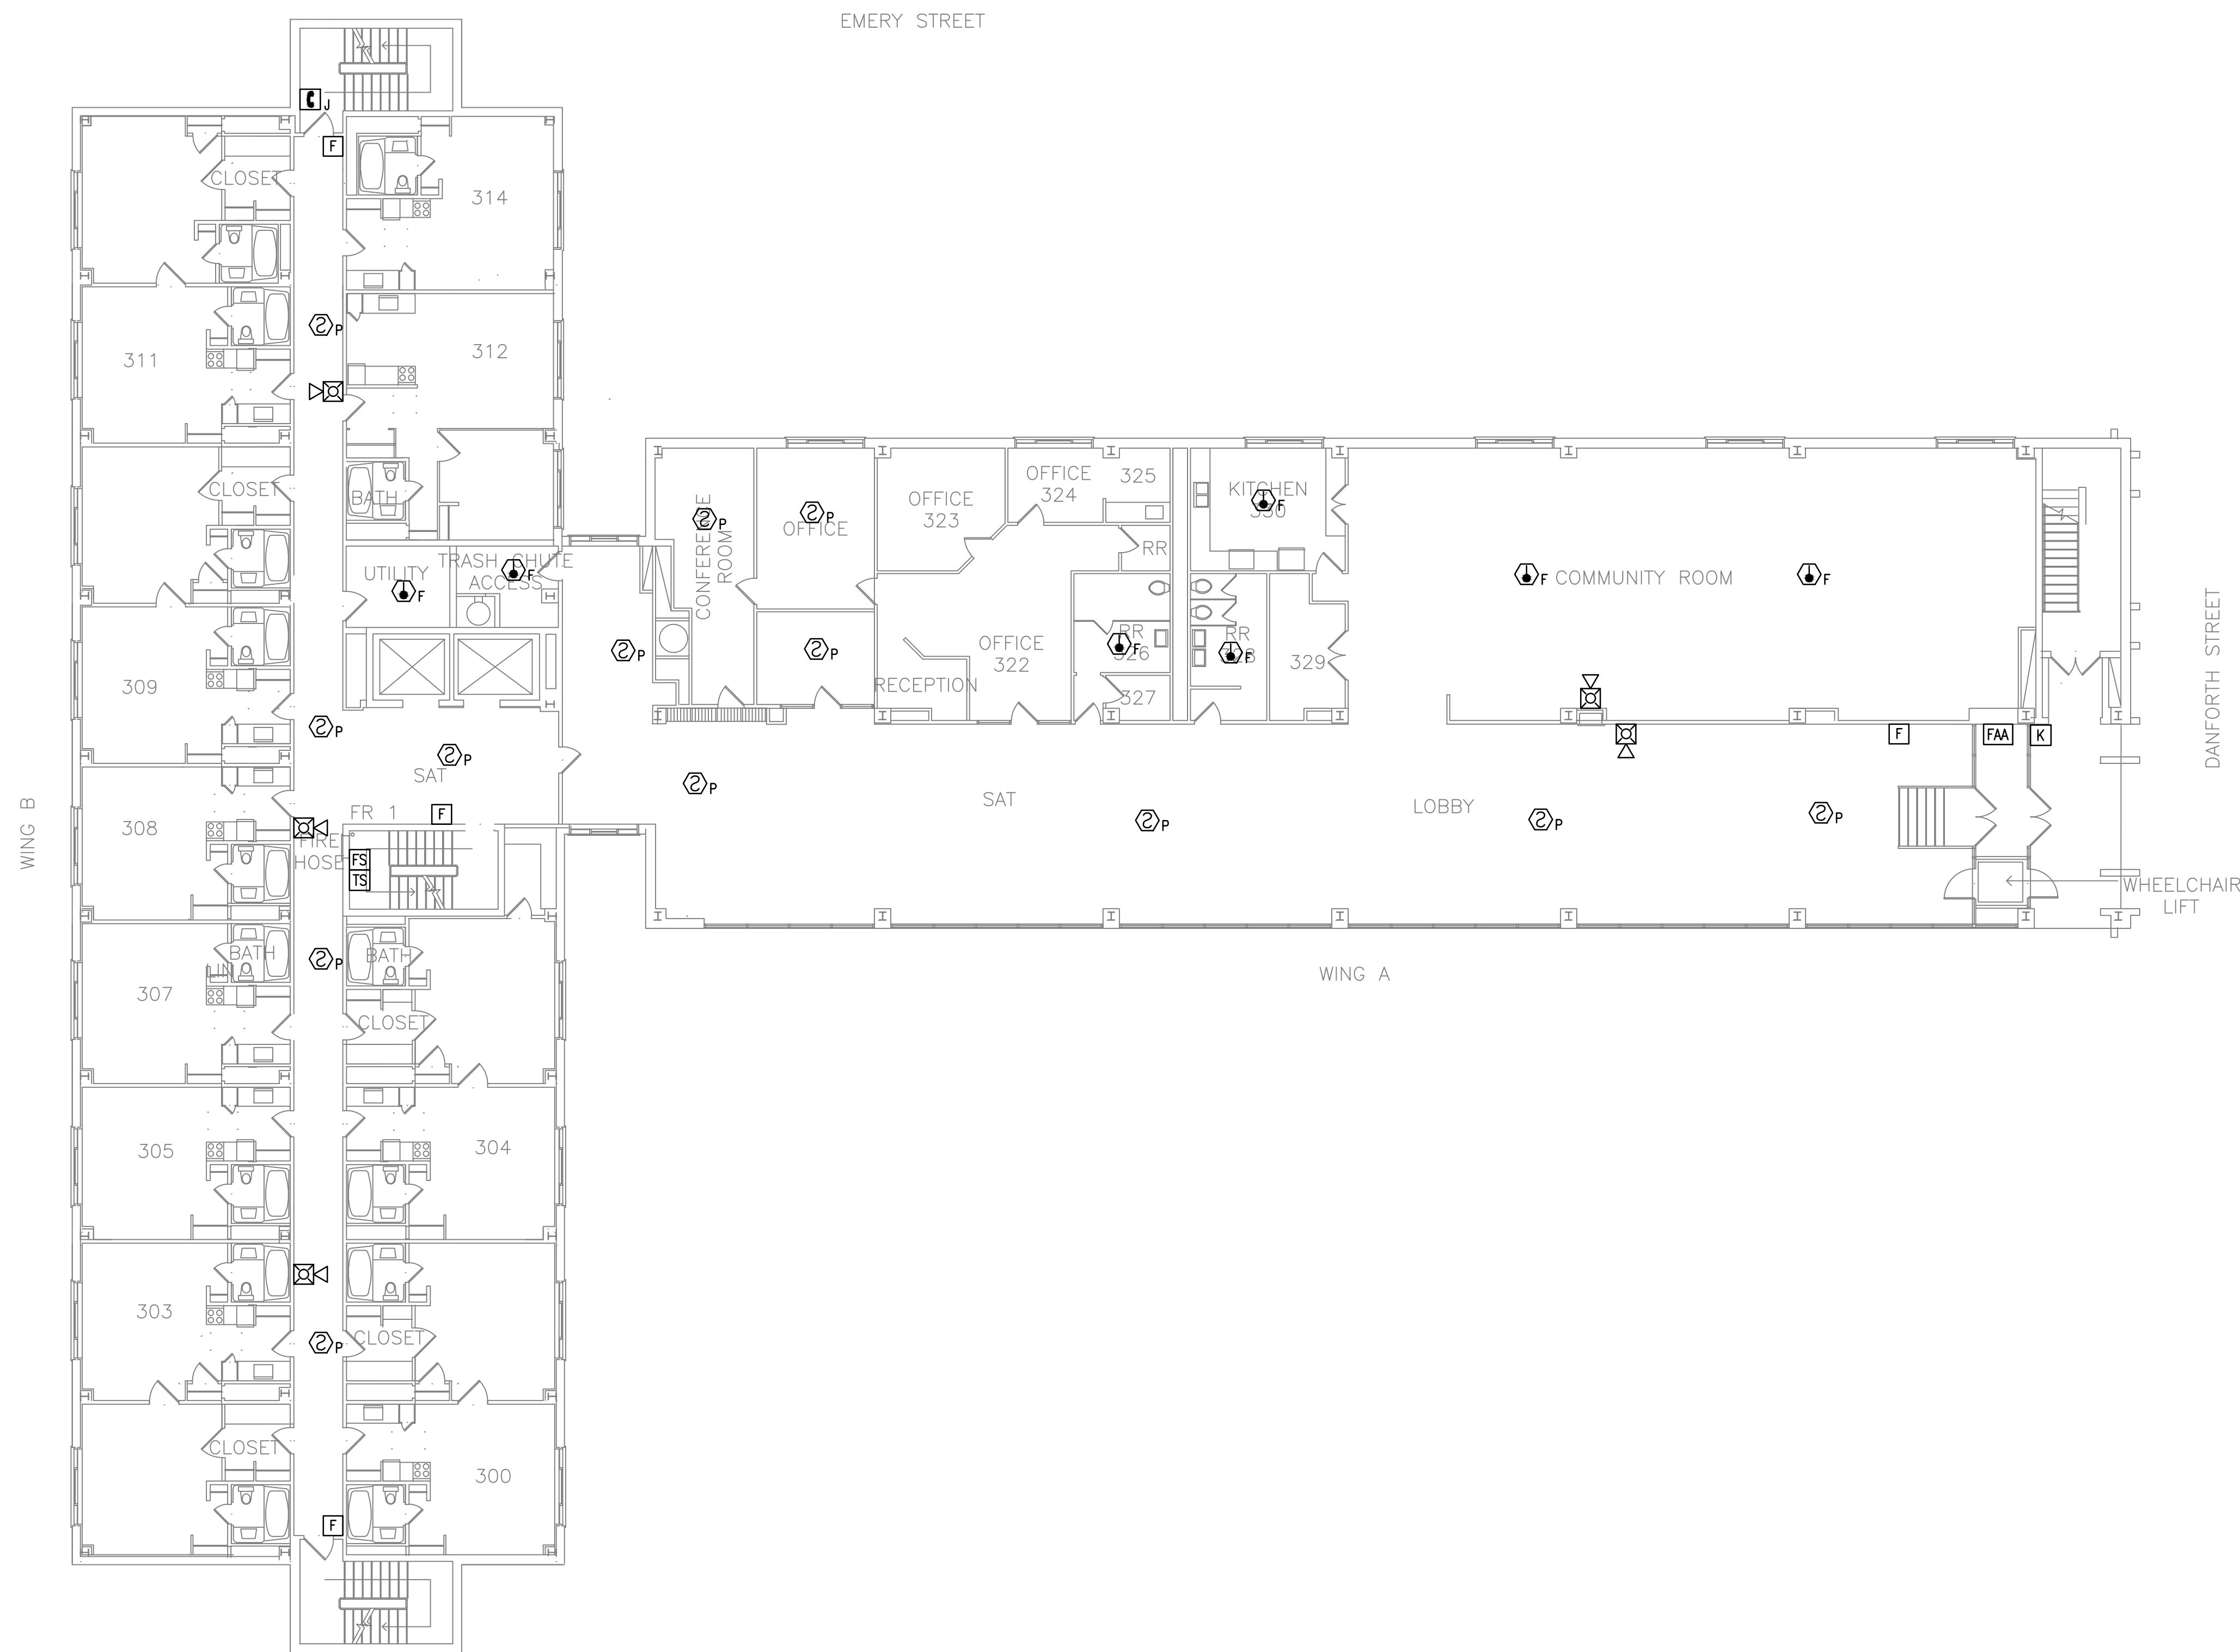

**THIRD FLOOR FIRE ALARM DEMOLITION PLAN**  
SCALE: 3/32" = 1'-0"



0 8' 16' 24'  
Scale: 3/32" = 1'-0"

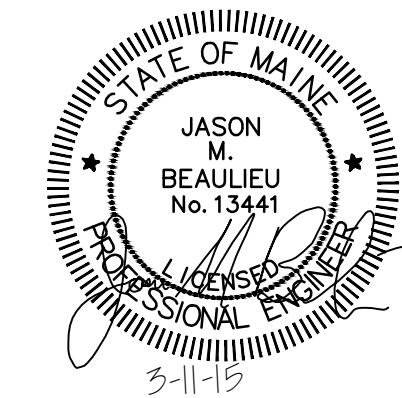

				PORTLAND HOUSING AUTHORITY PORTLAND, MAINE	
				HARBOR TERRACE FIRE ALARM UPGRADE	
				THIRD FLOOR FIRE ALARM DEMOLITION PLAN	
A	ISSUED FOR CONSTRUCTION	BVD	MRL	3/11/15	
REV	DESCRIPTION	DWN	APP	DATE	
PLEASE NOTE: THIS DOCUMENT MAY NOT ACCURATELY REPRESENT THE FINAL DOCUMENT. ONLY AN ENGINEER, ARCHITECT OR SURVEYOR SIGNED, SEALED AND DATED PAPER COPY, PROVIDED BY THIS OFFICE, MAY BE UTILIZED FOR BIDDING OR CONSTRUCTION PURPOSES.		Colby Company engineering		47A York Street Portland, Maine 04101 207.533.7753 colbycoengineering.com	
SIZE:	ANSI D	PROJECT NO.	218.006.002		
DATE:	03-11-2015	DRAWING NO.	FA-103		
DES BY:	JMB	SHEET	4 OF 17		
DWN BY:	BVD				
CKD BY:	MRL				