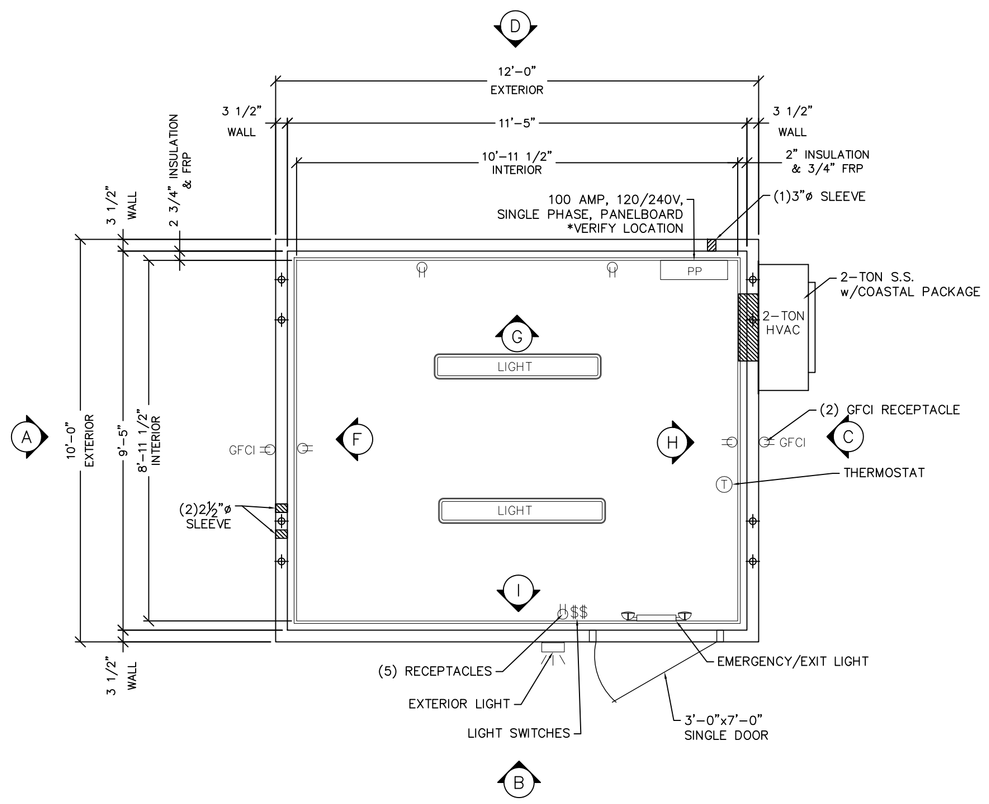

E PLAN VIEW

3/4" = 1'-0"

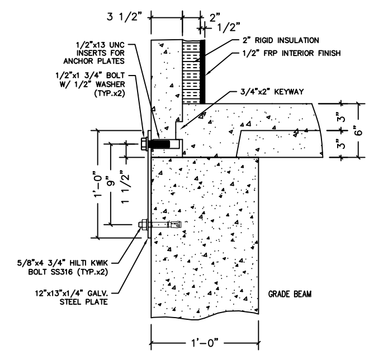

TYPICAL BUILDING PINNING DETAIL
(N.T.S.)

GENERAL NOTES:

1. CONCRETE COMPRESSIVE STRENGTH: 5,000 PSI @ 28 DAYS.

2. STRUCTURAL SHALL BE WET CAST USING A SELF COMPACTING CONCRETE MIX.

3. REINFORCING STEEL DEFORMED BARS CONFORM TO LATEST ASTM SPECIFICATION A706, GRADE 60, 1½" MINIMUM COVER, U.N.O.

4. THE SUPPORTING BASE FOR THE BUILDING AND ALL CONCRETE PADS OUTSIDE OF THE BUILDING ARE THE RESPONSIBILITY OF THE SITE CONTRACTOR.

5. CONCRETE STRUCTURE TO HAVE 3" SOLID WALLS WITHOUT FLUTES (SMOOTH FINISH), 6" THICK FLOOR AND 6" THICK ROOF.

FINISH SCHEDULE		
AREA	COATING TYPE	COLOR
BUILDING EXTERIOR ROOF	(2) COATS OF ROOF MASTIC	WHITE
BUILDING EXTERIOR WALLS	(1) COAT OF THOROSEAL AND SMOOTH FINISH	PER OWNER'S SPECIFICATIONS
BUILDING INTERIOR WALLS, CEILING	NUDO F.R.P. ON ¾" PLYWOOD & (1) LAYER OF 2" INSULATION WITH COVE BASE	WHITE
BUILDING INTERIOR FLOOR	NON-SKID EPOXY	GRAY
BUILDING DOORS & FRAMES	(2) COATS OF SHERWIN WILIAMS SHER-CRYL HPA	PER OWNER'S SPECIFICATIONS
BUILDING LOUVERS	MILL FINISH	MILL FINISH
CONSTRUCTION SEALANT	TREMCO DYMONIC CAULKING	LIMESTONE

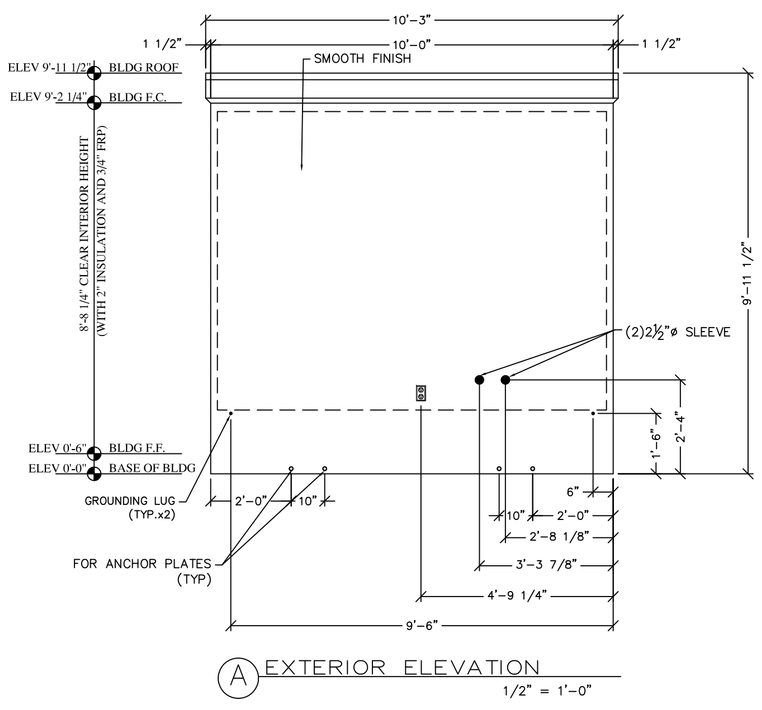

A EXTERIOR ELEVATION

1/2" = 1'-0"

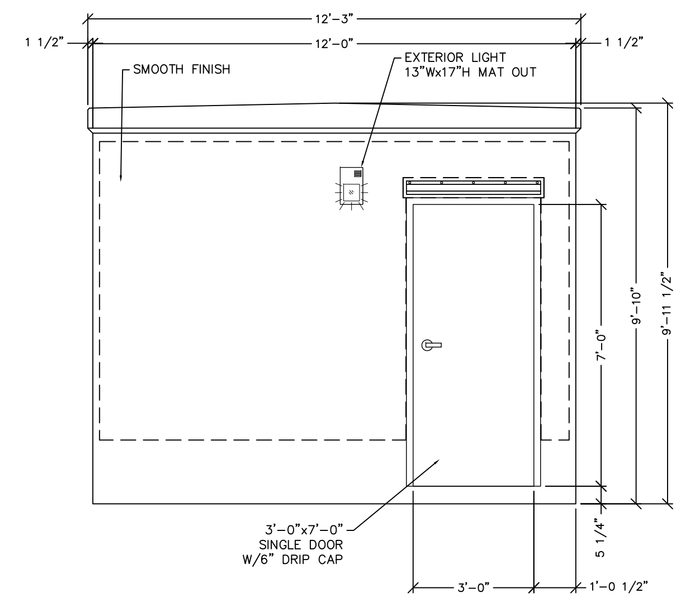

B EXTERIOR ELEVATION

1/2" = 1'-0"

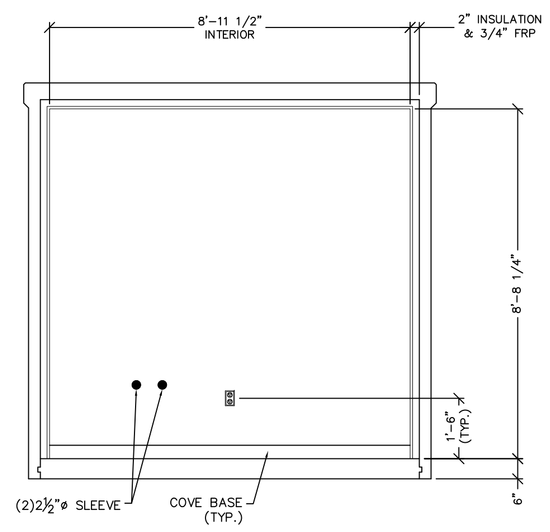

F INTERIOR ELEVATION

1/2" = 1'-0"

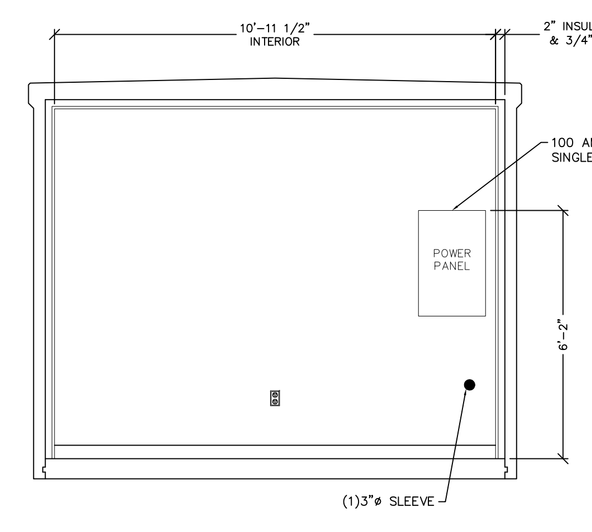

G INTERIOR ELEVATION

1/2" = 1'-0"

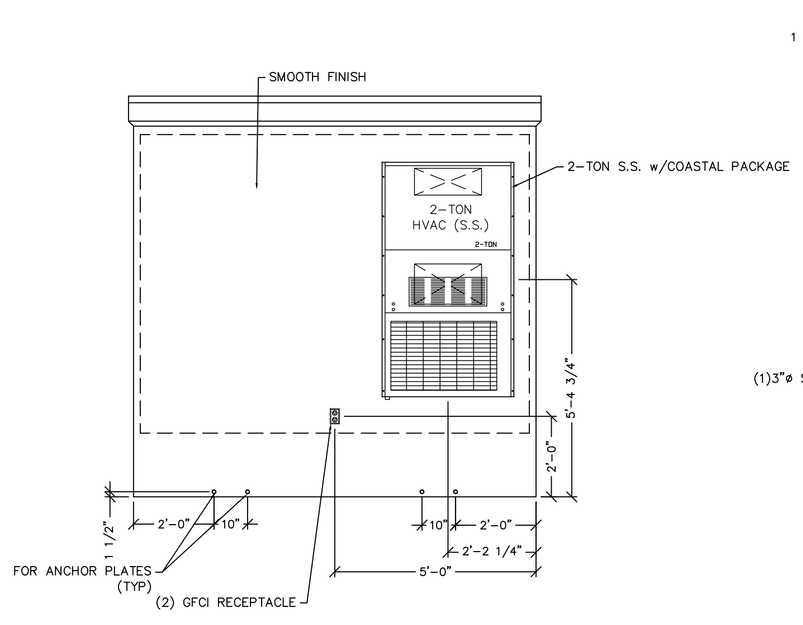

C EXTERIOR ELEVATION

1/2" = 1'-0"

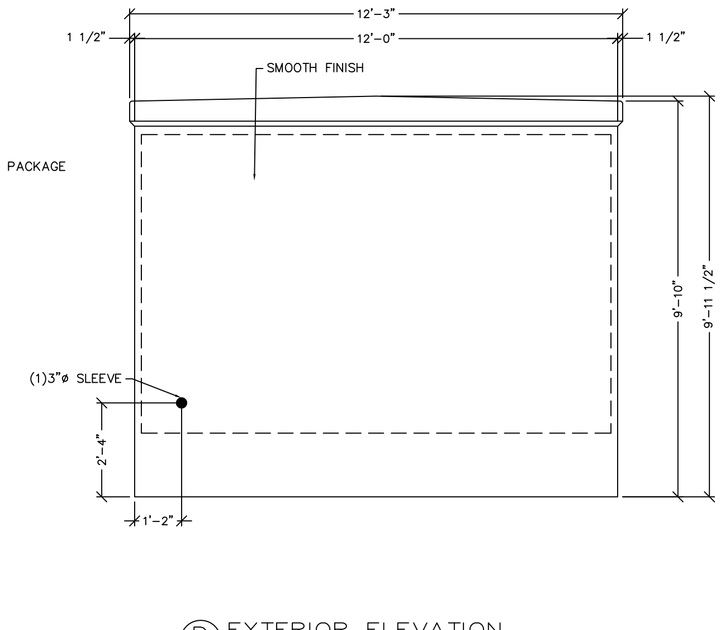

D EXTERIOR ELEVATION

1/2" = 1'-0"

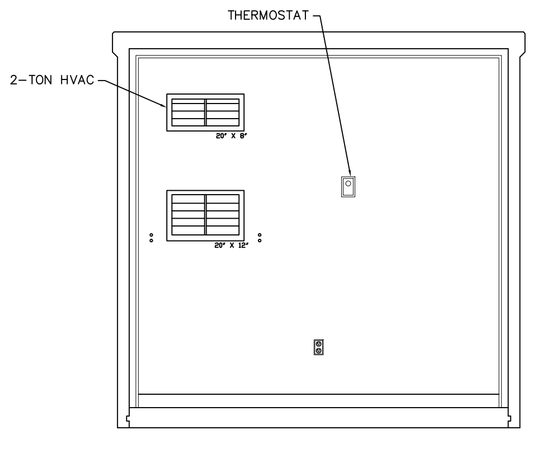

H INTERIOR ELEVATION

1/2" = 1'-0"

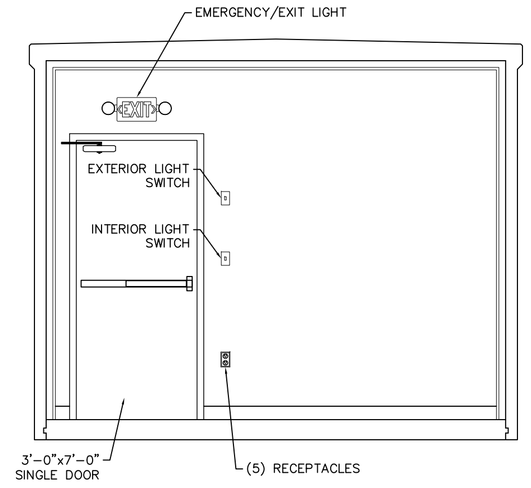

I INTERIOR ELEVATION

1/2" = 1'-0"

ISSUE LOG		
NUMBER	DATE	DESCRIPTION
4		
3		
2		
1	4/29/16	REVISED EXTERIOR FINISH

UNITED CONCRETE PRODUCTS

UNITED CONCRETE PRODUCTS INC.
173 Church Street Yalesville, CT 06492
(800) 234-3119 Fax: (203) 265-4941

CUSTOMER:	UNITIL
JOB NAME:	UNITIL DAC BUILDING, W. COMMERCIAL ST.
JOB LOCATION:	PORTLAND, ME
DWG TITLE:	DAC BUILDING

DRAFTER:	DATE:	CK BY:	DATE:
JPR	4/5/16		

JOB NO:	SCALE:	DRAWING NO:
9277	3/8" = 1'-0"	S-1