
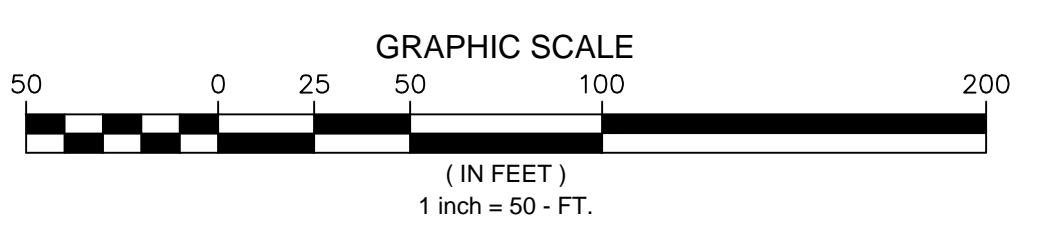


Luminaire Schedule										
Symbol	Label	Qty	Description	Arrangement	Lum. Lumens	LLF	Filename	[TEST]	Lum. Watts	Total Watts
	L2-BC	1	CL1-90L-5K-2-105-BC	SINGLE	19059	0.850	CL1-90L-5K-2-105-BC	5385	344	344
	L3	1	CL1-90L-X-5K-3	SINGLE	14708	0.850	CL1-90L-U-5K-3.IES	3751	223.9	223.9
	L3-A	6	CL1-x-60L-x-5K-3	SINGLE	9805	0.850	CL1-60L-U-5K-3.IES	3821	146	876
	L4	1	CL1-90L-U-5K-4	SINGLE	14172	0.850	CL1-90L-U-5K-4.IES	3562	217.5	217.5
	L42-90	1	CL1-90L-U-5K-4	2 @ 90 DEGREES	14172	0.850	CL1-90L-U-5K-4.IES	3562	217.5	435
	WP3	4	LMC-30-LU-5K-4-XX	SINGLE	4509	0.850	LMC-30-LU-5K-4-XX.IE	3793	70.8	283.2
	WM3	2	LMC-18LU-5K-X	SINGLE	2039	0.850	LMC-18LU-5K-X.IES	3199	42.3	84.6

Calculation Summary							
Label	Avg	Max	Min	Avg/Min	Max/Min	PtSpctLr	PtSpctB
CalcPts - All Pts Out To Zero Foot-Candles	0.25	4.4	0.0	N.A.	N.A.	10	10

All fixture types - full cutoff with LED lamping.

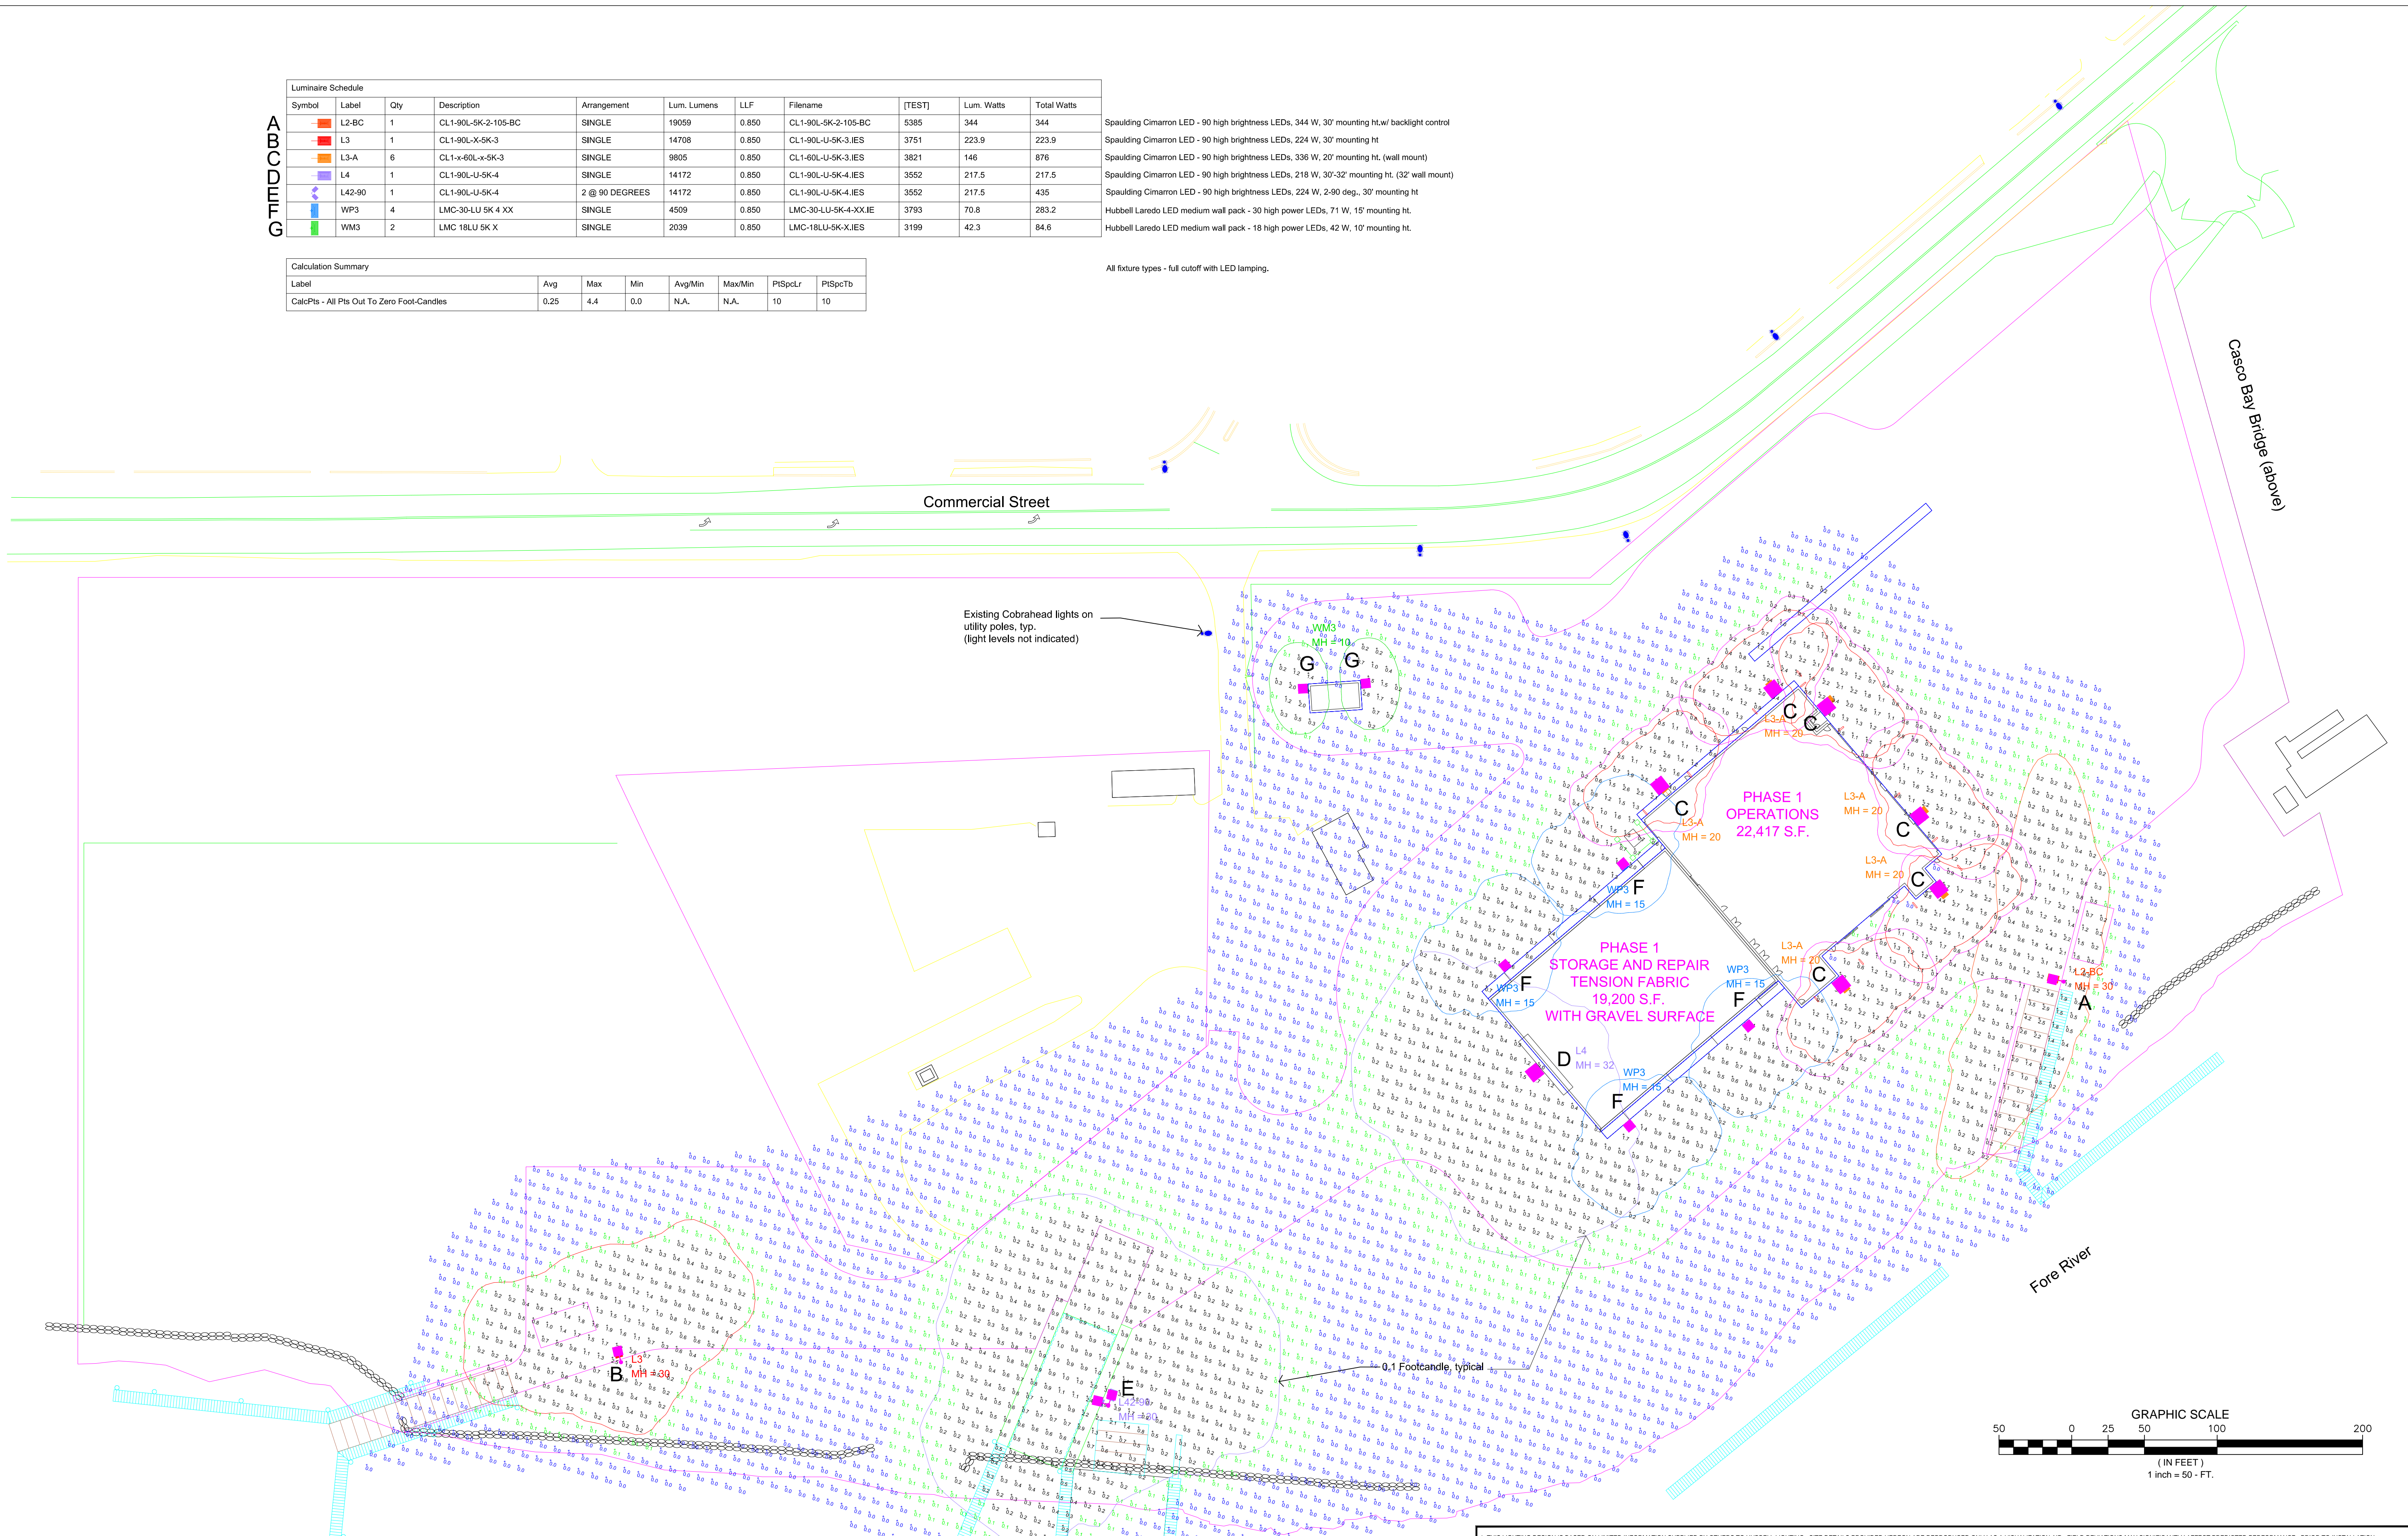

1. THIS LIGHTING DESIGN IS BASED ON LIMITED INFORMATION SUPPLIED BY OTHERS TO HUBBELL LIGHTING. SITE DETAILS PROVIDED HEREON ARE REPRODUCED ONLY AS A VISUALIZATION AID. FIELD DEVIATIONS MAY SIGNIFICANTLY AFFECT PREDICTED PERFORMANCE. PRIOR TO INSTALLATION, CRITICAL SITE INFORMATION (POLE LOCATIONS, ORIENTATION, MOUNTING HEIGHT, ETC.) SHOULD BE COORDINATED WITH THE CONTRACTOR AND/OR SPECIFIER RESPONSIBLE FOR THE PROJECT.
 2. LUMINAIRE DATA IS TESTED TO INDUSTRY STANDARDS UNDER LABORATORY CONDITIONS. OPERATING VOLTAGE AND NORMAL MANUFACTURING TOLERANCES OF LAMP, BALLAST, AND LUMINAIRE MAY AFFECT FIELD RESULTS.
 3. CONFORMANCE TO FACILITY CODE AND OTHER LOCAL REQUIREMENTS IS THE RESPONSIBILITY OF THE OWNER AND/OR THE OWNER'S REPRESENTATIVE.

TITLE:		REVISED FROM DRAWING NUMBER(S):		 Hubbell Lighting, Inc. 701 MILLENNIUM BLVD. GREENWICH, SC 29607	ON BY:	DATE:	CHK BY:
PHOTOMETRIC PLAN		1260018	1261427B		YVY	7-2-12	N/A
CANAL LANDING		1260117	1261496		YVY	12-7-12	AS NOTED
		1260171	1261677A				
		1260185					
				QUOTE:	DRAWING DESIGNER:	1262184	