MATL

1 3/4 WD

1 3/8 WD

1 3/4 MTL

1 3/4 | MTL

6'-8" 1 3/8 WD

6'-8" | 1 3/8 | WD

1 3/4 MTL

1 3/8 WD

1 3/8 WD

1 3/8 WD

HGT THK

7'-0"

7'-0"

7'-0"

6'-8"

6'-8"

7'-0"

6'-8"

GLAZING

FRAME

MATL TYPE

WD

WD

WD

MTL

MTL

WD

WD

WD

WD

WD

NOTES

EXISTING DOOR TO REMAIN

45 MIN FIRE RATED

FIELD VERIFY EXISTING OPENING

LIFT & SLIDE DOOR, ACTIVE PANEL AS SHOWN, PERFORMANCE SILL

WOOD DOOR, PAINTED, STYLE AS SHOWN, CASING BY MARVIN

WOOD DOOR, PAINTED, STYLE AS SHOWN, CASING BY MARVIN

DOOR SCHEDULE

SWING

OHD

EXISTING

SWING

SWING

CULSS12080

SWING

SWING

SWING

POCKET

BI-FOLD

SWING

SWING

SWING

MANUFACTURER

MARVIN

MARVIN

MARVIN

MARVIN

3'-0"

9'-0"

2'-6"

3-0"

12'-0"


3-0"

2'-6"

3'-0"

2'-8"

3'-0"

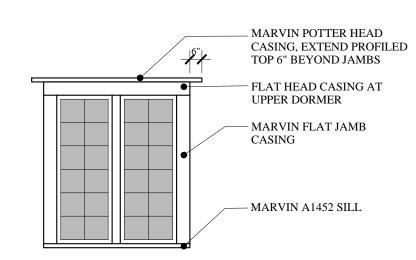

1. ALL WINDOWS &	DOORS SHALL	BE MARVIN WINDOWS.	

2. COLOR:

WINDOW NOTES:

INTERIOR: PRE FINISHED WHITE **EXTERIOR: CADET GRAY**

3. GRILLS: PATTERN AS SHOWN ON THE ELEVATIONS

7/8" SIMULATED DIVIDED LIGHT 4. EXTENSION JAMBS:

6 <u>9</u>" JAMBS

6. CASINGS:

5. GLAZING HIGH PERFORMANCE LOW-E GLASS W/ ARGON

INTERIOR: FIELD APPLIED (BY G.C.)

HEAD: POTTER CASING, EXTEND PROFILED EDGE 6" BEYOND JAMB JAMB: FLAT CASING SILL: A1452

7. SCREENS: (SHIP/ PACKAGE SEPARATE FROM WINDOWS)

STANDARD MESH INSECT SCREENS

8. HARDWARE: STAINLESS STEEL COASTAL HARDWARE OR EQUAL

SATIN NICKEL - VERIFY W/ OWNER STYLE T.B.D. BY OWNER

9. G.C. TO VERIFY WINDOW R.O. W/ WINDOW SUBMITTAL PRIOR TO CONSTRUCTION.

10. G.C. SHALL SUBMIT WINDOW SPECIFICATIONS TO OWNER FOR APPROVAL PRIOR TO ORDER. 11. ALL FACTORY MULLS SHALL BE 'LVL' REINFORCED.

12. ALL WINDOWS IN SLEEPING ROOMS SHALL BE EGRESS WINDOWS MEETING THE FOLLOWING

MINIMUM CLEAR OPENING REQUIREMENTS: 22" WIDE - 24" HIGH - 5.7 S.F. 13. ALL WINDOWS WITHIN 60" HORIZ. & VERT. DIMENSION OF STAIRS MUST BE TEMPERED.


ALL WINDOWS WITHIN 24" OF A DOOR SWING MUST BE TEMPERED.

ALL WINDOWS WITHIN A SHOWER ENCLOSURE MUST BE TEMPERED.

1x_ SHIPLAP WOOD BOARD SIDING W/ FLUSH EDGE REVEAL, SEE ELEVATIONS FOR BOARD HEIGHT - 1/2" GYPSUM PANEL 6 MIL VAPOR BARRIER. TAPE ALL - 2x6 STUD WALL 4" SPRAY FOAM INSULATION, - DRAINABLE HOUSE WRAP - 'ZIP' WALL SHEATHING SYSTEM @ NEW WALLS WOOD EXTERIOR WALL DETAIL

ADD 2X4 P.T. NAILERS OVER OVER DRAINABLE

HOUSE WRAP OVER EXISTING MASONRY WALL

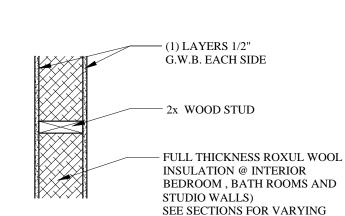

CONDITIONS


2x WOOD STUD WALL NON-RATED

2x WOOD STUD WALL

SUBSTITUTE: (1) LAYER 5/8" F.C. G.W.B. EACH SIDE

WALL LEGEND EXISTING WALL NEW WALL EXISTING WALL TO BE ========

REMOVED

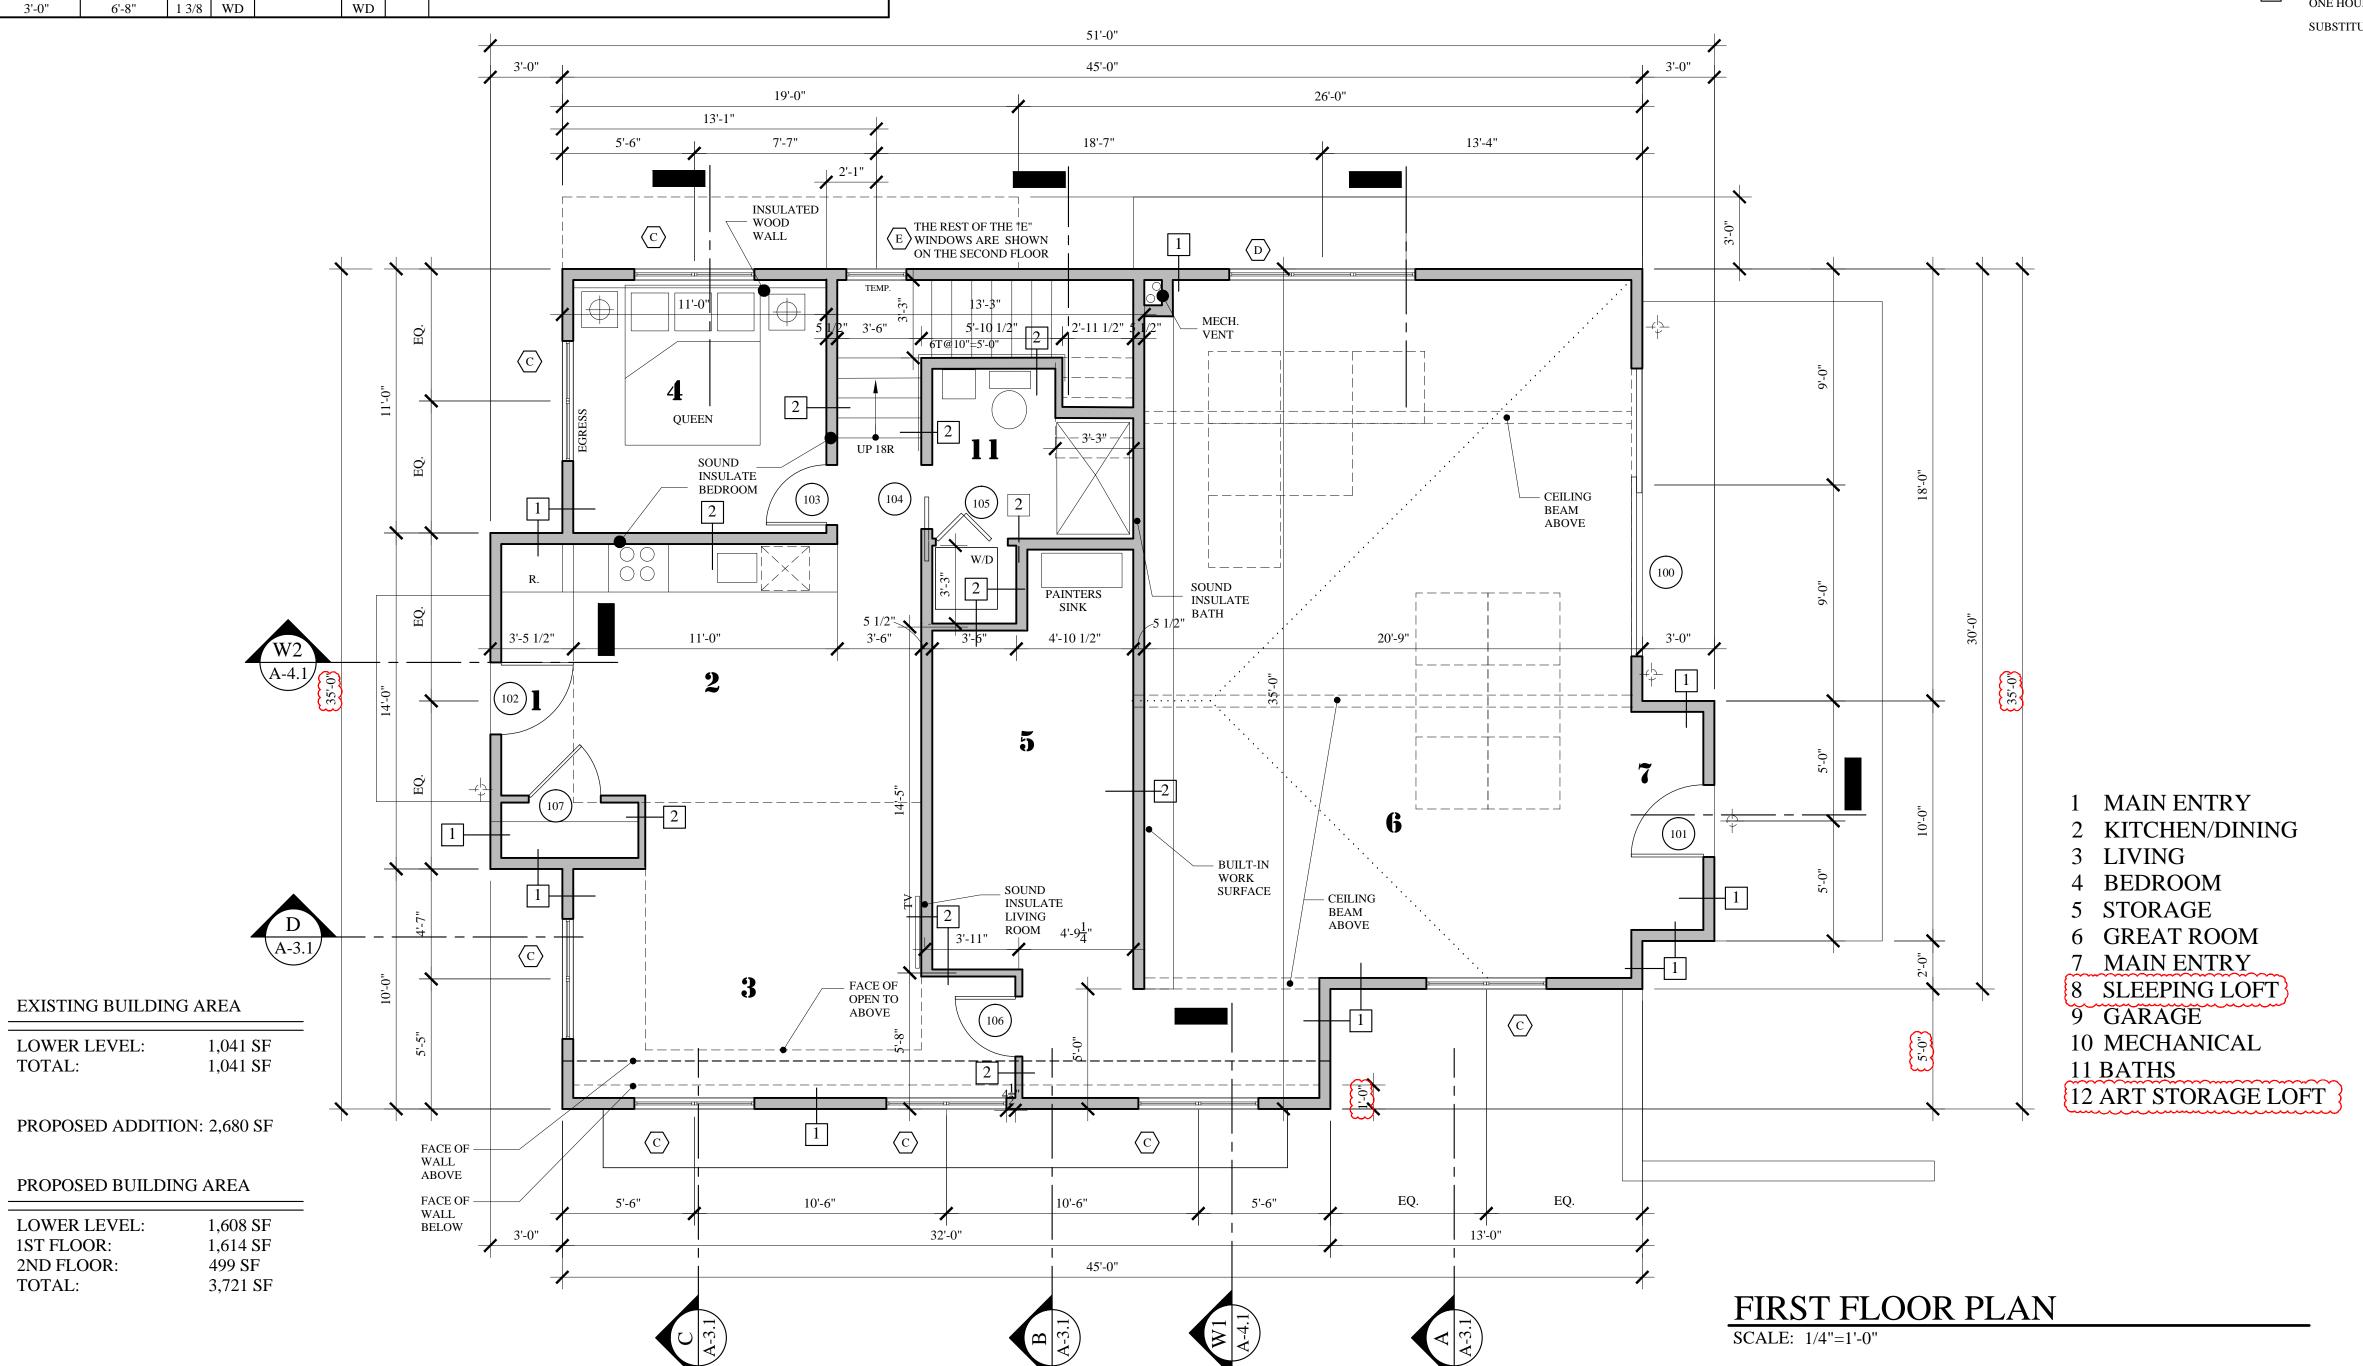

REVISED: JUNE 11, 2015 A-1.2 BUILDING PERMIT: FEBRUARY 20, 2015

MARK MUELLER **ARCHITECTS**

100 Commercial Street Suite 205 Portland, Maine 04101 Phone: 207.774.9057 rfi@muellerarchitects.com

COPYRIGHT 2014 MARK MUELLER ARCHITECTS