ERVCCSVB, ERVCCSHB Energy Recovery Ventilators HRVCCSVB, HRVCCSHB Heat Recovery Ventilators



Product Data

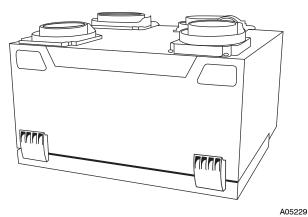


Fig. 1 - ERVCCSVB / HRVCCSVB

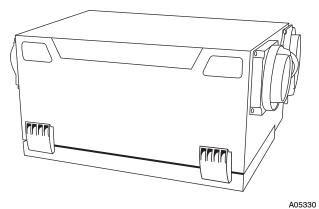


Fig. 2 - ERVCCSHB / HRVCCSHB

Energy Recovery Ventilation (ERV) and Heat Recovery Ventilation (HRV) systems offered by Carrier are the finest on the market today. These units provide efficient and cost effective heat and energy recovery during the heating and cooling season when needed most.

As temperatures drop below 23° F (-5°C), indoor air is recirculated periodically through the heat exchanger core to prevent frost from forming. Competitors' methods of supplementary electric defrost waste energy. Unlike rotary wheel heat exchangers which mix air streams, these cross-flow or counterflow heat exchangers ensure that there is no mixing of the stale air stream with the fresh outdoor air stream.


A filter installed on the incoming outdoor air stream removes large airborne particles from the intake air stream before they enter the heat exchanger and reduces the maintenance required. The units' acoustically engineered design makes the Carrier ERVs and HRVs are the quietest on the market and ensures that comfort is felt, not heard.

Unlatching two (2) suitcase style latches allows easy removal of the filters and core for cleaning.

NOTE: The HRV should not be installed in an attic or unconditioned space unless provisions are made for drain-line freezing and condensation.

STANDARD FEATURES

- Drainless design ERVs / Drains provided HRVs
- Integrated airflow balancing points
- · High pressure blowers
- · Onboard control for continuous high/low ventilator operation
- · Energy saving defrost cycle
- Cross-flow, counterflow heat exchangers
- One filter on incoming air; one filter on outgoing air to protect core
- No-tools maintenance
- Enthalpic heat exchanger core ERVs
- Polypropylene heat exchanger core HRVs

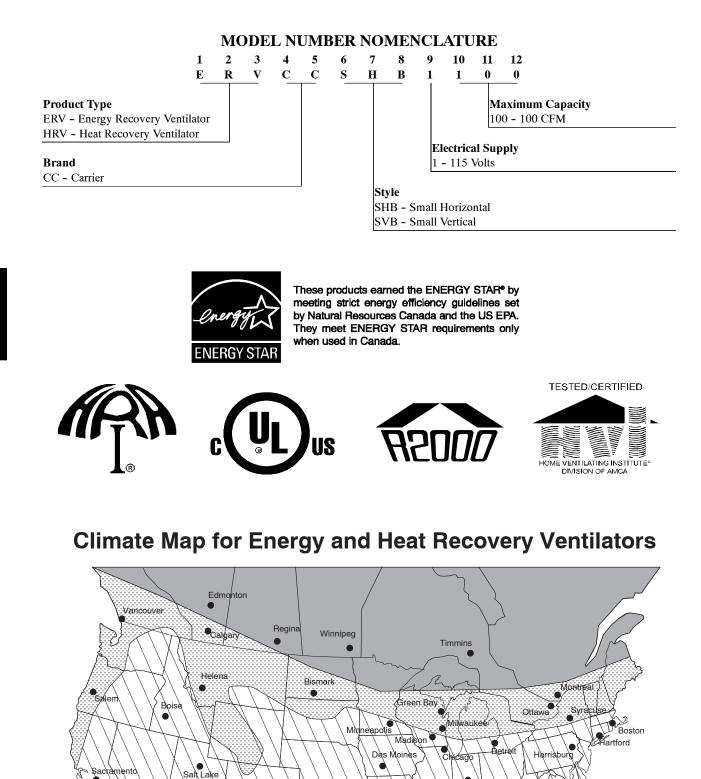

Cit∖

ERV Recommended w/HRV or ERV Wall Control

Honolulu St

D

HRV Recommended

ERV Recommended

•

Denve

2

è

opel

Oklahoma Cit

lustin

Springitield

.

Nashvi

ndianabolis

Vashington D.C.

Ralen

O

Columbia

Orlando

Atlanta

VENTILATOR ACCESSORY NUMBER NOMENCLATURE

| | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | |
|---------------------------|-----|---|---|---|---|---|---|---|---|----|----|------------------------|---------------|
| | K | V | B | C | N | 0 | 1 | 0 | 1 | C | В | S | |
| Product | | | | | | | | | | | С | ntrol Description | |
| KV - Ventilator Accessory | Kit | | | | | | | | | | Cl | BS - Carrier Basic Con | trol |
| | | | | | | | | | | | Cl | C - Carrier Latent Con | ntrol |
| Series | | | | | | | | | | | Cl | T - Carrier OneTouch | Control |
| A - Original Series | | | | | | | | | | | C | T - Carrier Standard C | Control |
| B - Second Series | | | | | | | | | | | A | cessory Description | |
| | | | | | | | | | | | H | CO - Concentric Intake | /Exhaust Hood |
| Туре | | | | | | | | | | | H | DD - Intake Hood | |
| AC01 - Accessory | | | | | | | | | | | K | T - Airflow Measuring | g Kit |
| CN01 - Control | | | | | | | | | | | Ti | ner Description | |
| TM01 - Timer | | | | | | | | | | | 20 | C - 20 Minute Timer k | Kit |
| | | | | | | - | | | | | 60 | M - 60 Minute Timer | Kit |
| Package Quantity | | | | | | | | | | | | | |
| 01 - Single Pack | | | | | | | | | | | | | |

| KIT NUMBER | DESCRIPTION | WHERE USED |
|--------------|------------------------------------|--|
| KVAAC0101HOD | Exterior Intake and Exhaust Hood | 2 Required |
| KVAAC0101HCO | Concentric Intake and Exhaust Hood | Used as a single intake/exhaust for SVB1100, SHB1100 models only |
| KVBCN0101CBS | Basic HRV Control | Used with all HRVs |
| KVBCN0101CLC | Latent Control | Used with ERVs only |
| KVBCN0101CLT | Carrier OneTouch Control | Used with all ERVs and HRVs as a main wall control |
| KVBCN0101CST | Standard HRV Control | Used with all HRVs |
| KVATM010120C | 20 Minute Push Button Timer | Used with all HRVs when 20 minute manual operation is required |
| KVATM010160M | 60 Minute Timer | Used with all HRVs, time is adjustable between 10 and 60 minutes |
| KVBAC0101KIT | Airflow Measuring Kit | Used with all ERVs and HRVs to balance intake/exhaust airflow |

| CONTROL DESCRIPTION | FAN SPEED CONTROL | HUMIDISTAT CONTROL | DEHUMIDISTAT CONTROL | CONTINUOUS MODE | INTERMITTENT MODE |
|------------------------|----------------------|-----------------------|-------------------------|--------------------|----------------------|
| Latent | Yes | Yes | No | Yes | Yes |
| OneTouch | Yes | No | No | Yes | Yes |
| Basic | Yes | No | No | Yes | No |
| Standard | Yes | Yes | Yes | Yes | Yes |

Control features

Basic Control:

Allows the user to manually set fan speed to low or high as required to maximize comfort.

Standard Control:

Offers automatic dehumidistat control and the option to select continuous or intermittent fan operation. Setting the wall control to low will activate the continuous mode.

OneTouch Control:

Allows control of ventilator with the touch of a button. This control will operate as a main wall control. The OneTouch will operate the unit in Intermittent Mode (20 minutes per hour), continuous low speed, continuous high speed, and off.

Latent Control (ERVs only):

Low Exchange Mode—If the relative humidity inside the building is lower than selected, air exchange would occur with the outside at high speed. If the relative humidity inside the building is higher than selected, air exchange would occur with the outside at low speed. This ensures continuous air exchange for constant air quality.

Intermittent Mode—If the relative humidity inside the building is higher than selected, no air exchange would occur and the system would turn off. If the relative humidity inside the building is lower than selected, air exchange would occur with the outside at high speed. This mode is ideal for maintaining the proper humidity level when the continuous mode cannot.

Automatic Defrost Cycle Features

All models offer a non-electric defrost cycle feature which prevents frost and ice buildup within the heat recovery core. When the outside air temperature falls below 23° F (-5°C) it is electronically sensed and the dampers close the outside air ports. This allows warm indoor air to recirculate within the heat recovery core. The frequency of this cycle increases as the outside air temperature decreases.

| MODEL | 23°F TC (–5°C TC |) −17°F) −27°C) | BELOW –17°F (–27°C) | | |
|----------------------|---------------------|---------------------|------------------------|-----------------------|--|
| | DEFROST* | EXCHANGE† | DEFROST* | EXCHANGE [†] | |
| ERVCCSHB HRVCCSHB | 8 Minutes | 25 Minutes | 10 Minutes | 22 Minutes | |
| ERVCCSVB HRVCCSVB | 8 Minutes | 25 Minutes | 10 Minutes | 22 Minutes | |

* All defrost times are in the standard mode (as shipped)

† Time between defrost when within specified temperature range

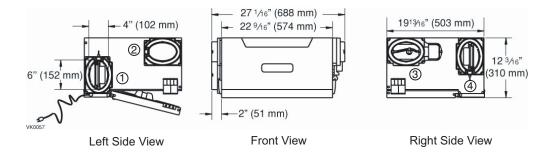


Fig. 3 - ERVCCSHB and HRVCCSHB Unit Dimensions



Key to Unit Port Locations

- 1 Fresh air to building
- ② Stale air from building
- ③ Fresh air from outside
- (4) Stale air to outside

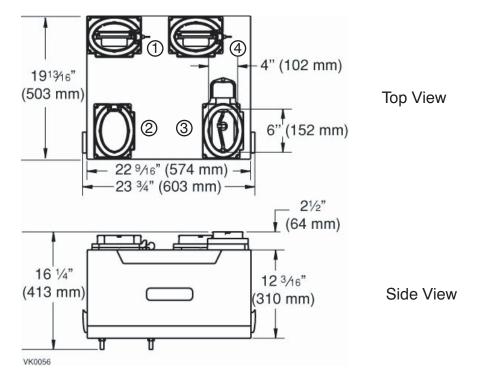


Fig. 4 - ERVCCSVB and HRVCCSVB Unit Dimensions

PHYSICAL DATA

| MODEL | ERVCCSVB1100 | ERVCCSHB1100 | HRVCCSVB1100 | HRVCCSHB1100 |
|---|--|--|--|--|
| Port Locations | Тор | Side | Тор | Side |
| Core Type | Enthalpic transfer media with plastic stack | Enthalpic transfer media with plastic stack | Polypropylene Cross Flow | Polypropylene Cross Flow |
| Core Exchange Area | 56 sq. ft. (5.2m ²⁾ | 56 sq. ft. (5.2m ²⁾ | 55 sq. ft. (5.1m ²⁾ | 55 sq. ft. (5.1m ²⁾ |
| Weight Ib (kg) | 42 (19) | 42 (19) | 42 (19) | 42 (19) |
| Shipping Weight Ib (kg) | 48 (22) | 48 (22) | 48 (22) | 48 (22) |
| Shipping Dimensions in. (mm) Height Width Depth | 25.5 (648) 17.5 (445) 23.0 (584) | 30.0 (762) 15.0 (381) 23.0 (584) | 25.5 (648) 17.5 (445) 23.0 (584) | 30.0 (762) 15.0 (381) 23.0 (584) |
| Voltage | 120 | 120 | 120 | 120 |
| Max Power (Watts) | 104 | 104 | 100 | 100 |
| Max Amps | 0.87 | 0.87 | 0.85 | 0.85 |

NOTE: Drain Connector Kits are supplied with HRVs only. They are not necessary with ERVs.

Ventilator Sizing

Tables 1 and 2 should be used to determine the required airflow for a home. These guidelines are taken from ASHRAE 62.2-2007.

| FLOOR | BEDROOMS | | | | | | | | |
|-------------------------|----------|-----|-----|-----|-----|--|--|--|--|
| AREA (ft ²) | 0-1 | 2-3 | 4-5 | 6-7 | >7 | | | | |
| <1500 | 30 | 45 | 60 | 75 | 90 | | | | |
| 1501-3000 | 45 | 60 | 75 | 90 | 105 | | | | |
| 3001-4500 | 60 | 75 | 90 | 105 | 120 | | | | |
| 4501-6000 | 75 | 90 | 105 | 120 | 135 | | | | |
| 6001-7500 | 90 | 105 | 120 | 135 | 150 | | | | |
| >7500 | 105 | 120 | 135 | 150 | 165 | | | | |

Table 1 – Ventilation Air Requirements, cfm

Table 2 – Ventilation Air Requirements, L/s

| FLOOR | BEDROOMS | | | | | | | | |
|------------------------|----------|-----|-----|-----|----|--|--|--|--|
| AREA (m ²) | 0-1 | 2-3 | 4-5 | 6-7 | >7 | | | | |
| <139 | 14 | 21 | 28 | 35 | 42 | | | | |
| 139.1-279 | 21 | 28 | 35 | 42 | 50 | | | | |
| 279.1-418 | 28 | 35 | 42 | 50 | 57 | | | | |
| 418.1-557 | 35 | 42 | 50 | 57 | 64 | | | | |
| 557.1-697 | 42 | 50 | 57 | 64 | 71 | | | | |
| >697 | 50 | 57 | 64 | 71 | 78 | | | | |

PERFORMANCE DATA

HVI Rated Energy Performance


| MODEL MODE | MODE | SUPPL | Y ТЕМР | NET AII | r flow | POWER CONSUMED (WATTS) | SENSIBLE RECOVERY | APPARENT SENSIBLE | LATENT RECOVERY MOISTURE | TOTAL RECOVERY |
|------------|----------|-------|--------|---------|--------|------------------------------|----------------------|----------------------|--------------------------------|-------------------|
| | | °C | °F | L/S | CFM | | EFFICIENCY | EFFECTIVENESS | TRANSFER | EFFICIENCY |
| | | 0 | 32 | 21 | 45 | 42 | 68 | 79 | 0.63 | |
| ERVCCSH | Heating | 0 | 32 | 27 | 58 | 46 | 68 | 76 | 0.58 | |
| B1100 | rieating | 0 | 32 | 41 | 87 | 70 | 63 | 71 | 0.48 | |
| | | -25 | -13 | 22 | 47 | 58 | 55 | 78 | 0.60 | |
| | Cooling | 35 | 95 | 21 | 44 | 42 | | | | 52 |
| | | 0 | 32 | 21 | 45 | 42 | 68 | 79 | 0.63 | |
| ERVCCSVB | Heating | 0 | 32 | 27 | 58 | 46 | 68 | 76 | 0.58 | |
| 1100 | ricating | 0 | 32 | 41 | 87 | 70 | 63 | 71 | 0.48 | |
| | | -25 | -13 | 22 | 47 | 58 | 55 | 78 | 0.60 | |
| | Cooling | 35 | 95 | 21 | 44 | 42 | | | | 52 |
| | | 0 | 32 | 18 | 39 | 37 | 66 | 78 | 0.03 | |
| HRVCCSH | Heating | 0 | 32 | 24 | 50 | 44 | 65 | 74 | 0.01 | |
| B1100 | riodang | 0 | 32 | 40 | 85 | 68 | 59 | 68 | 0.01 | |
| | | -25 | -13 | 23 | 48 | 56 | 57 | 84 | 0.03 | |
| | Cooling | 35 | 95 | | | | - | - | _ | - |
| | | 0 | 32 | 18 | 39 | 37 | 66 | 78 | 0.03 | |
| HRVCCSV | Heating | 0 | 32 | 24 | 50 | 44 | 65 | 74 | 0.01 | |
| B1100 | ricating | 0 | 32 | 40 | 85 | 68 | 59 | 68 | 0.01 | |
| | | -25 | -13 | 23 | 48 | 56 | 57 | 84 | 0.03 | |
| | Cooling | 35 | 95 | | | | | | | |

Ventilation Performance

| | EXT. S | STATIC | | LY AIR FLOW | GROSS AIR FLOW | | | | | |
|---|--------|--------|----------|-------------|----------------|------|---------|-----|--|--|
| MODEL | PRES | SURE | NET SUPP | | SU | PPLY | EXHAUST | | | |
| - | PA | IN WC | L/S | CFM | L/S | CFM | L/S | CFM | | |
| | 25 | 0.1 | 55 | 116 | 56 | 119 | 55 | 116 | | |
| Ī | 50 | 0.2 | 53 | 113 | 54 | 115 | 53 | 112 | | |
| ERVCCSHB1100 | 100 | 0.4 | 50 | 105 | 51 | 108 | 50 | 105 | | |
| Ī | 200 | 0.8 | 42 | 89 | 43 | 92 | 41 | 87 | | |
| Ī | 250 | 1.0 | 38 | 80 | 39 | 83 | 37 | 78 | | |
| | 25 | 0.1 | 55 | 116 | 56 | 119 | 55 | 116 | | |
| Ī | 50 | 0.2 | 53 | 113 | 54 | 115 | 53 | 112 | | |
| ERVCCSVB1100 | 100 | 0.4 | 50 | 105 | 51 | 108 | 50 | 105 | | |
| | 200 | 0.8 | 42 | 89 | 43 | 92 | 41 | 87 | | |
| Ī | 250 | 1.0 | 38 | 80 | 39 | 83 | 37 | 78 | | |
| | 25 | 0.1 | 52 | 110 | 53 | 112 | 57 | 121 | | |
| Ī | 50 | 0.2 | 50 | 106 | 51 | 108 | 54 | 115 | | |
| HRVCCSHB1100 | 100 | 0.4 | 46 | 97 | 47 | 100 | 50 | 106 | | |
| | 200 | 0.8 | 37 | 79 | 38 | 81 | 42 | 90 | | |
| Ī | 250 | 1.0 | 33 | 70 | 34 | 72 | 37 | 79 | | |
| | 25 | 0.1 | 52 | 110 | 53 | 112 | 57 | 121 | | |
| | 50 | 0.2 | 50 | 106 | 51 | 108 | 54 | 115 | | |
| HRVCCSVB1100 | 100 | 0.4 | 46 | 97 | 47 | 100 | 50 | 106 | | |
| Ē | 200 | 0.8 | 37 | 79 | 38 | 81 | 42 | 90 | | |
| The second se | 250 | 1.0 | 33 | 70 | 34 | 72 | 37 | 79 | | |

NOTE: For additional data points, refer to HVI Directory at www.hvi.org


VENTILATOR INSTALLED WITH FORCED AIR SYSTEM

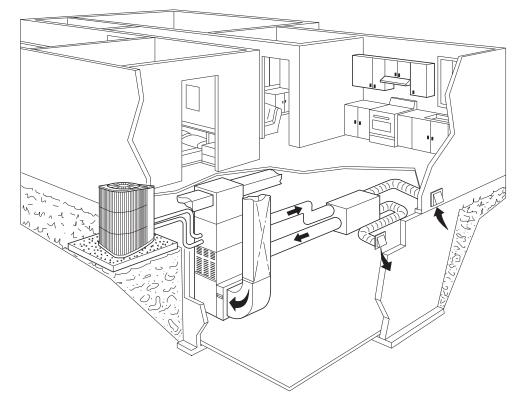

A10105

ERV / HRV

VENTILATOR INSTALLED WITH INDEPENDENT AIR DISTRIBUTION

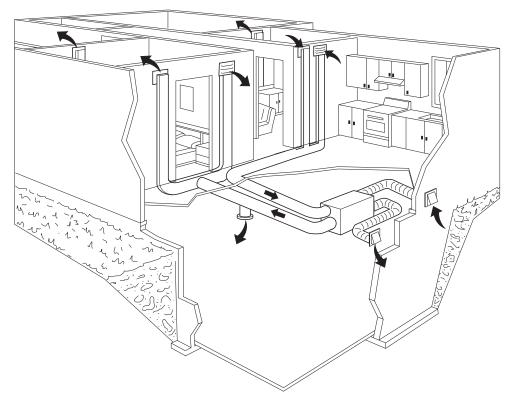

A10106

Copyright 2010 Carrier Corp. • 7310 W. Morris St. • Indianapolis, IN 46231 Printed in U.S.A. Edition Date: 05/10