EXISTING ROOFTOP CONDENSING UNIT CU-1T , RELOCATE & PROVIDE SLEEPERS

ROOFTOP DUCTWORK SUPPORTS, 10'-0" MAXIMUM SPACING, TYPICAL.

20"ØS & E THRU GABLE END, SEE A1, SHEET MH103 FOR CONTINUATION

20"ØS

20"ØE

C1 M104

1-1/2" HWS & R DN THRU ROOF CURB

30x28S DN THRU ROOF CURB

20"ØE

ERV 1

CU 4

30x28E DN THRU ROOF CURB

CU 3

CU 1

CU 2

A1 M104

TYPICAL

ERV 2 ERV 3 ERV 4

CU 5

CU 6

FUTURE

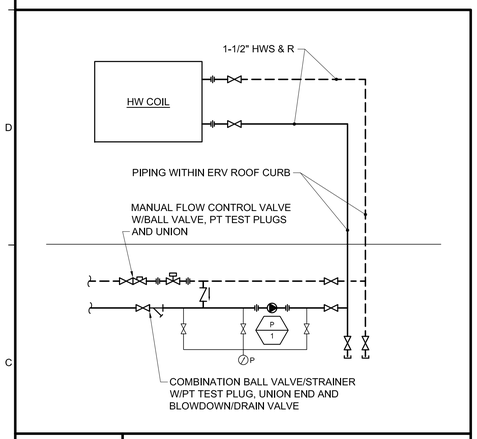

C1	DETAIL ~ HEATING COIL PIPING
NOT TO SCALE	

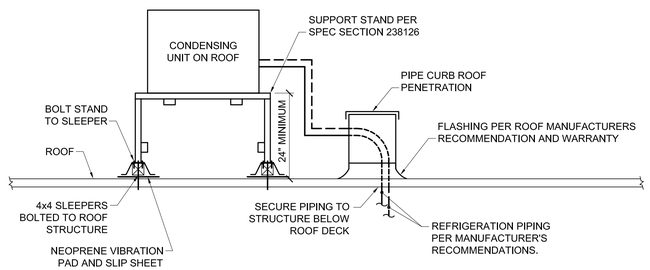

A1	DETAIL ~ TYPICAL ROOF MOUNTED CONDENSING UNIT INSTALLATION
NOT TO SCALE	

A4	MECHANICAL PLAN ~ ROOF
1/8" = 1'-0"	

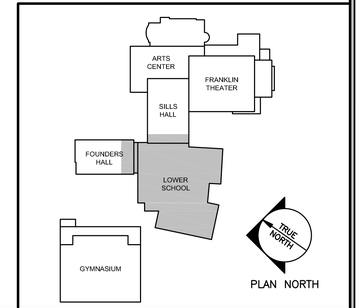

PLAN NORTH

A9	KEYED PLAN
NOT TO SCALE	

N:\Projects\2015\15051 ~ Waynflete School\00 Drawing Files\15051M.dwg Jan 11, 2017 - 10:01am

scott simons architects
designed for human potential

75 York Street,
Portland, Maine 04101
simonsarchitects.com
207.772.4656

Allied Engineering
Structural Mechanical
Electrical Commissioning

160 Veranda Street
Portland, Maine 04103
T: 207.221.2260
F: 207.221.2266
Web: www.allied-eng.com

COPYRIGHT 2015 ALLIED ENGINEERING, INC.

Allied Project No: 15051

Cad File: 15051M.dwg

PROJECT NAME:

WAYNFLETE LOWER SCHOOL

ADDITION & RENOVATIONS

WAYNEFLETE SCHOOL
360 SPRING STREET
PORTLAND, MAINE 04102

SEAL:



THIS DRAWING IS THE PROPERTY OF SCOTT SIMONS ARCHITECTS (SSA) AND IS NOT TO BE COPIED OR REPRODUCED IN PART OR WHOLE.
2015 © SCOTT SIMONS ARCHITECTS, LLC

REVISION:

1	DATE
2	DATE
3	DATE
4	DATE
5	DATE
6	DATE

DATE OF ISSUE:	12 JANUARY 2017
PROJECT NUMBER:	2013-0050
STATUS:	ISSUED FOR BID

MECHANICAL PLAN ~ ROOF

M104