

**SPRINKLER PIPING KEYED NOTES:**


- 1 GERRY LEACH FROM THE STATE FIRE MARSHAL'S OFFICE HAS GRANTED PERMISSION TO REUSE THE (E)GLYCOL SYSTEM CURRENTLY SERVING THE ATTIC. TEST GLYCOL SOLUTION FOR FREEZE PROTECTION PROPERTIES AND IF FOUND DEFICIENT, DRAIN PIPING AND REPLACE WITH A PREMIXED SOLUTION RATED TO -17° F.
- 2 RUN PIPING THROUGH PRE-CUT HOLES IN STRUCTURE. SEE STRUCTURAL DRAWINGS FOR LOCATIONS AND SIZES.

**DOMESTIC PIPING KEYED NOTES:**

- 1 1 1/4" CW UIC OR UIW
- 2 1/2" HW & CW UIW OR UIC



75 York Street,  
Portland, Maine 04101  
simonsarchitects.com  
207.772.4656

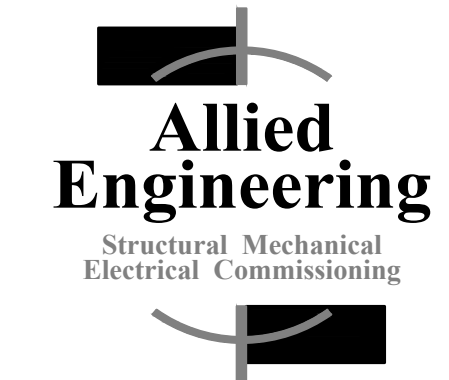

160 Veranda Street  
Portland, Maine 04103  
T: 207.221.2260  
F: 207.221.2266  
Web: www.allied-eng.com

Project No: 15051  
Cad File: 15051M.dwg

**WAYNFLETE LOWER SCHOOL**  
ADDITION & RENOVATIONS

WAYNFLETE SCHOOL  
360 SPRING STREET  
PORTLAND, MAINE 04102




THIS DRAWING IS THE PROPERTY OF SCOTT SIMONS ARCHITECTS (SSA) AND IS NOT TO BE COPIED OR REPRODUCED IN PART OR WHOLE. 2015 © SCOTT SIMONS ARCHITECTS, LLC

REVISION:

NO.	DATE
1	DATE
2	DATE
3	DATE
4	DATE
5	DATE
6	DATE

DATE OF ISSUE: 12 JANUARY 2017  
PROJECT NUMBER: 2013-0050  
STATUS: ISSUED FOR BID

**DOMESTIC PIPING PLAN ~ UPPER LEVEL**

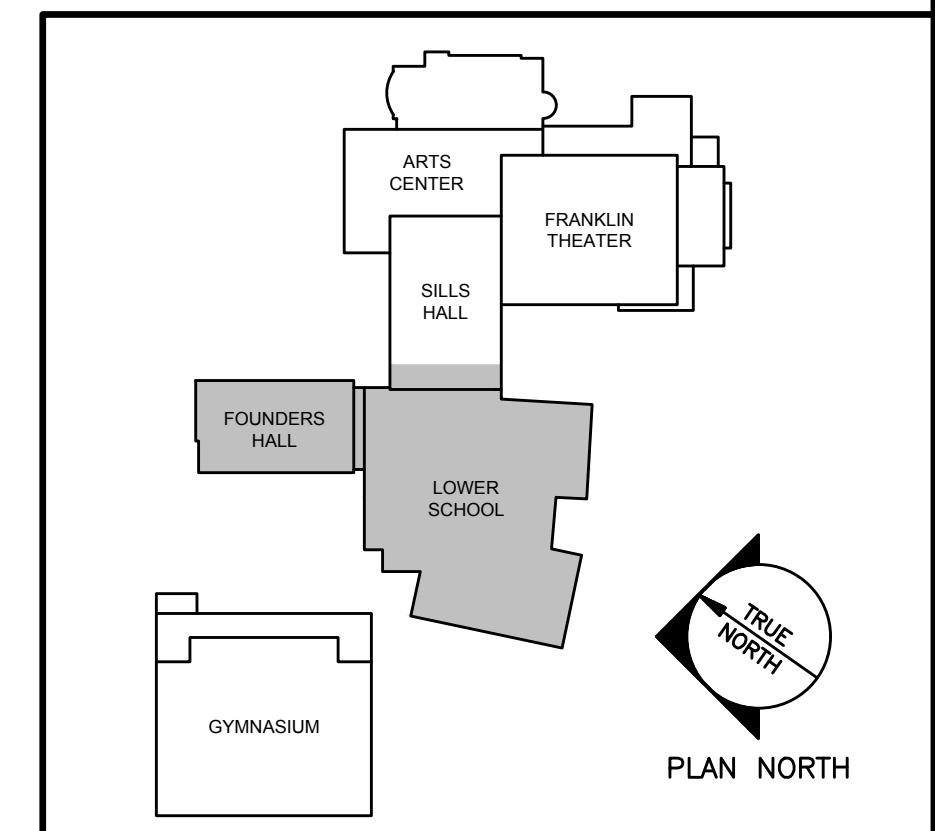

A1	DOMESTIC PIPING PLAN ~ UPPER LEVEL	A9	KEYED PLAN
1/8" = 1'-0"		NOT TO SCALE	

**PP103**

N:\Projects\2015\15051 - Waynflete School\00 Drawing Files\15051P.dwg Jan 11, 2017 - 10:36am