

- ① MOUNT PENDANT FIXTURES IN THIS ROOM/AREA AT 9'-0" AFF.
- ② PROVIDE EMERGENCY BATTERY PACK CAPABLE OF 4 HOURS OF OPERATION.
- ③ PROVIDE DIMMING FOR LIGHTING AT STAIR S2-1 AND COMMON AREA 001 ON LOWER LEVEL. LOCATE DIMMER IN FACULTY SUPPORT OFFICE 102.

**A1 LIGHTING CONTROL NOTES**

- |   |   |
|---|---|
| <ul style="list-style-type: none"> <li>① LIGHTING CONTROL SHALL BE MANUAL ON/MANUAL OFF VIA WALL SWITCHES.</li> <li>② LIGHTING CONTROL SHALL BE MANUAL ON/AUTO OFF WALL SENSOR SWITCH - DETAIL A9/EL500</li> <li>③ LIGHTING CONTROL SHALL BE AUTO ON/AUTO OFF WALL SENSOR SWITCH - DETAIL B9/EL500</li> <li>④ LIGHTING CONTROL SHALL BE AUTO ON/AUTO OFF WALL SENSOR SWITCH WIRED FOR 3-WAY OPERATION - SEE DETAIL A6/EL500</li> <li>⑤ LIGHTING CONTROL SHALL BE AUTO ON/AUTO OFF VIA CEILING OCCUPANCY SENSOR(S) - DETAIL B6/EL500</li> <li>⑥ LIGHTING CONTROL SHALL BE MANUAL ON/AUTO OFF VIA CEILING SENSOR(S) - DETAIL F1/EL500</li> <li>⑦ LIGHTING CONTROL SHALL BE WALL MOUNTED OCCUPANCY SENSOR DIMMER SWITCH, MANUAL ON, AUTOMATIC OFF (NO DETAIL)</li> <li>⑧ LIGHTING CONTROL SHALL BE 0-10V DIMMING WITH AUTO OFF VIA CEILING SENSOR(S) - DETAIL F4/EL500</li> <li>⑨ LIGHTING CONTROL SHALL BE 0-10V DIMMING OF ONE OR TWO CONTROL GROUPS AS INDICATED WITH AUTO OFF VIA CEILING SENSORS AND DAYLIGHT RESPONSIVE DIMMING VIA PHOTOCELL - DETAIL A1/EL600.</li> <li>⑩ LIGHTING CONTROL SHALL BE DUAL CIRCUIT SWITCHING WITH 2-BUTTON OCCUPANCY SENSOR - DETAIL E4/EL500</li> </ul> | <ul style="list-style-type: none"> <li>⑪ LIGHTING CONTROL SHALL BE WALL SENSOR MANUAL ON/AUTO OFF WITH AUTOMATIC DAYLIGHT CONTROL - DETAIL A4/EL500</li> <li>⑫ LIGHTING CONTROL SHALL BE A-B SWITCHING WITH AUTO OFF VIA CEILING SENSOR(S) - DETAIL A1/EL500</li> <li>⑬ LIGHTING CONTROL SHALL BE A-B SWITCHING WITH AUTO OFF AND AUTOMATIC DAYLIGHT CONTROL - DETAIL C1/EL500</li> <li>A - LIGHTING CONTROL SHALL BE MANUAL ON WITH AUTO OFF BY LCP (NO DETAIL)</li> <li>B - LIGHTING CONTROLLED FROM LIGHTING CONTROL PANEL - REFER TO LIGHTING CONTROL PANEL SCHEDULES (NO DETAIL)</li> <li>C - LIGHTING CONTROL SHALL BE A-B SWITCHING WITH AUTO OFF VIA LIGHTING CONTROL PANEL - REFER TO LIGHTING CONTROL PANEL SCHEDULES (NO DETAIL)</li> <li>D1 - FOR STAIRWAY LIGHTING, EACH FIXTURE SHALL BE ALWAYS ON AT 50% WHILE BUILDING IS OCCUPIED AND SHALL AUTOMATICALLY GO TO 100% ON BY AN INTEGRAL OCCUPANCY SENSOR</li> <li>D2 - FOR STAIRWAY LIGHTING, EACH FIXTURE SHALL HAVE 1 LAMP ALWAYS ON WHILE BUILDING IS OCCUPIED AND 1 LAMP SHALL BE AUTOMATICALLY TURNED ON BY AN INTEGRAL OCCUPANCY SENSOR</li> </ul> <p><b>NOTE:</b><br/>NOT ALL LIGHTING DIAGRAM OR LIGHTING CONTROL NOTES MAY PERTAIN TO THIS PROJECT</p> |
|---|---|


**A1 LIGHTING CONTROL NOTES**

CONNECT ALL LIGHTING IN THIS AREA TO CIRCUIT L21-34


CONNECT ALL LIGHTING IN THIS AREA TO CIRCUIT L21-36

**A5 LIGHTING PLAN - MAIN LEVEL**

1/8" = 1'-0"



75 York Street,  
Portland, Maine 04101  
simonsarchitects.com  
207.772.4656

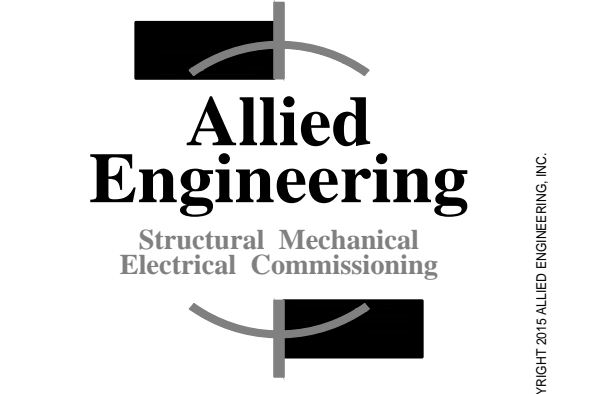


160 Veranda Street  
Portland, Maine 04103  
T: 207.221.2260  
F: 207.221.2266  
Web: www.allied-eng.com

Allied Project No: 15051  
Cad File: 15051E.dwg

PROJECT NAME:  
**WAYNFLETE LOWER SCHOOL**  
ADDITION & RENOVATIONS

WAYNFLETE SCHOOL  
360 SPRING STREET  
PORTLAND, MAINE 04102

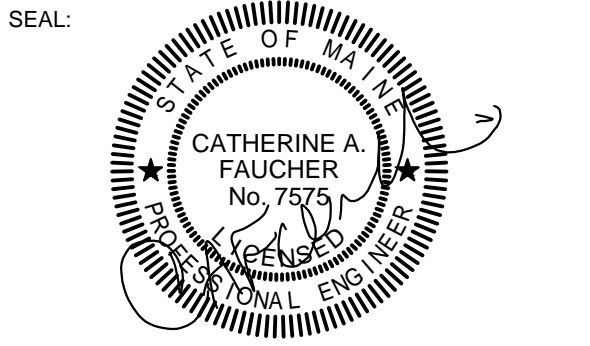

THIS DRAWING IS THE PROPERTY OF SCOTT SIMONS ARCHITECTS (SSA) AND IS NOT TO BE COPIED OR REPRODUCED IN PART OR WHOLE. © 2015 © SCOTT SIMONS ARCHITECTS, LLC

REVISION:	02/09/17
ADDENDUM #2	DATE
1	DATE
2	DATE
3	DATE
4	DATE
5	DATE
6	DATE

DATE OF ISSUE: 12 JANUARY 2017  
PROJECT NUMBER: 2013-0050  
STATUS: ISSUED FOR BID

**LIGHTING PLAN**  
**MAIN LEVEL**

**EL102R**

N:\Projects\2015\15051 - Waynflete School\00 Drawing Files\15051EL.dwg Feb 06, 2017 - 2:43pm