




F1 CEILING SENSORS WITH MANUAL OVERRIDE CONTROL
NO SCALE

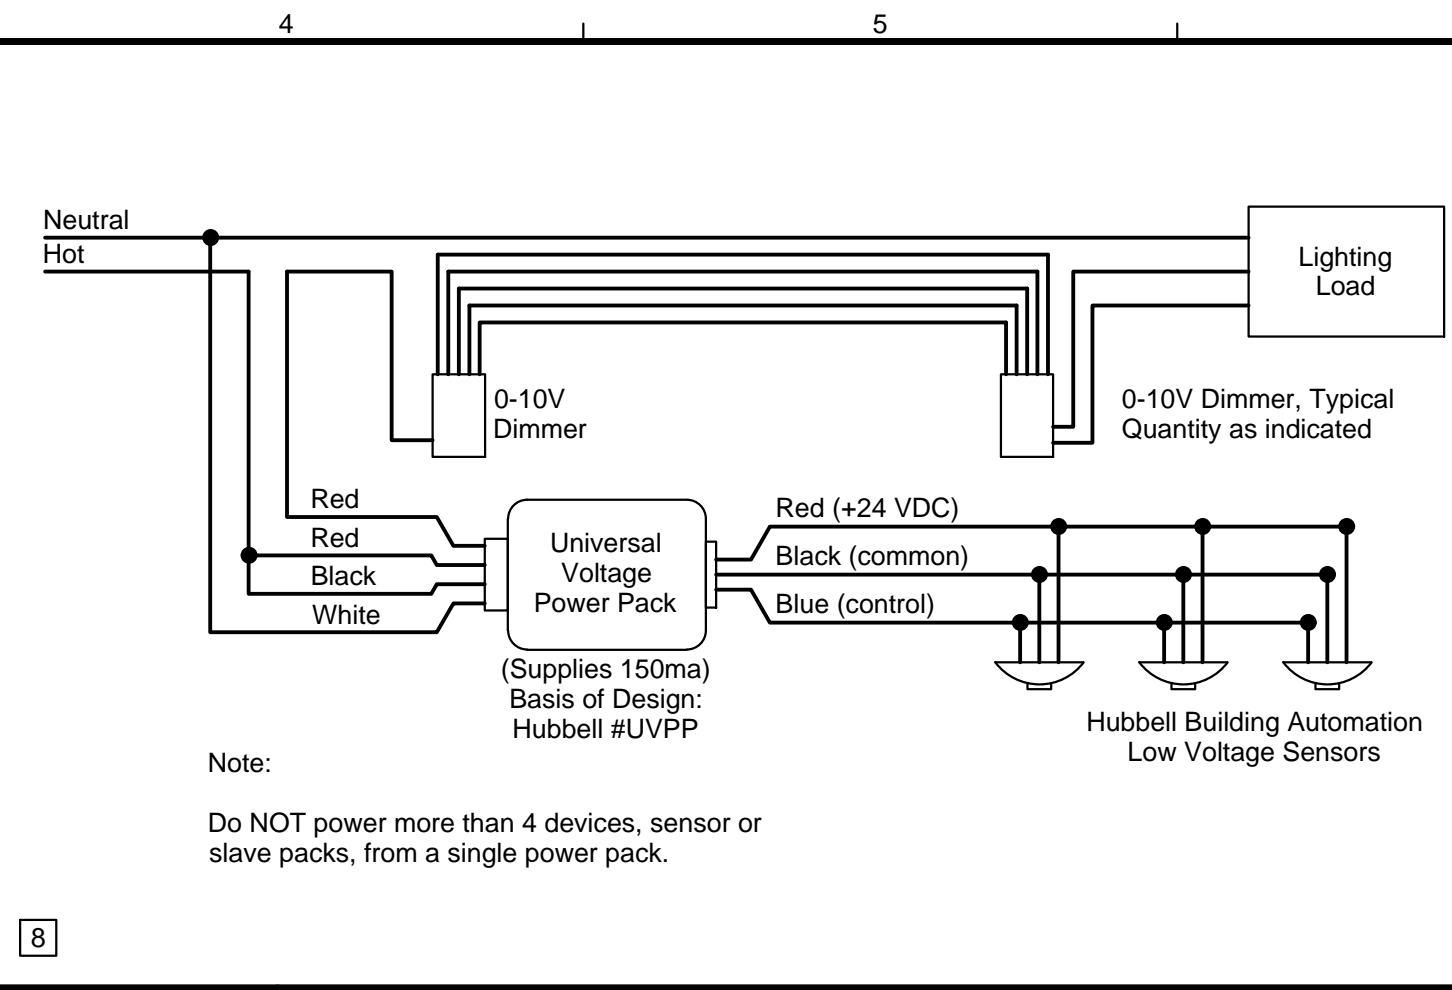


F4 CEILING SENSORS WITH 0-10V DIMMING
NO SCALE

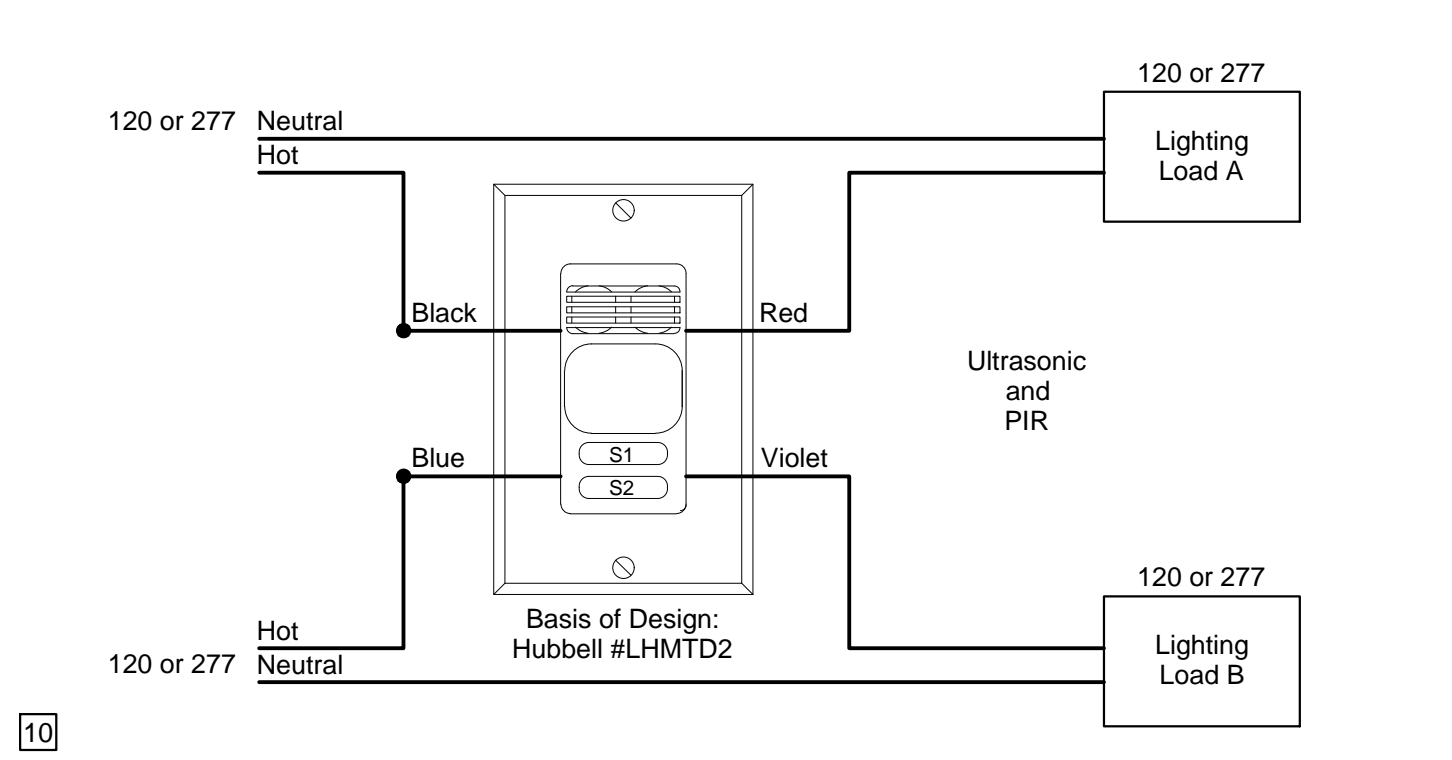

E4 DUAL CIRCUIT SWITCHING WITH 2-BUTTON OCC SENSOR
NO SCALE

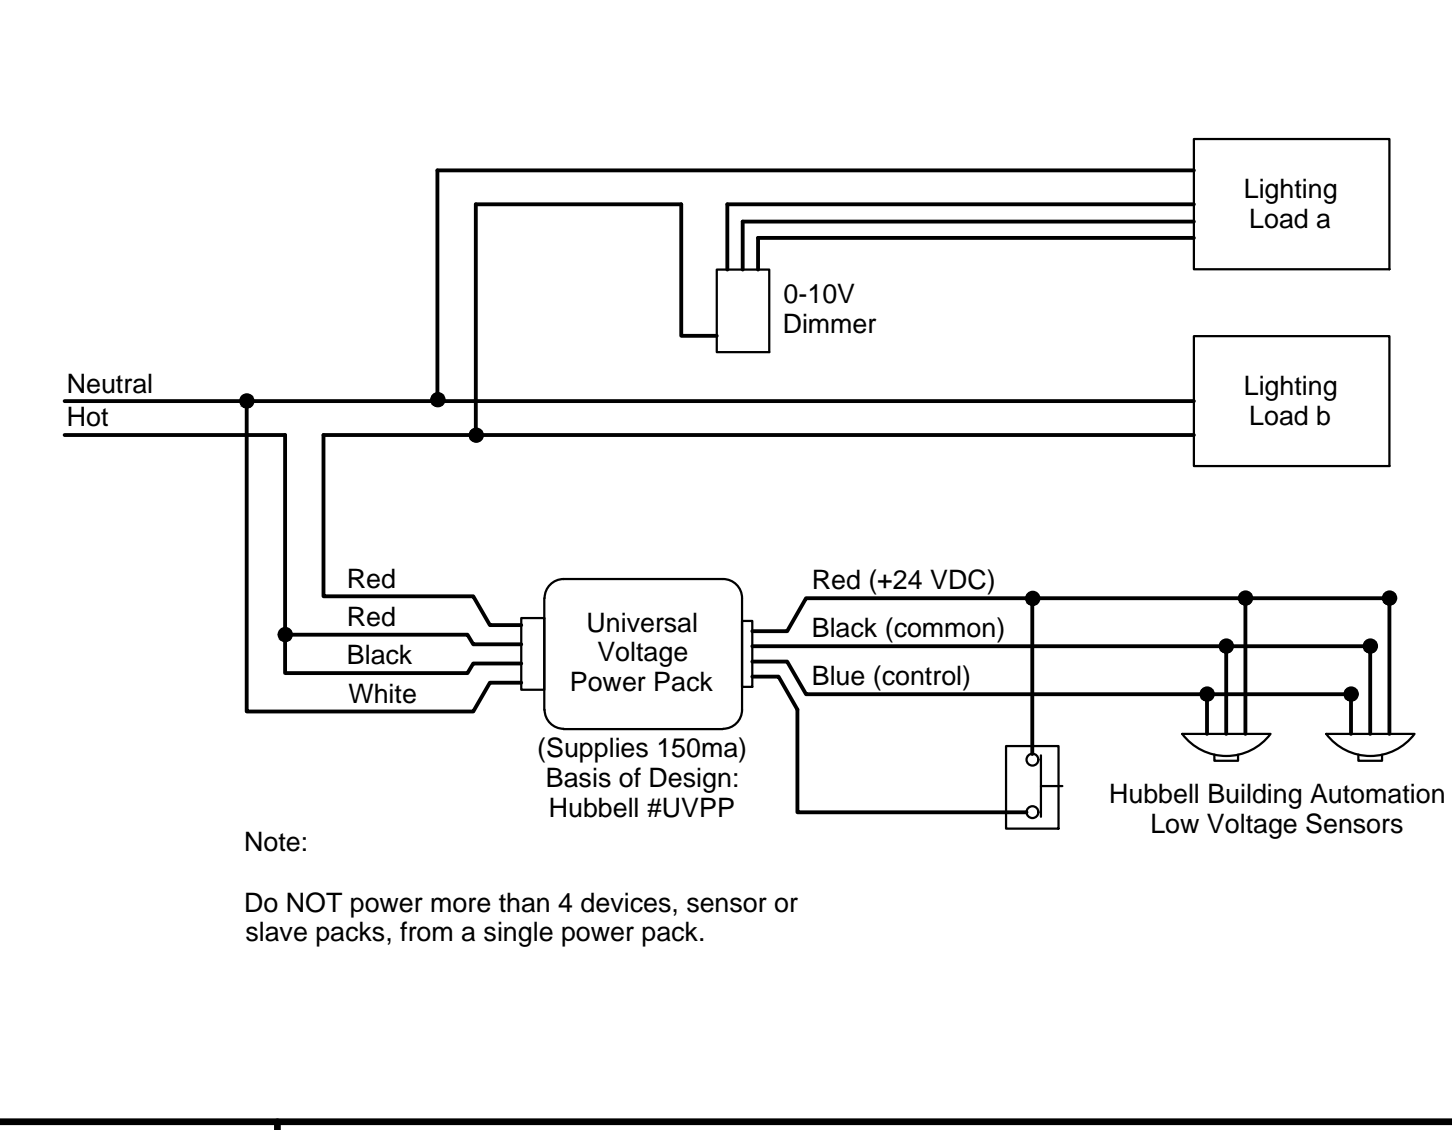

C4 SWITCHING DIAGRAM WITH 2 LIGHTING LOADS
NO SCALE

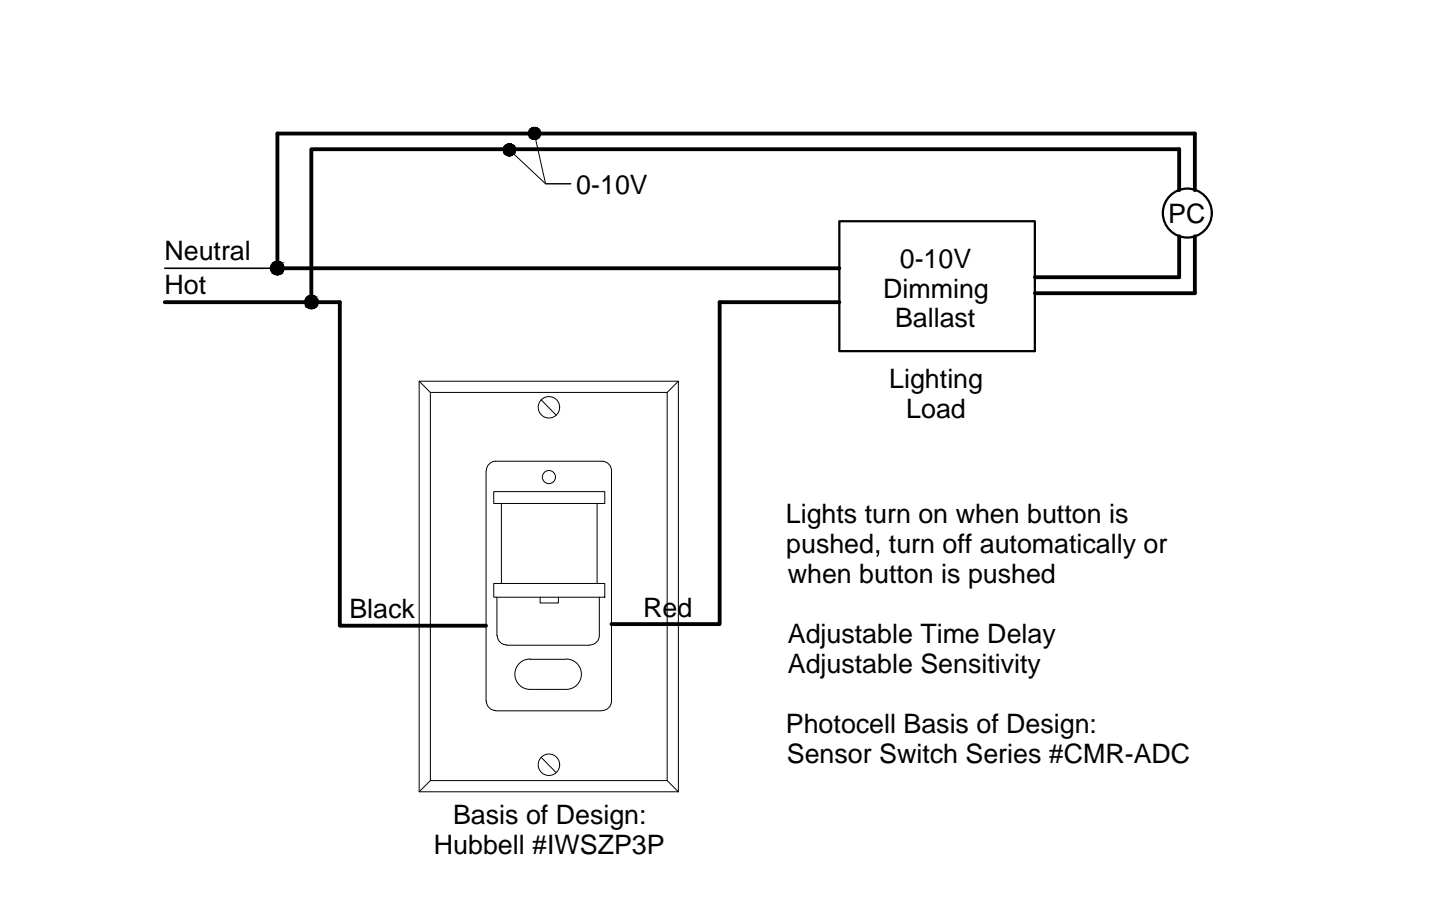

A4 MANUAL ON/AUTO OFF & AUTOMATIC DAYLIGHT CONTROL
NO SCALE

- 1 LIGHTING CONTROL SHALL BE MANUAL ON/MANUAL OFF VIA WALL SWITCHES.
- 2 LIGHTING CONTROL SHALL BE MANUAL ON/AUTO OFF WALL SENSOR SWITCH - DETAIL A9/EL500
- 3 LIGHTING CONTROL SHALL BE AUTO ON/AUTO OFF WALL SENSOR SWITCH - DETAIL B9/EL500
- 4 LIGHTING CONTROL SHALL BE AUTO ON/AUTO OFF WALL SENSOR SWITCH WIRED FOR 3-WAY OPERATION - SEE DETAIL A6/EL500
- 5 LIGHTING CONTROL SHALL BE AUTO ON/AUTO OFF VIA CEILING OCCUPANCY SENSOR(S) - DETAIL B6/EL500
- 6 LIGHTING CONTROL SHALL BE MANUAL ON/AUTO OFF VIA CEILING SENSOR(S) - DETAIL F1/EL500
- 7 LIGHTING CONTROL SHALL BE WALL MOUNTED OCCUPANCY SENSOR DIMMER SWITCH, MANUAL ON, AUTOMATIC OFF (NO DETAIL)
- 8 LIGHTING CONTROL SHALL BE 0-10V DIMMING WITH AUTO OFF VIA CEILING SENSOR(S) - DETAIL F4/EL500
- 9 LIGHTING CONTROL SHALL BE 0-10V DIMMING OF ONE OR TWO CONTROL GROUPS AS INDICATED WITH AUTO OFF VIA CEILING SENSORS AND DAYLIGHT RESPONSIVE DIMMING VIA PHOTOCELL - DETAIL A1/EL600.
- 10 LIGHTING CONTROL SHALL BE DUAL CIRCUIT SWITCHING WITH 2-BUTTON OCCUPANCY SENSOR - DETAIL E4/EL500


F7 LIGHTING CONTROL NOTES

- 11 LIGHTING CONTROL SHALL BE WALL SWITCH SENSOR MANUAL ON/AUTO OFF WITH AUTOMATIC DAYLIGHT CONTROL - DETAIL A4/EL500
 - 12 LIGHTING CONTROL SHALL BE A-B SWITCHING WITH AUTO OFF VIA CEILING SENSOR(S) - DETAIL A1/EL500
 - 13 LIGHTING CONTROL SHALL BE A-B SWITCHING WITH AUTO OFF AND AUTOMATIC DAYLIGHT CONTROL - DETAIL C1/EL500
 - A A - LIGHTING CONTROL SHALL BE MANUAL ON WITH AUTO OFF BY LCP (NO DETAIL)
 - B B - LIGHTING CONTROLLED FROM LIGHTING CONTROL PANEL - REFER TO LIGHTING CONTROL PANEL SCHEDULES (NO DETAIL)
 - C C - LIGHTING CONTROL SHALL BE A-B SWITCHING WITH AUTO OFF VIA LIGHTING CONTROL PANEL - REFER TO LIGHTING CONTROL PANEL SCHEDULES (NO DETAIL)
 - D1 D1 - FOR STAIRWAY LIGHTING, EACH FIXTURE SHALL BE ALWAYS ON AT 50% WHILE BUILDING IS OCCUPIED AND SHALL AUTOMATICALLY GO TO 100% ON BY AN INTEGRAL OCCUPANCY SENSOR
 - D2 D2 - FOR STAIRWAY LIGHTING, EACH FIXTURE SHALL HAVE 1 LAMP ALWAYS ON WHILE BUILDING IS OCCUPIED AND 1 LAMP SHALL BE AUTOMATICALLY TURNED ON BY AN INTEGRAL OCCUPANCY SENSOR
- NOTE:**
NOT ALL LIGHTING DIAGRAMS OR LIGHTING CONTROL NOTES MAY PERTAIN TO THIS PROJECT

N:\Projects\2015\15051\5051\Drawing Files\15051EL.dwg Feb 06, 2017 - 2:45pm


A1 A-B SWITCHING WITH AUTO OFF VIA CEILING SENSORS
NO SCALE

B6 CEILING SENSORS WITH AUTO ON/AUTO OFF CONTROL
NO SCALE

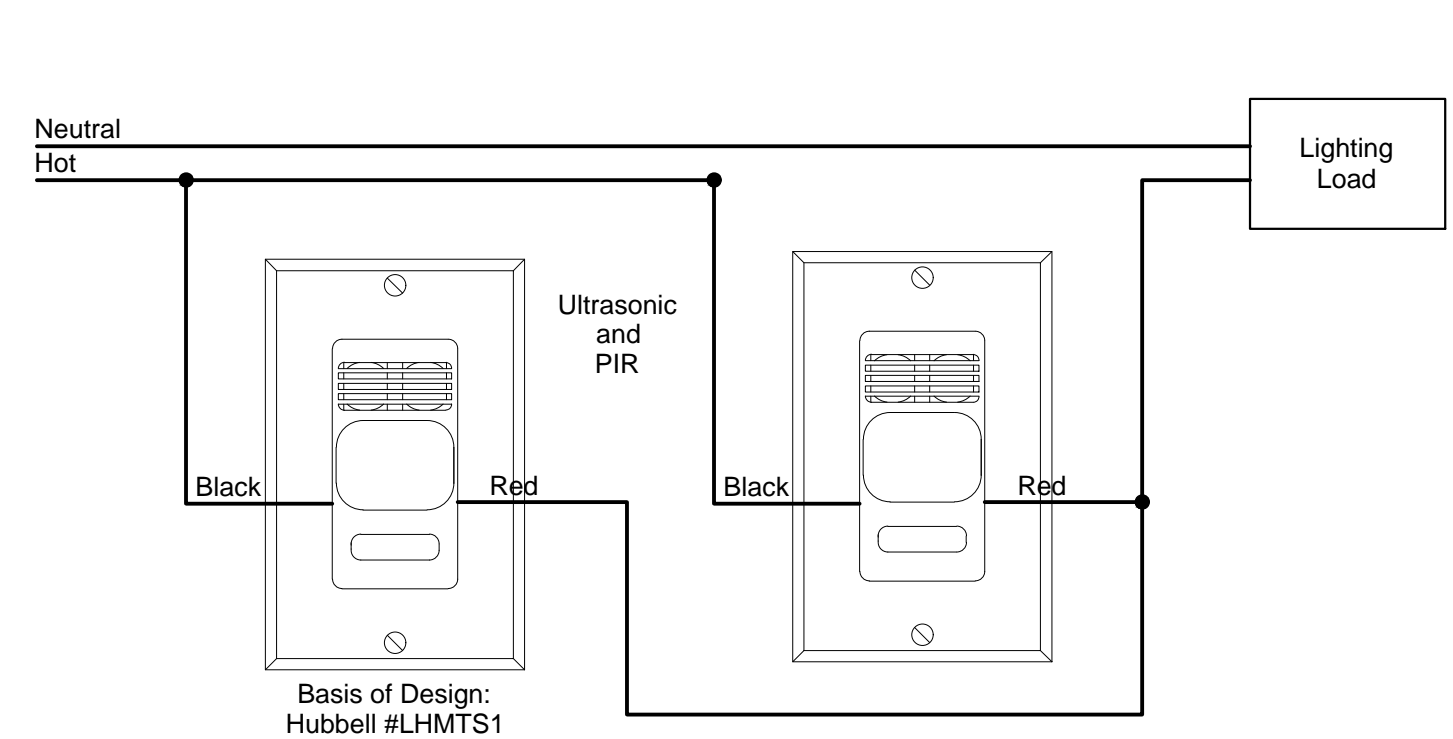

A6 3-WAY SENSOR SWITCH WIRING - AUTO ON/AUTO OFF
NO SCALE


B9 WALL SENSOR SWITCH - AUTO ON/AUTO OFF
NO SCALE

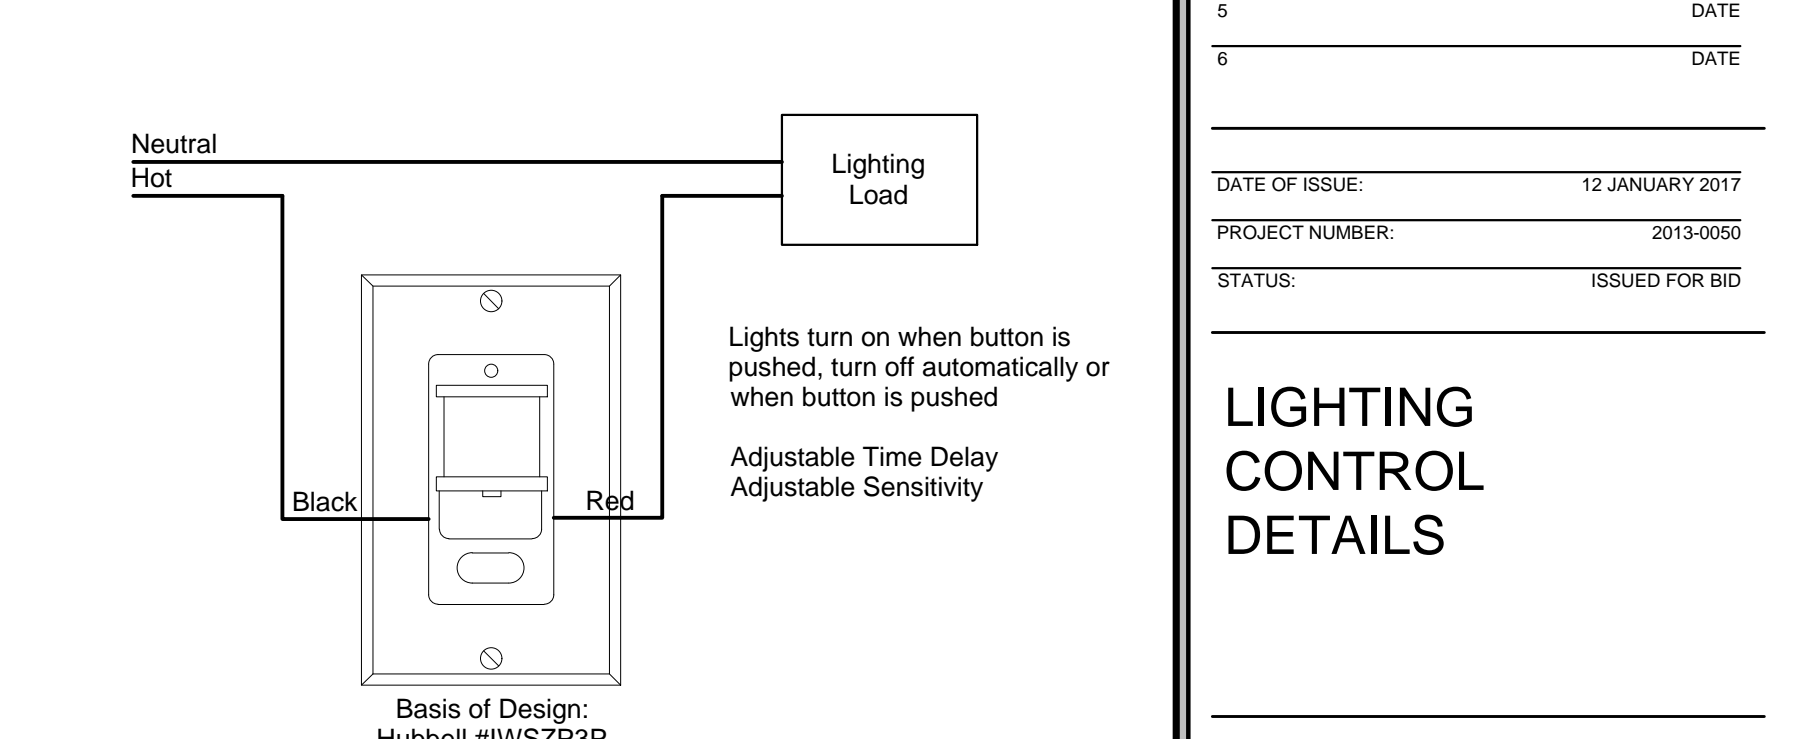

A9 WALL SENSOR SWITCH - MANUAL ON/AUTO OFF
NO SCALE



75 York Street,
Portland, Maine 04101
simonsarchitects.com
207.772.4656

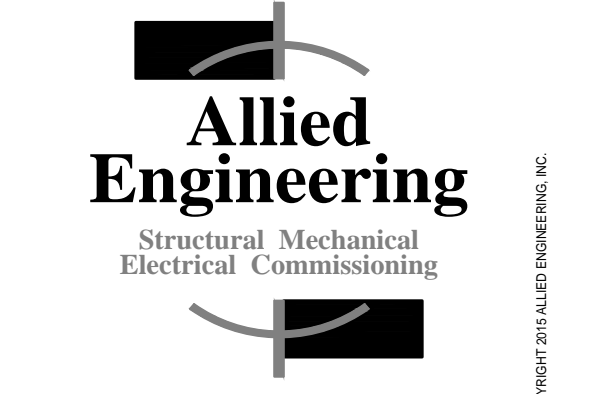


160 Veranda Street
Portland, Maine 04103
T: 207.221.2266
F: 207.221.2266
Web: www.allied-eng.com

Allied Project No: 15051
Cad File: 15051E.dwg

PROJECT NAME:
WAYNFLETE LOWER SCHOOL
ADDITION & RENOVATIONS

WAYNFLETE SCHOOL
360 SPRING STREET
PORTLAND, MAINE 04102

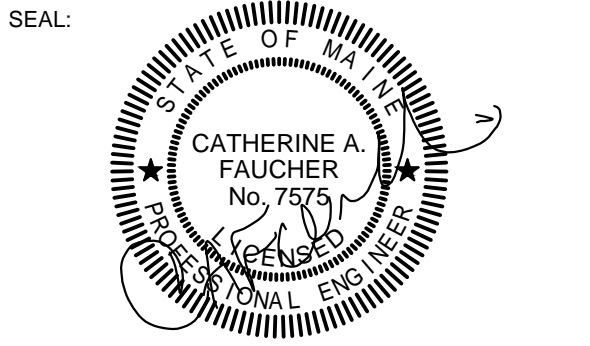

THIS DRAWING IS THE PROPERTY OF SCOTT SIMONS ARCHITECTS (SSA) AND IS NOT TO BE COPIED OR REPRODUCED IN PART OR WHOLE. © 2015 © SCOTT SIMONS ARCHITECTS, LLC

REVISION:	ADDENDUM #2	02/09/17
1		DATE
2		DATE
3		DATE
4		DATE
5		DATE
6		DATE

DATE OF ISSUE: 12 JANUARY 2017
PROJECT NUMBER: 2013-0050
STATUS: ISSUED FOR BID

LIGHTING CONTROL DETAILS

EL500R