



SECOND FLOOR

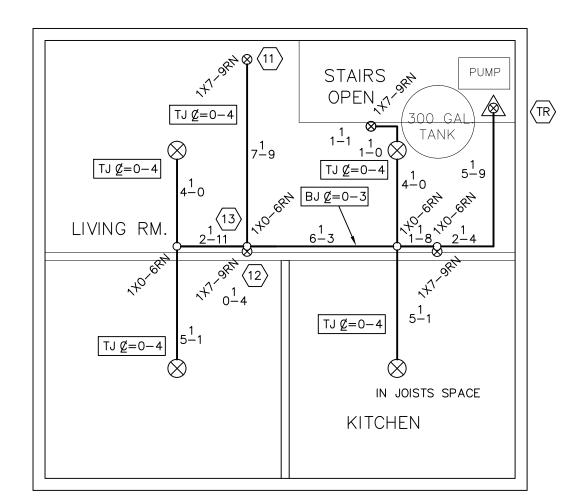

FIRST FLOOR

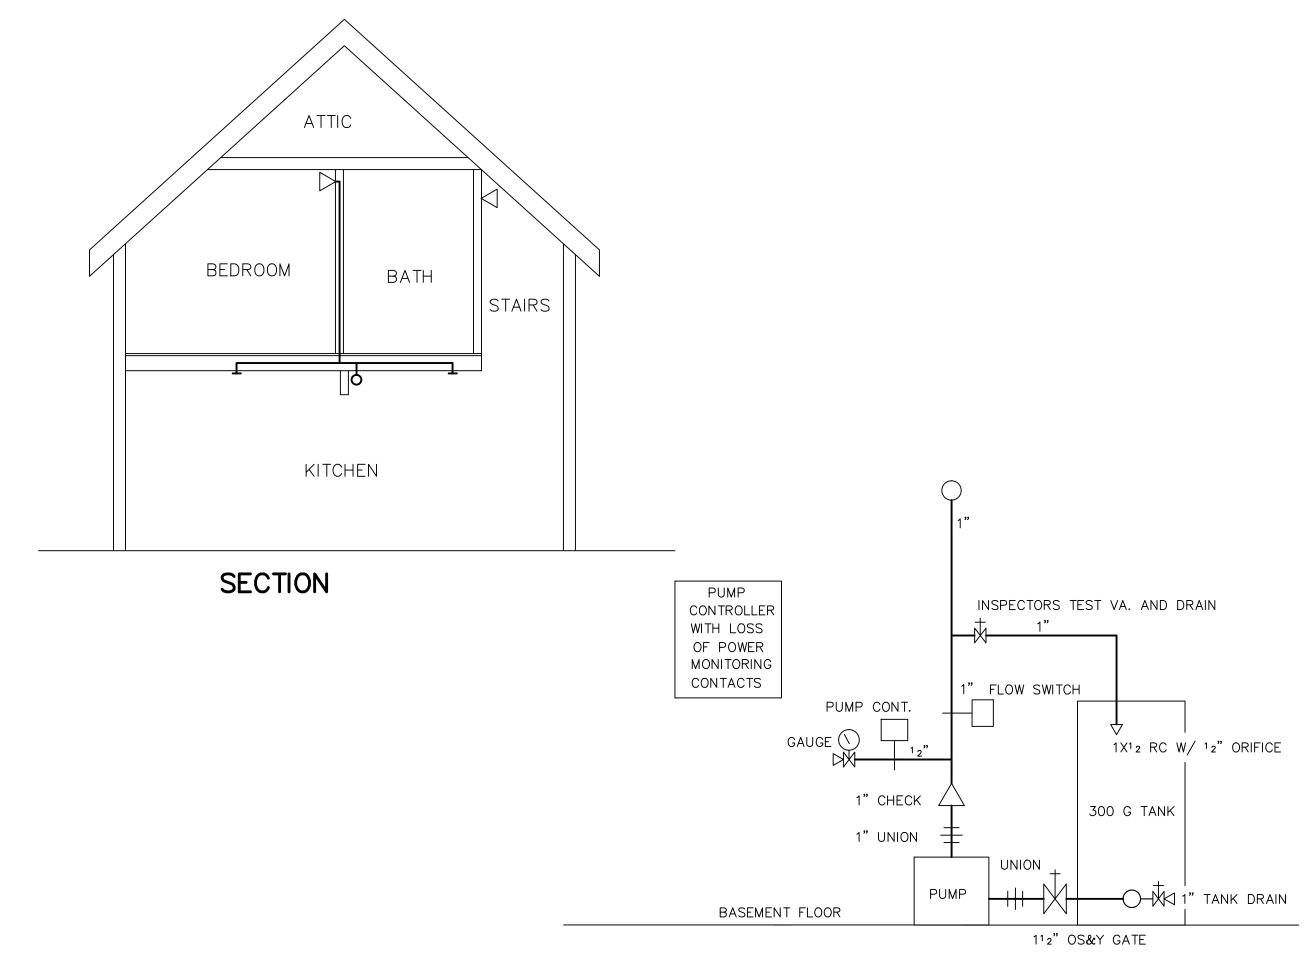

GENERAL NOTES

ALL DIMENSIONS ARE CENTER TO CENTER U/N
ALL 2" AND SMALLER PIPE TO SCH 40 BLACK STEEL
ALL SCREWED FITTINGS TO BE STD. WT. C.I. BLACK U/N
ALL HANGER SPACING AND SIZES TO CONFORM TO NFPA #13.
SUFFICIENT HEAT TO PREVENT FREEZING OF THE WET PIPE SPRINKLER SYSTEM
AND REQUIRED INSULATION METHODS PER NFPA STANDARDS
ARE REQUIRED TO BE FURNISHED BY THE BUYER/OWNER.


LEGEND

RISE OR DROP NIPPLERISER BETWEEN FLOORS

RELIABLE RFC43

RESIDENTIAL WHITE PENDENT CONCEALED LIVING SPACE

1/2"X7/16" K=4.3



RISER SECTION

NO SCALE

LIVING SPACE

SYSTEM CLASSIFICATION

A WET PIPE NFPA #13D SPRINKLER SYSTEM TO BE INSTALLED IN ALL AREAS OF THE RESIDENCE TO MEET NFPA, STATE, AND CITY OF PORTLAND CODES. PO BOX 709, GRAY, MAINE 04039 (207)657-5646 FAX: (207)657-5647

| REVISIONS | | // | APPROVED BY | DATE | SURVEYED BY | HAK 4-7-1 | l6 TI | 114 EMERY STREET | NO. OF SPRINKLERS SHOWN ON THIS SHEET |
|-----------|-----------|------|-------------|------|----------------------|------------|-------|------------------|--|
| | | // | | 11 | DRAWN BY | HAK 4-11-1 | 16 | 114 EMERT STREET | 10 |
| | | // | | // | CHECKED BY | DAS xxxx | < | | NO. OF SPRINKLERS ON JOB |
| | | // | | // | AT DEAN & ALLYN, INC | | | DODTI AND MAINE | 10 |
| | | // | | // | SCALE 1/4"=1'-0" | | | PORTLAND, MAINE | CONTRACT NO. |
| | REVISIONS | DATE | | // | SHEET NO. 1 | IF 1 | | | C161336 |