


LIGHTING FIXTURE SCHEDULE

- A LITHONIA #WL4-40L-EZB-LP835 5"X48"L LED FIXTURE HAVING ACRYLIC DIFFUSER. WALL MOUNTED. PROVIDE WITH 4124 LUMEN, 3500 DEGREE KELVIN, 39.5W LED ARRAY, AND 120/277 V DRIVER, 0-10V DIMMABLE. EQUAL FIXTURES BY COLUMBIA SHALL BE ACCEPTED.
- AE SAME AS TYPE "A" BUT WITH ADDITIONAL BATTERY BACKUP EMERGENCY BALLAST. EMERGENCY BALLAST TO OPERATE ON LOSS OF AC POWER. FIXTURE SHALL OPERATE ON BATTERY FOR A MINIMUM OF 90 MINUTES AT 1400 LUMENS LIGHT OUTPUT. UNIT SHALL HAVE TEST SWITCH AND INDICATOR LIGHT. CONNECT EMERGENCY BALLAST TO UNSWITCHED LIGHTING CIRCUIT.
- B LITHONIA #VG03C-25LED-MVOLT-DDBT OUTDOOR LED FIXTURE, BRONZE COLOR, POLYCARBONATE LENS, DIE CAST ALUMINUM HOUSING, WALL MOUNTED. PROVIDE WITH 595 LUMEN, 3500 DEGREE KELVIN, 25W LED ARRAY, AND 120/277 V, DRIVER, PHOTOCELL. EQUAL FIXTURES BY COLUMBIA SHALL BE ACCEPTED.
- C LITHONIA #ASW1LED-42C-350-40K-SR3-MVOLT-DMG OUTDOOR LED AREA LIGHTING TYPE iii FIXTURE, BRONZE COLOR, DIE CAST ALUMINUM HOUSING, WALL MOUNTED. PROVIDE WITH 4000 LUMEN, 4000 DEGREE KELVIN, 49W LED ARRAY, AND 120/277 V, 350mA DRIVER, 0-10V DIMMABLE, PHOTOCELL. EQUAL FIXTURES BY COLUMBIA SHALL BE ACCEPTED.
- LITHONIA #LHQM-LED-R QUANTUM SERIES EXIT SIGN. UNIT SHALL HAVE RED LIGHT EMITTING DIODES FOR ILLUMINATION WITH WHITE STENCIL AND HOUSING. CONSTRUCTION SHALL BE THERMO-PLASTIC. UNIT SHALL HAVE 90 MINUTE MINIMUM EMERGENCY OPERATION WITH 120/277V CONSTANT CURRENT BATTERY CHARGER AND MAINTENANCE FREE NI-CAD BATTERY. BATTERY SHALL DISCONNECT AUTOMATICALLY WHEN DISCHARGED BELOW 80% NOMINAL VOLTAGE. PROVIDE WITH THE NUMBER OF FACES, MOUNTING STYLE, AND DIRECTIONAL ARROWS (CHEVRONS) AS SHOWN ON PLANS. EQUAL FIXTURES BY DUAL-LITE SHALL BE ACCEPTED.

LIGHTING FIXTURE SCHEDULE NOTES:

- 1. FIXTURES SHALL BE APPROVED BY UTILITY COMPANY FOR USE IN LIGHTING REBATE
- 2. UNLESS OTHERWISE SPECIFIED, ALL FIXTURES SHALL BE BY HUBBELL/COLUMBIA OR LITHONIA. EQUAL FIXTURE APPROVAL SHALL BE AS JUDGED BY ENGINEER.
- 3. PROVIDE FIXTURES WITH HARDWARE SUITABLE FOR INSTALLATION ON GYP. BOARD, STRUCTURAL, OR SUSPENDED CEILINGS. SEE ARCHITECTURAL PLANS.
- -. PROVIDE A DISCONNECTING MEANS FOR ALL BALLAST SUPPLY CONDUCTORS, INTEGRAL TO EACH FIXTURE. INSTALLATION SHALL MEET THE REQUIREMENTS OF NEC ARTICLE 410.73.
- 5. ALL FIXTURES ARE SPECIFIED WITH 0-10V DIMMING FOR FUTURE USE.

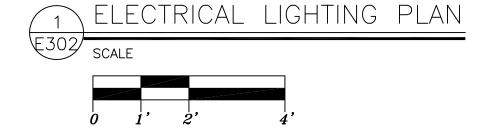





CPS ENGINEERING, INC. MECHANICAL AND ELECTRICAL ENGINEERS 90 NATIONAL DRIVE, GLASTONBURY, CT 06033 Tel. 860-657-8118 Fax 860-657-8999

2015.01.083

REVISIONS / AUTHORIZATIONS

NO.	REVISIONS / AUTHORIZATIONS	DATE					
	BID SET	08/30/17					

PROPRIETARY AT&T INFORMATION

NOT FOR GENERAL USE OR DISCLOSURE OUTSIDE OF AT&T
THIS INFORMATION MAY ONLY BE USED BY AUTHORIZED
PERSONNEL OF THE LOCAL GOVERNMENT AGENCY IN CONNECTION
WITH APPLICATION FOR PERMITS AND AUTHORIZATIONS FOR
BUILDINGS, CONSTRUCTION, AND/ OR ZONING CHANGES.

DRAWINGS PREPARED FOR



CORPORATE REAL ESTATE

AAB7WI

PROJECT TITLE:

TELECOMMUNICATIONS HUT

UNION STATION PLAZA 240-280 SAINT JOHN ST PORTLAND

PTLFME01

GREGG MIRANDO

Archoid

ELECTRICAL LIGHTING PLAN

AT&T PROJECT NUMBER:	DATE:		08/30/2017		SCALE: AS	NOTED
E15823	DRAWN	BY:	JAP		CHECKED BY:	SJM
AT&T AUTHORIZATION:	SHEET:	7	OF:	15	SHEETS	SHEET NO.
- OPENS MINING	AT&T DRAWING NO.:					E302

CONSTRUCTION DOCUMENT SUBMISSION (BID SET)