


PARK AVE

NOTES:

1. ALL TOP STORM TANK ELEVATIONS: 13.35'
2. ALL BOTTOM STORM TANK ELEVATIONS: 7.35'
3. MAXIMUM FINISHED GRADE ABOVE STORM TANKS IS 18.35' PER MANUFACTURER'S REQUIREMENT.
4. MINIMUM FINISHED GRADE ABOVE STORM TANKS IS 15.35' PER MANUFACTURER'S REQUIREMENT.
5. THIS PROFILE IS NOT INCLUSIVE OF ALL UTILITIES AND INFRASTRUCTURE. IT IS SOLELY A VISUAL REPRESENTATION OF THE SYSTEM WITH APPLICABLE ELEVATIONS.
6. REFER TO SHEET C-45 FOR DETAILS.

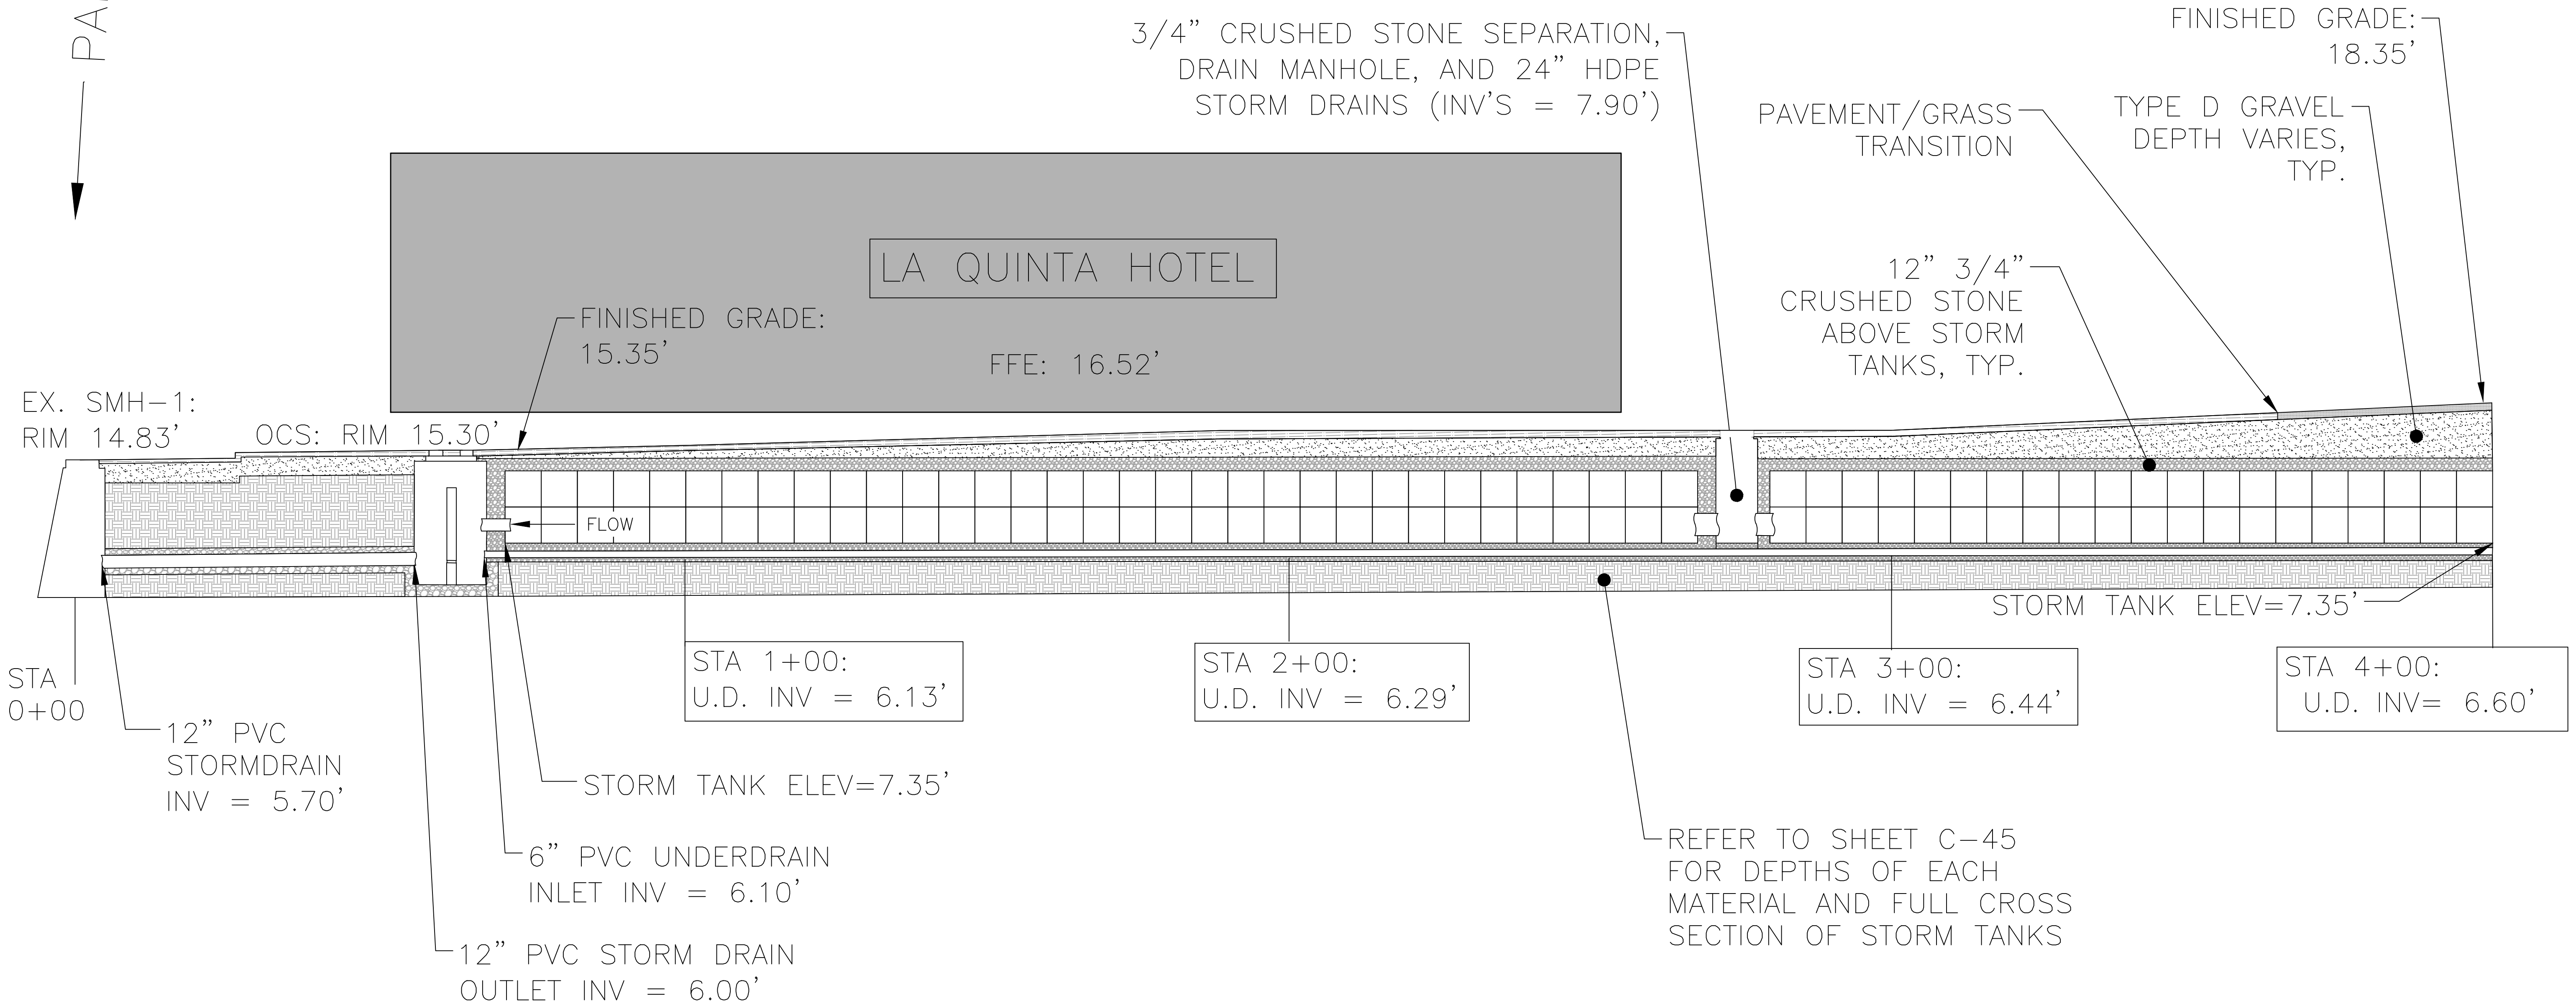

STORMWATER DETENTION PROFILE  
NOT TO SCALE


PRELIMINARY  
NOT ISSUED FOR  
CONSTRUCTION

ISSUED FOR	BY
FINAL APP.	MTA
1/13/17	
CITY COMMENTS	MTA
3/14/17	

DRAWING NAME: SUBSURFACE DETENTION PROFILE  
PROJECT NAME: HOTEL RENOVATION & STORMWATER UPGRADES  
CLIENT: LQ MANAGEMENT, LLC  
909 HIDDEN RIDGE SUITE 600, IRVING, TEXAS 75038

ACCOR ENGINEERING, INC.  
ENGINEERING, INC.

FILE:	5012_CIVIL
JN:	5012
SCALE:	NTS
DESIGNED BY:	SJL
DRAWN BY:	SJL
CHECKED BY:	MTA

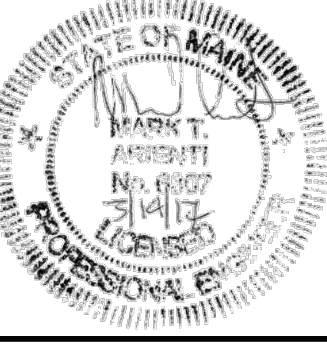

DRAWING NO.  
**C-46**