


	GUESTROOM DOOR SCHEDULE											
			DOOR						FRAME			
DOOR				SIZE				ELEV			DOOR & FRAME	
NO.	To Room:	From Room:	WIDTH	HEIGHT	THICK	MATL	FINISH	TYPE	MATERIAL	FRAME FINISH	RATING	COMMENTS
001	CLOSET	GUESTROOM	3' - 0"	6' - 8"	1 3/4"	HM	PNT	А	HM	PNT	-	
002	CLOSET	GUESTROOM	2' - 0"	6' - 8"	1 3/4"	HM	PNT	A	HM	PNT	-	
								A A			-	

2

					LO	BBY DOOR	SCHEDULE					
	To Room:	From Room:	DOOR							FRAME		
			SIZE					ELEV			DOOR & FRAME	
DOOR NO.			WIDTH	HEIGHT	THICK	MATL	FINISH	TYPE	MATERIAL	FRAME FINISH	RATING	COMMENTS
100	BREAKFAST	PANTRY	3' - 0"	7' - 0"	1 3/4"	HM	PNT	А	HM	PNT	45 MIN.	PROVIDE CLOSER AND LATCH
101	BREAKFAST ROOM	BREAKFAST	4' - 0"	6' - 8"	1 1/2"	HM	PNT	А	HM	PNT	-	
102	BREAKFAST ROOM	BREAKFAST	4' - 0"	6' - 8"	1 1/2"	HM	PNT	А	HM	PNT	-	
103	EXTERIOR	VESTIBULE	8' - 4"	8' - 0"	1 3/4"	ALUM	PREFINISH	В	ALUM.	PREFINISH	-	
104	VESTIBULE	LOBBY	8' - 4"	8' - 0"	1 3/4"	ALUM	PREFINISH	В	ALUM.	PREFINISH	-	
105	HVAC ROOM	CORRIDOR	6' - 0"	7' - 0"	1 3/4"	HM	PNT	А	HM	PNT	45 MIN.	PROVIDE CLOSER AND LATCH
106	OFFICE	WORK AREA	3' - 0"	7' - 0"	1 3/4"	HM	PNT	А	HM	PNT	-	
107	VTAC ROOM	BREAKFAST	2' - 0"	6' - 8"	1 3/4"	HM	PNT	А	HM	PNT	45 MIN.	PROVIDE CLOSER AND LATCH
108	VTAC ROOM	PANTRY	2' - 0"	6' - 8"	1 3/4"	HM	PNT	А	HM	PNT	45 MIN.	PROVIDE CLOSER AND LATCH
109	VTAC ROOM	FITNESS	2' - 0"	6' - 8"	1 3/4"	HM	PNT	А	HM	PNT	45 MIN.	PROVIDE CLOSER AND LATCH
110	CORRIDOR	GUEST LAUNDRY	3' - 0"	7' - 0"	1 3/4"	HM	PNT	А	HM	PNT	45 MIN.	PROVIDE CLOSER AND LATCH





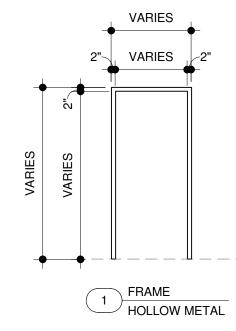


A FLUSH HOLLOW METAL OR SCW

1/4" = 1'-0"

ALUM/ GLASS

DOOR TYPE ELEVATIONS

1/4" = 1'-0"

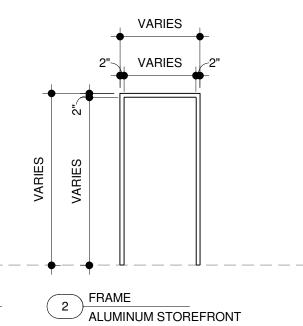

3

DOOR FRAME ELEVATIONS

DOOR NOTE: ALL NEW GUESTROOM ENTRY DOORS TO MATCH EXISTING, VERIFY IN FIELD.

GENERAL DOOR NOTES:

4

REFER TO MANUFACTURER FOR EXACT R.O. DIMENSIONS. 1.

5


- PROVIDE WEATHERSTRIPPING AT ALL EXTERIOR DOORS. 2.
- THRESHOLDS TO CONFORM TO ADA STANDARDS. 3.
- GLAZING IN ALL EXTERIOR DOORS AND SIDELIGHTS TO BE 4. TEMPERED INSULATED LOW-E ARGON FILLED GLASS.
- GLAZING IN ALL INTERIOR DOORS AND SIDELIGHTS TO BE 5. CLEAR TEMPERED GLASS, U.N.O.
- PROVIDE A KNURLED FINISH ON LEVERS ON THE KEY SIDE OF ALL DOORS THAT LEAD TO A HAZARDOUS AREA, SPECIFICALLY ELECTRICAL, TELEPHONE, ELEVATOR MACHINE ROOMS, GENERATOR ROOMS, MECHANICAL ROOMS AND ROOF ACCESS
- PROVIDE GALVANIZED DOORS AND FRAMES IN POOL AREA, 7. LAUNDRY, AND ALL EXTERIOR DOORS.
- DOOR CLOSERS SHALL NOT BE VISIBLE FROM THE PUBLIC 8. (CORRIDOR) SIDE OF DOORS.
- COORDINATE DOORS WITH CARD READERS WITH 9.

ELECTRICAL DRAWINGS.

- REFER TO FLOOR PLANS FOR EXACT DOOR SWINGS 10.
- HARDWARE SUPPLIER TO PROVIDE HARDWARE IN 11. COMPLIANCE WITH ALL APPLICABLE STATE AND LOCAL CODES.
- CONTRACTOR IS RESPONSIBLE FOR PROVIDING A 12. COMPLETE DOOR HARDWARE PACKAGE UTILIZING A MEMBER OF THE AMERICAN SOCIETY OF ARCHITECTURAL HARDWARE CONSULTANTS ONCE INTERIOR DESIGN PACKAGE IS SELECTED.
- ON DOORS WITH FIRE RATINGS, ALL COMPONENTS OF THE 13. DOOR (FRAME, HARDWARE, ETC.) ARE TO BE COMPATIBLE WITH THE LISTED RATING.
- GLAZING IN FIRE RATED DOORS TO BE FIRELITE PLUS. 14.
- 15. VERIFY ALL NEW DOOR HEIGHTS WITH FIELD CONDITIONS.
- REFER TO ID DRAWINGS FOR EXACT FINISHES. 16.

GENERAL PARTITION & FURRING NOTES:

- STAGGER GYPSUM BOARD JOINTS.
- PROVIDE MOISTURE RESISTANT GWB AT ALL WET AREAS.
- PROVIDE TILE BACKING PANELS AT ALL TILED WALLS, REFER TO SPECS 3.
- PROVIDE ACOUSTICAL SEALANT AROUND PERIMETER OF ALL GUESTROOM 4. DIVIDING WALLS AND AROUND ALL PENETRATIONS OR OPENINGS IN WALL, **REF: SPECIFICATIONS.**
- FRAMING OR FURRING SPACING FOR CEILINGS WITH MOISTURE RESISTANT GWB TO BE 12" O.C.
- FIRESTOP ALL PENETRATIONS THROUGH RATED WALL ASSEMBLIES WITH U.L. LISTED FIRE STOPPING EQUAL TO OR GREATER THAN THE RATING OF THE ASSEMBLY.
- REFER TO U.L. GUIDELINES FOR ACCEPTABLE MATERIALS/METHODS AT RATED ASSEMBLIES.
- FOR ALL CONSTRUCTION SYSTEMS WHERE AN ASSEMBLY IS SHOWN WITH A U.L. 8 LISTING NUMBER, ALL UNDERWRITERS LABORATORIES REQUIREMENTS FOR THAT NUMBER SHALL BE COMPLIED WITH, INCLUDING MISCELLANEOUS ACCESSORIEAND CONSTRUCTION TECHNIQUES. REFER TO U.L. FOR ADDITIONAL INFORMATION, INCLUDING SPECIFIC PRODUCTS ALLOWED.
- ALL PARTITION DIMENSIONS ON PLAN ARE TO CENTERLINE OF PARTITION NOT 9. CENTER OF STUD.
- MAINTAIN FIRE RATING AT PARTITION INTERSECTIONS. 10.
- PROVIDE FIRE RATED DRYWALL CONTINUOUS FLOOR TO CEILING BEHIND TUBS & 11. SHOWERS IN RATED PARTITIONS.
- CLOSE OFF BOTTOM OF ALL SHAFTS WITH HORIZONTAL SHAFT AND FIRE CAULKING, 12. UNLESS SHAFT EXTENDS DOWN TO CONCRETE SLAB OR COMPOSITE DECK.
- GUESTROOM AND MECHANICAL SHAFTS TO EXTEND TIGHT TO UNDERSIDE OF FIRE 13. RATED ASSEMBLY UNLESS NOTED OTHERWISE.
- PROVIDE A LEVEL 5 GYPSUM FINISH AT ALL PUBLIC AREA AND CORRIDOR 14. WALLS THAT ARE SCHEDULED TO RECEIVE VWC, PROVIDE LEVEL 4 FINISH @ GUESTROOMS & OTHER AREAS.
- PROVIDE DRYWALL J BEADS AT ENDS OF EXPOSED GYPSUM AT OPENINGS, I.E. AT 15. WINDOW JAMB FRAMES AND BELOW WINDOW SILLS.

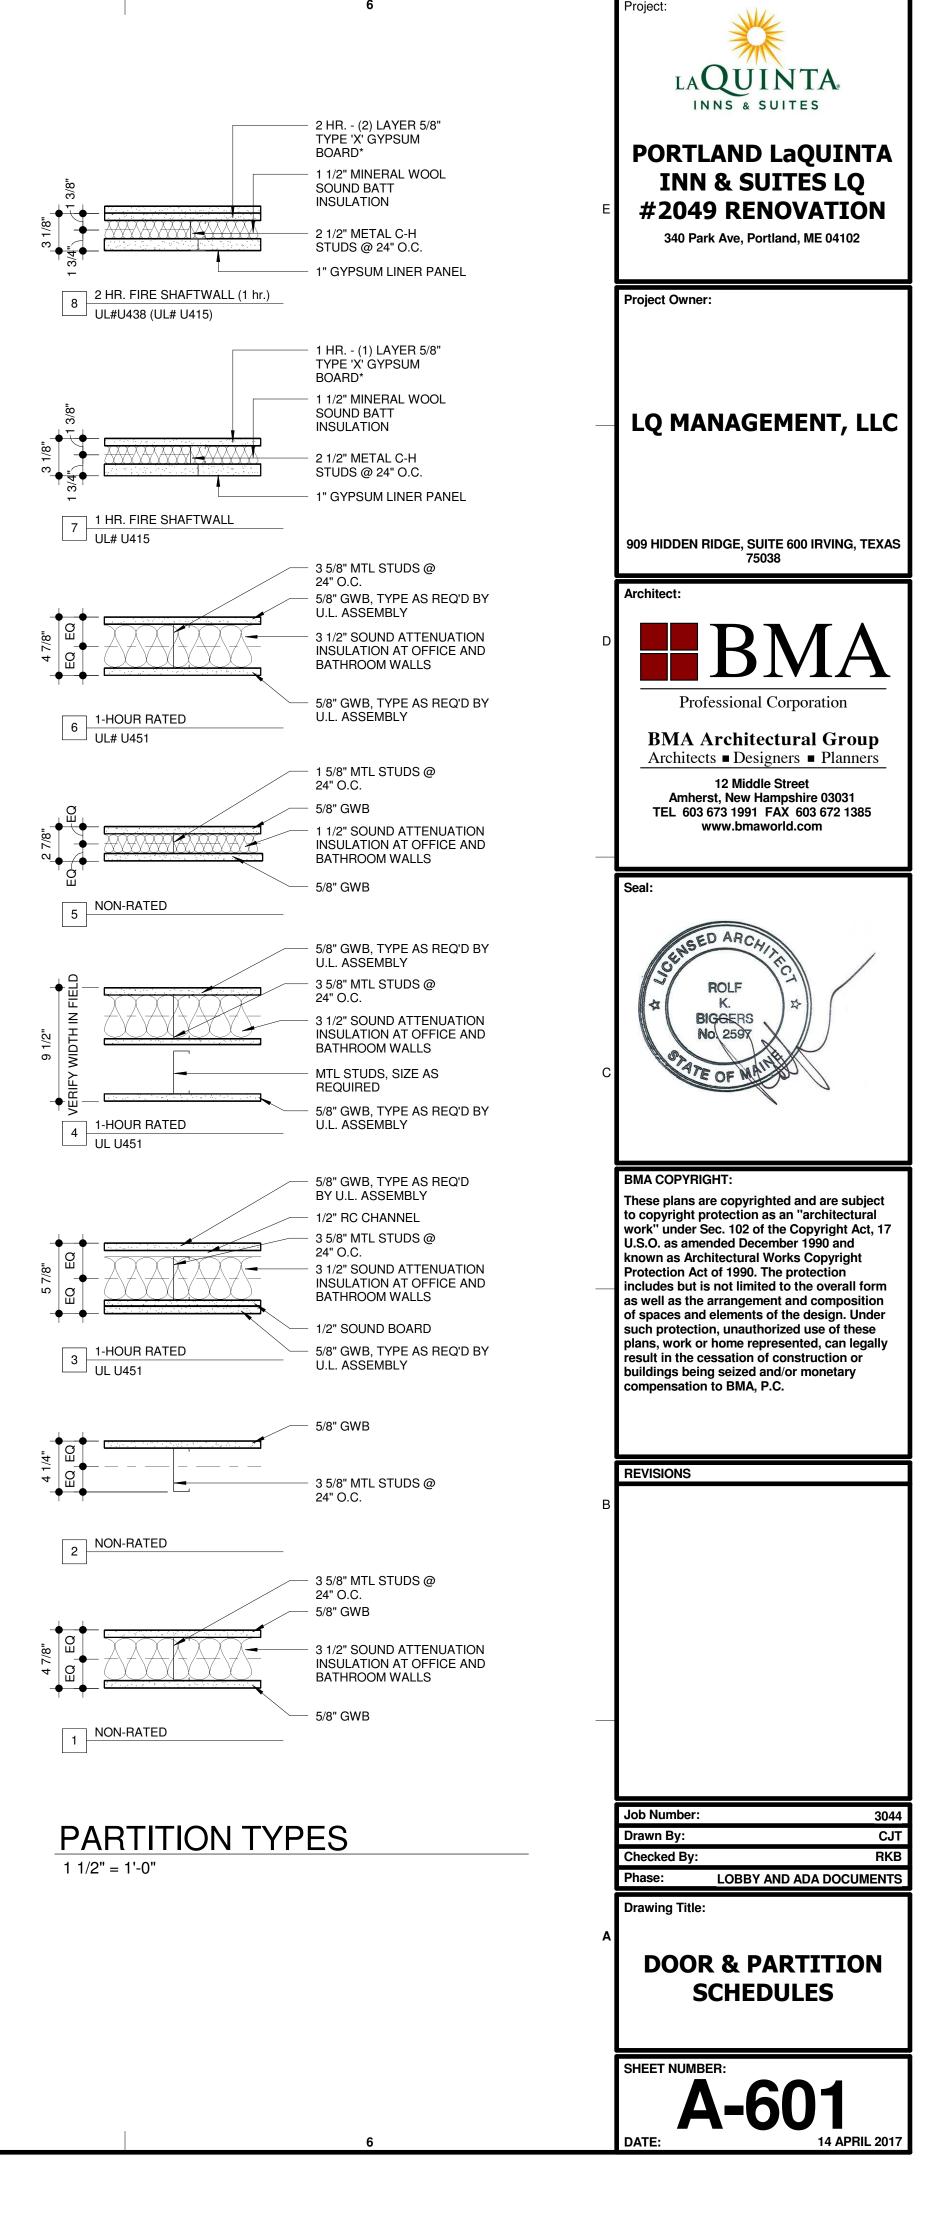

6