

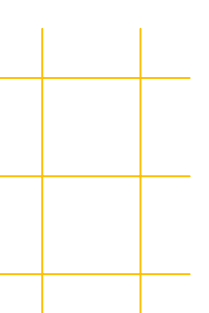






REVISIONS:	
Description:	Date:

Drawing Title:
FIRST FLOOR REFLECTED CEILING PLAN

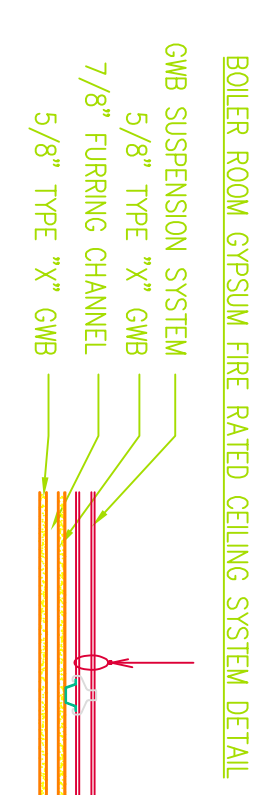
Scale: 1/4" = 1'-0"
Date: Progress 05/11/05
CWS Proj. No.:

Drawn Number:
A2.1

REFLECTED CEILING LEGEND

-  A17, 2x2 SUSPENDED CEILING SYSTEM
-  GMB, 5/8" TYPE "X" Gypsum WALL BOARD CEILING SYSTEM
-  RETURN AIR DEVICE - REF. MECHANICAL
-  SUPPLY AIR DEVICE - REF. MECHANICAL
-  2x4 FLUORESCENT FIXTURE - REF. ELECTRICAL
-  2x4 FLUORESCENT FIXTURE - REF. ELECTRICAL
-  2x4 FLUORESCENT FIXTURE - REF. ELECTRICAL

- GENERAL ELECTRICAL AND MECHANICAL NOTES:
- ELECTRICAL ITEMS ARE SHOWN FOR COORDINATION PURPOSES ONLY. COORDINATE FINAL LAYOUT, DESIGN AND FUTURE TYPE WITH OWNER AND TENANT. DESIGN PERFORMANCE SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
 - MECHANICAL ITEMS INDICATED WITHIN THIS PLAN ARE FOR COORDINATION PURPOSES ONLY. THE MECHANICAL SYSTEM DESIGN, LAYOUT AND PERFORMANCE SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.



GENERAL SUSPENDED CEILING NOTE:
2x2 SUSPENDED CEILING SYSTEM TYPICAL. INSTALL CEILING AS HIGH AS POSSIBLE 8'-0" COORDINATE WITH LIGHT FIXTURE AND DUCTWORK. MINIMUM CEILING HEIGHT IN ANY SPACE SHALL BE 7'-6".

PROVIDE 1-HOUR FIRE RATED GMB CEILING WITHIN BOILER ROOM. PROVIDE GMB SUSPENSION SYSTEM. INSTALL (1) LAYER OF 5/8" TYPE "X" GMB TO UNDERSIDE CHANNEL FRAMING. INSTALL 7/8" FURRING CHANNELS OVER FIRST LAYER OF GMB. INSTALL A SECOND LAYER OF 5/8" TYPE "X" GMB ABOVE FURRING CHANNELS.

GENERAL GMB CEILING NOTE:
HATCH REPRESENTS GMB CEILING OR SPORT. FINISH CEILING HEIGHT SHALL BE 6" LOWER THAN ADJACENT SUSPENDED CEILING SYSTEM. MINIMUM GMB CEILING HEIGHT SHALL BE 7'-0".

