


Typical Diagram



Designed & Installed by:
Firesafe Equipment
PO Box 1355
Auburn, ME 04211
207-784-7525

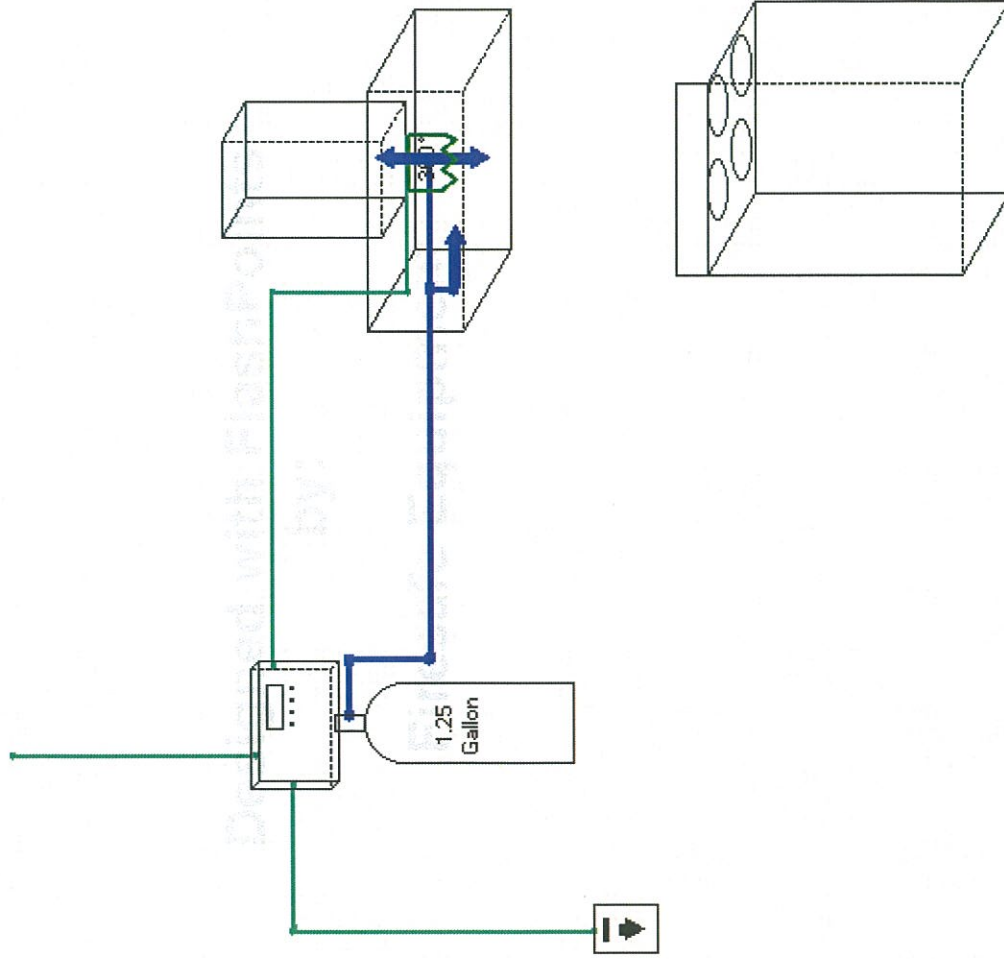

For:
The Thaxter Company
55 Bell Street
Portland, ME 04103

Lic #:

Designer: W Lord

Job #: 101013-B1

Date: 10/10/2013

Stamp

Fire Suppression System Design Specifications

Notes

System Materials

Item Number	Description	Quantity
87-120019-001	R Nozzle	1
60-120001-001	WHDR-125 Cylinder/Valve, 1.25 Gallon	1
60-120099-001	Universal Control Head Assembly	1
WK-282664-000	ML-360 Link 360 F (182 C), ML, Unpaint	1
60-120110-001	Remote Manual Release, Combination	1
87-120016-001	ADP Nozzle	2
60-120064-001	Universal Link Detector Housing Kit (A+	1



Designed & Installed by:
Firesafe Equipment
PO Box 1355
Auburn, ME 04211
207-784-7525

For:
The Thaxter Company
55 Bell Street
Portland, ME 04103