




**PDT ARCHITECTS**  
 49 DARTMOUTH STREET  
 PORTLAND, MAINE 04101  
 207-775-0559  
 www.pdtarch.com

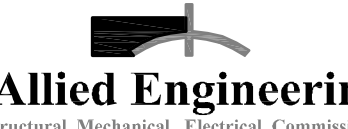


**Allied Engineering**  
 Structural Mechanical Electrical Consulting  
 100 Veranda Street  
 Portland, Maine 04103  
 T: 207.221.2266  
 F: 207.221.2266  
 W: www.allied-eng.com

ALLIED PROJECT NO.:  
 13008  
 CAD FILE:  
 13008M.DWG

**COPYRIGHT**  
 PDT Architects  
 Reuse or reproduction of the  
 contents of this document is not  
 permitted without written  
 permission of PDT Architects

TruChoice FCU - 272 Park Avenue  
 PORTLAND, MAINE

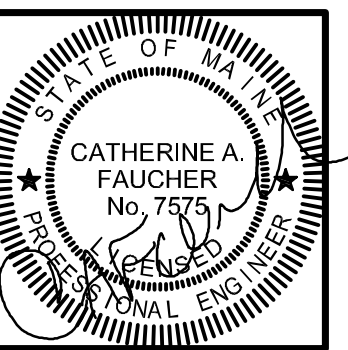

PDT JOB NO.  
 12084

DRWN.  
 CHK.  
 SCALE:  
 AS NOTED

ISSUE:  
 04/26/2013  
 CONSTRUCTION  
 DOCUMENTS

TITLE  
 ELECTRICAL  
 SCHEDULES &  
 POWER RISER  
 DIAGRAM

SHEET  
 EP600

| PANEL SCHEDULE ~ L3 |           |             |           |                              |      |                         |                            |                 |         |
|---------------------|-----------|-------------|-----------|------------------------------|------|-------------------------|----------------------------|-----------------|---------|
| VOLTAGE: 208/120V   |           |             | MCO: 225A |                              |      | AIC: 10,000             |                            |                 |         |
| 3-PHASE, 4-WIRE     |           |             | MGB:      |                              |      | LOCATION: ELECTRIC ROOM |                            |                 |         |
| CKT NO              | BRKR SIZE | NO OF POLES | PH        | CIRCUIT LOAD (KVA) CONNECTED |      |                         | BRANCH CIRCUIT DESCRIPTION | WIRE SIZE       | CONDUIT |
|                     |           |             |           | A                            | B    | C                       |                            |                 |         |
| 1                   | 20        | 1           | A         | 1.50                         |      |                         | (E) BASEMENT OFFICE        | (2)#12, (1)#12G | 1/2"    |
| 3                   | 20        | 1           | B         |                              | 1.50 |                         | EH-3 RM 103, EH-3 RM 107   | (2)#12, (1)#12G | 1/2"    |
| 5                   | 20        | 1           | C         |                              |      | 1.50                    | EH-3 RM 111, EH-3 RM 112   | (2)#12, (1)#12G | 1/2"    |
| 7                   | 20        | 1           | A         | 1.50                         |      |                         | EH-3 RM 104, EH-3 RM 105   | (2)#12, (1)#12G | 1/2"    |
| 9                   | 20        | 1           | B         |                              | 1.50 |                         | EH-4 RM 110                | (2)#12, (1)#12G | 1/2"    |
| 11                  | 20        | 1           | C         |                              |      | 1.25                    | EH-2 RM 113                | (2)#12, (1)#12G | 1/2"    |
| 13                  | 20        | 1           | A         | 1.50                         |      |                         | EH-4 STAIR 1               | (2)#12, (1)#12G | 1/2"    |
| 15                  | 20        | 1           | B         |                              | 0.75 |                         | EH-3 RM 103                | (2)#12, (1)#12G | 1/2"    |
| 17                  | 20        | 1           | C         |                              |      | 0.97                    | LOBBY LIGHTING             | (2)#12, (1)#12G | 1/2"    |
| 19                  | 20        | 1           | A         | 0.86                         |      |                         | FIRST FLOOR LIGHTING       | (2)#12, (1)#12G | 1/2"    |
| 21                  | 20        | 1           | B         |                              | 0.90 |                         | RM 103 & EXTERIOR LTG      | (2)#12, (1)#12G | 1/2"    |
| 23                  | 20        | 1           | C         |                              | 1.20 |                         | PRIMARY BANK SIGN          | (2)#10, (1)#10G | 1/2"    |
|                     |           |             |           | 5.56                         | 4.65 | 4.92                    | SUBTOTAL                   |                 |         |
|                     |           |             |           |                              |      |                         |                            |                 |         |
| 2                   | 20        | 1           | A         | 0.00                         |      |                         | (E) SUMP PUMP              | (2)#12, (1)#12G | 1/2"    |
| 4                   | 20        | 1           | B         |                              | 0.00 |                         | (E) COMPUTER ROOM          | (2)#12, (1)#12G | 1/2"    |
| 6                   | 20        | 1           | C         |                              | 0.00 |                         | (E) ALARM PANEL            | (2)#12, (1)#12G | 1/2"    |
| 8                   | 20        | 1           | A         | 1.20                         |      |                         | BLDG MTD BANK SIGN         | (2)#10, (1)#10G | 1/2"    |
| 10                  | 30        | 2           |           |                              | 2.50 |                         | EH-1 IN 101                | (2)#10, (1)#10G | 1/2"    |
| 12                  | 20        | 1           | C         |                              |      | 2.50                    | SPARE                      |                 |         |
| 14                  | 20        | 1           | A         | 0.00                         |      |                         | SPARE                      |                 |         |
| 16                  | 20        | 1           | B         |                              | 0.00 |                         | SPARE                      |                 |         |
| 18                  | 20        | 1           | C         |                              | 0.00 |                         | SPARE                      |                 |         |
| 20                  | 20        | 1           | A         | 0.00                         |      |                         | SPARE                      |                 |         |
| 22                  | 20        | 1           | B         |                              | 0.00 |                         | SPARE                      |                 |         |
| 24                  | 20        | 1           | C         |                              | 0.00 |                         | SPARE                      |                 |         |
|                     |           |             |           | 1.20                         | 2.50 | 2.70                    | SUBTOTAL                   |                 |         |

| PANEL SCHEDULE ~ L2 |           |             |           |                              |      |                      |                            |                 |         |
|---------------------|-----------|-------------|-----------|------------------------------|------|----------------------|----------------------------|-----------------|---------|
| VOLTAGE: 208/120V   |           |             | MCO: 225A |                              |      | AIC: 10,000          |                            |                 |         |
| 3-PHASE, 4-WIRE     |           |             | MGB:      |                              |      | LOCATION: OFFICE 107 |                            |                 |         |
| CKT NO              | BRKR SIZE | NO OF POLES | PH        | CIRCUIT LOAD (KVA) CONNECTED |      |                      | BRANCH CIRCUIT DESCRIPTION | WIRE SIZE       | CONDUIT |
|                     |           |             |           | A                            | B    | C                    |                            |                 |         |
| 1                   | 20        | 1           | A         | 1.20                         |      |                      | RECEPTACLES                | (2)#12, (1)#12G | 1/2"    |
| 3                   | 20        | 1           | B         |                              | 1.20 |                      | RECEPTACLES                | (2)#12, (1)#12G | 1/2"    |
| 5                   | 20        | 1           | C         |                              |      | 1.60                 | RECEPTACLES                | (2)#12, (1)#12G | 1/2"    |
| 7                   | 20        | 1           | A         | 1.60                         |      |                      | RECEPTACLES                | (2)#12, (1)#12G | 1/2"    |
| 9                   | 20        | 1           | B         |                              | 0.80 |                      | RECEPTACLES                | (2)#12, (1)#12G | 1/2"    |
| 11                  | 20        | 1           | C         |                              |      | 0.80                 | RECEPTACLES                | (2)#12, (1)#12G | 1/2"    |
| 13                  | 20        | 1           | A         | 0.80                         |      |                      | RECEPTACLES                | (2)#12, (1)#12G | 1/2"    |
| 15                  | 20        | 1           | B         |                              | 1.00 |                      | RECEPTACLES                | (2)#12, (1)#12G | 1/2"    |
| 17                  | 20        | 1           | C         |                              |      | 1.20                 | DIGITAL MARKETING TV'S     | (2)#12, (1)#12G | 1/2"    |
| 19                  | 20        | 1           | A         | 1.00                         |      |                      | RECEPTACLES                | (2)#12, (1)#12G | 1/2"    |
| 21                  | 20        | 1           | B         |                              | 1.00 |                      | RECEPTACLES                | (2)#12, (1)#12G | 1/2"    |
| 23                  | 20        | 1           | C         |                              |      | 3.00                 | TUBE SYSTEM CUSTOMER UNIT  | (2)#10, (1)#10G | 1/2"    |
| 25                  | 30        | 1           | A         | 3.00                         |      |                      | TUBE SYSTEM CUSTOMER UNIT  | (2)#10, (1)#10G | 1/2"    |
| 27                  | 20        | 1           | B         |                              | 1.00 |                      | GENERATOR BATTERY CHARGER  | (2)#12, (1)#12G | 1/2"    |
| 29                  | 20        | 1           | C         |                              |      | 1.50                 | GENERATOR BLOCK HEATER     | (2)#12, (1)#12G | 1/2"    |
| 31                  | 20        | 1           | A         | 0.20                         |      |                      | ROOFTOP RECEPTACLE         | (2)#12, (1)#12G | 1/2"    |
| 33                  | 20        | 1           | B         |                              | 0.00 |                      | SPARE                      |                 |         |
| 35                  | 20        | 1           | C         |                              | 0.00 |                      | SPARE                      |                 |         |
| 37                  | 20        | 1           | A         | 0.00                         |      |                      | SPARE                      |                 |         |
| 39                  | 20        | 1           | B         |                              | 0.00 |                      | SPARE                      |                 |         |
| 41                  | 20        | 1           | C         |                              | 0.00 |                      | SPARE                      |                 |         |
|                     |           |             |           | 7.80                         | 5.00 | 8.10                 | SUBTOTAL                   |                 |         |
|                     |           |             |           |                              |      |                      |                            |                 |         |
| 2                   | 20        | 1           | A         | 0.80                         |      |                      | TELLERS RECEPTACLES        | (2)#12, (1)#12G | 1/2"    |
| 4                   | 20        | 1           | B         |                              | 0.80 |                      | TELLERS RECEPTACLES        | (2)#12, (1)#12G | 1/2"    |
| 6                   | 20        | 1           | C         |                              |      | 1.20                 | CASH DISPENSER             | (2)#12, (1)#12G | 1/2"    |
| 8                   | 20        | 1           | A         | 1.20                         |      |                      | TUBE SYSTEM OPERATOR UNIT  | (2)#12, (1)#12G | 1/2"    |
| 10                  | 20        | 1           | B         |                              | 1.20 |                      | TUBE SYSTEM OPERATOR UNIT  | (2)#12, (1)#12G | 1/2"    |
| 12                  | 20        | 1           | C         |                              |      | 0.60                 | AUDIO SWITCHER BOX         | (2)#12, (1)#12G | 1/2"    |
| 14                  | 20        | 1           | A         | 0.60                         |      |                      | COPIER - 105               | (2)#12, (1)#12G | 1/2"    |
| 16                  | 20        | 1           | B         |                              | 1.60 |                      | COUNTER RECEPTACLES        | (2)#12, (1)#12G | 1/2"    |
| 18                  | 20        | 1           | C         |                              |      | 1.00                 | COUNTER RECEPTACLES        | (2)#12, (1)#12G | 1/2"    |
| 20                  | 20        | 1           | A         | 1.00                         |      |                      | ATM                        | (2)#12, (1)#12G | 1/2"    |
| 22                  | 20        | 1           | B         |                              | 1.20 |                      | ATM                        | (2)#12, (1)#12G | 1/2"    |
| 24                  | 20        | 1           | C         |                              |      | 1.20                 | FACP                       | (2)#12, (1)#12G | 1/2"    |
| 26                  | 20        | 1           | A         | 0.30                         |      |                      | TELLERS RECEPTACLES        | (2)#12, (1)#12G | 1/2"    |
| 28                  | 20        | 1           | B         |                              | 0.80 |                      | DOOR HARDWARE              | (2)#12, (1)#12G | 1/2"    |
| 30                  | 20        | 1           | C         |                              |      | 0.20                 | SPARE                      |                 |         |
| 32                  | 20        | 1           | A         | 0.00                         |      |                      | SPARE                      |                 |         |
| 34                  | 20        | 1           | B         |                              | 0.00 |                      | SPARE                      |                 |         |
| 36                  | 20        | 1           | C         |                              | 0.00 |                      | SPARE                      |                 |         |
| 38                  | 20        | 1           | A         | 0.00                         |      |                      | SPARE                      |                 |         |
| 40                  | 20        | 1           | B         |                              | 0.00 |                      | SPARE                      |                 |         |
| 42                  | 20        | 1           | C         |                              | 0.00 |                      | SPARE                      |                 |         |
|                     |           |             |           | 3.90                         | 5.60 | 4.20                 | SUBTOTAL                   |                 |         |

| ELECTRICAL SCHEDULE OF MECHANICAL EQUIPMENT |   |       |    |       |       |      |                   |       |      |                                |                              |          |     |       |                   |                     |         |
|---|---|-------|----|-------|-------|------|-------------------|-------|------|--------------------------------|------------------------------|----------|-----|-------|-------------------|---------------------|---------|
| TAG   | DESCRIPTION   | VOLTS | PH | LOAD  | MCA   | MOPD | DISCONNECT SWITCH |       |      |                                | STARTER (NEMA)               |          |     | PANEL | WIRING IN CONDUIT | NOTES               |         |
|   |   |       |    |       |       |      | FRAME             | POLES | FUSE | NEMA ENCL                      | FBD                          | SIZE/VFD | FBD |       |                   |                     | CBD     |
| RTU-1                                       | ROOF TOP UNIT   | 208   | 3  | 21.1A | 23.8A | 30A  | 30A               | 3     | 30A  | 3R                             | 26                           | -        | -   | -     | Exist MDP         | 3#10, 1#10G IN 3/4" | 3       |
| RTU-2                                       | ROOF TOP UNIT   | 208   | 1  | 15.9A | 18.1A | 25A  | 25A               | 2     | 25A  | 3R                             | 26                           | -        | -   | -     | Exist MDP         | 2#10, 1#10G IN 3/4" | 3       |
| RTU-4                                       | ROOF TOP UNIT   | 208   | 3  | 21.1A | 23.8A | 30A  | 30A               | 3     | 30A  | 3R                             | 26                           | -        | -   | -     | Exist MDP         | 3#10, 1#10G IN 3/4" | 4       |
| EH-1  | ELECTRIC FAN HEATER - CEILING   | 208   | 1  | 5000W | 24A   | 30A  | -                 | -     | -    | -                              | 23                           | -        | -   | -     | L3                | 2#10, 1#10G IN 3/4" | 1, 2, 5 |
| EH-2  | ELECTRIC BASEBOARD HEATER - WALL  | 120   | 1  | 1250W | 10.4A | 20A  | -                 | -     | -    | -                              | -                            | -        | -   | -     | L3                | 2#12, 1#12G IN 3/4" | 1, 2, 5 |
| EH-3  | ELECTRIC BASEBOARD HEATER - WALL  | 120   | 1  | 750W  | 6.3A  | 20A  | -                 | -     | -    | -                              | -                            | -        | -   | -     | L3                | 2#12, 1#12G IN 3/4" | 1, 2, 5 |
| EH-4  | ELECTRIC FAN HEATER - WALL  | 120   | 1  | 1500W | 12.5A | 20A  | -                 | -     | -    | -                              | -                            | -        | -   | -     | L3                | 2#12, 1#12G IN 3/4" | 1, 2, 5 |
| NOTES:                                      |   |       |    |       |       |      |                   |       |      |                                |                              |          |     |       |                   |                     |         |
| 1   | REFER TO POWER PLAN FOR QUANTITY AND CIRCUITING                           |       |    |       |       |      |                   |       |      |                                | ABBREVIATIONS:               |          |     |       |                   |                     |         |
| 2   | PROVIDE CIRCUIT BREAKER AT EXISTING PANEL L3                              |       |    |       |       |      |                   |       |      |                                | FWE FURNISHED WITH EQUIPMENT |          |     |       |                   |                     |         |
| 3   | PROVIDE FUSES IN EXISTING 60A FRAME BUCKET AT MDP                         |       |    |       |       |      |                   |       |      |                                | NF NOT FUSED                 |          |     |       |                   |                     |         |
| 4   | PROVIDE HARDWARE AND FUSES IN EXISTING 30A FRAME BUCKET AT MDP            |       |    |       |       |      |                   |       |      |                                | SWBD SWITCHBOARD             |          |     |       |                   |                     |         |
| 5   | FULL VOLTAGE THERMOSTAT FURNISHED WITH UNIT, E. C. TO INSTALL AND CIRCUIT |       |    |       |       |      |                   |       |      |                                | FBD FURNISHED BY DIVISION    |          |     |       |                   |                     |         |
|   |   |       |    |       |       |      |                   |       |      | CBD CONTROL WIRING BY DIVISION |                              |          |     |       |                   |                     |         |

| LIGHTING CONTROL PANEL SCHEDULE ~ LCP         |   |                    |  |
|---|---|--------------------|--|
| PROVIDE INTEGRAL ASTRONOMICAL TIME CLOCK      |   |                    |  |
| DESIGNATION: LCP                              |   | MOUNTING: SURFACE  |  |
| CONTROL VOLTAGE: 120                          |   | LOCATION: BASEMENT |  |
| CONTROL CIRCUIT: L3-19 PROJECT: TRUCHOICE FCU |   |                    |  |
| RELAY NO                                      | CIRCUIT NO  | NOTE NO            | DESCRIPTION                              |
| 1   | L3-21   | 1                  | DRIVE-THRU ATM LANE CANOPY LIGHTS        |
| 2   | L3-21   | 1                  | DRIVE-THRU CANOPY LIGHTS                 |
| 3   | L3-19   | 1                  | WALL PACKS AND EGRESS LIGHT              |
| 4   | L3-19   | 1                  | SECURE VESTIBULE 101 LIGHTS              |
| 5   | L3-17   | 4                  | LOBBY 102 LIGHTS SWITCH a                |
| 6   | L3-17   | 3                  | LOBBY 102 DN LTS + COVE LTS SWITCH b     |
| 7   | L3-21   | 3                  | LOBBY 102 + TELLER AREA 103 NIGHT LIGHTS |
| 8   | L3-21   | 1                  | LANDSCAPE STEP LIGHTS                    |
| 9   | L3-23   | 1                  | PRIMARY BANK SIGN                        |
| 10  | L3-21   | 1                  | FLAG POLE LIGHTS                         |
| 11  | L3-12   | 1                  | BUILDING MOUNTED BANK SIGN               |
| 12  | L3-21   | 2                  | TELLER AREA LIGHTS SWITCH d              |
| 13  | L3-21   | 2                  | TELLER AREA LIGHTS SWITCH e              |
| 14  | L3-21   | 1                  | PARKING LOT POLE LIGHTS                  |
| 15  |   |                    | SPARE                                    |
| 16  |   |                    | SPARE                                    |
| 17  |   |                    | SPARE                                    |
| 18  |   |                    | SPARE                                    |
| 19  |   |                    | SPARE                                    |
| 20  |   |                    | SPARE                                    |
| 21  |   |                    | SPARE                                    |
| 22  |   |                    | SPARE                                    |
| 23  |   |                    | SPARE                                    |
| 24  |   |                    | SPARE                                    |
| NOTES:  |   |                    |  |
| 1   | PROGRAM FOR AUTO-ON/AUTO-OFF TIME CONTROL - COORDINATE TIME WITH OWNER  |                    |  |
| 2   | PROGRAM FOR MANUAL ON AUTO OFF - COORDINATE TIME WITH OWNER   |                    |  |
| 3   | PROGRAM FOR AUTO-ON/AUTO-OFF TIME CONTROL WITH MANUAL ON/OFF OVERRIDE VIA SWITCH LOCATED IN TELLER AREA.  |                    |  |
| 4   | DURING OCCUPIED HOURS PHOTOCCELL SHUTS LIGHTING OFF WHEN AVERAGE ILLUMINATION AT 30 INCHES AFF IS ABOVE 70FC AND TURNS LIGHTING ON WHEN AVERAGE ILLUMINATION AT 30 INCHES AFF DROPS BELOW 40FC. PROVIDE MANUAL ON/OFF OVERRIDE VIA SWITCH LOCATED IN TELLER AREA. |                    |  |

| LUMINAIRE SCHEDULE |   |                    |                                    |                         |       |                 |          |                 |           |
|--------------------|---|--------------------|------------------------------------|-------------------------|-------|-----------------|----------|-----------------|-----------|
| TYPE               | DESCRIPTION   | MFR                | CATALOG SERIES NUMBER SEE NOTE 1   | MOUNTING                | VOLTS | LAMP            |          |                 | KEY NOTES |
|                    |   |                    |                                    |                         |       | QTY PER FIXTURE | WATTS    | TYPE            |           |
| L1                 | 2x4 VOLUMETRIC LED GRID TROFFER   | LITHONIA           | 2VTL4-48L-ADP-D47-LP835            | RECESSED                | MVOLT | -               | 47       | LED ARRAY 3500K |           |
| L2                 | 6" ROUND DOWNLIGHT, ENERGY STAR RATED   | JUNO               | 1IC922LEDG3-35K-1-27C-WH           | RECESSED                | 120   | -               | 15       | LED ARRAY 3500K |           |
| L3                 | 6" SQUARE DOWNLIGHT, DRIVE-UP CANOPY  | PRESCOLITE         | LF6SQLED8-6SQLED8-35K-CL           | RECESSED                | 120   | -               | 46       | LED ARRAY 3500K |           |
| L4                 | 4" ROUND DOWNLIGHT, ENERGY STAR RATED   | JUNO               | IC1LED3G-35K-1-17C-WH              | RECESSED                | 120   | -               | 10.5     | LED ARRAY 3500K |           |
| L5                 | 12" EGRESS LIGHT WITH REMOTE MICRO INVERTER   | LUMINAIRE LIGHTING | AEL-12-10W LED-DP-B2H-TX/SD-EMB20R | EXTERIOR WALL OVER DOOR | 120   | -               | 10       | LED ARRAY 3500K |           |
| L6                 | CONTINUOUS LINEAR LED STRIP LIGHT FOR COVE, 6000 SERIES   | TEMPO INDUSTRIES   | 6312-6-20-35                       | IN COVE                 | 120   | -               | 8.8W/ FT | LED ARRAY 3500K | 7,8       |
| L7                 | INGROUND FLAGPOLE LIGHT WITH DIRECTIONAL SHIELD   | LSI INDUSTRIES     | XG-B-LED-19-350-CW-UE-NFL25-NB-DSB | IN GROUND               | 120   | -               | 23       | LED ARRAY       |           |
| L8                 | PARKING LOT POLE LIGHT, DLC APPROVED  | SPAULDING          | CL1-A-30L-U-5K-5                   | 16' POLE                | 120   | -               | 70       | LED ARRAY       | 9         |
| L8A                | PARKING LOT POLE LIGHT WITH BACKLIGHT CONTROL, DLC APPROVED   | SPAULDING          | CL1-A-30L-U-5K-4-BC                | 14' POLE                | 120   | -               | 70       | LED ARRAY       | 9         |
| L9                 | WALL PACK   | HUBBELL            | LMC-18LUSK                         | WALL 12'                | 120   | -               | 45       | LED ARRAY       | 9         |
| F1                 | 1x4 SURFACE MOUNT   | COLUMBIA           | SM14-228-FS-A19-EP-U               | CEILING SURFACE         | 120   | 2               | 28       | T5 3500K        |           |
| O/C                | OPEN/CLOSED LANE SIGN   | SIGNAL-TECH        | 5887 (TCL718GR-100)                | CANOPY FASCIA           | 120   | -               | 4        | LED ARRAY       | 3         |
| ATM                | ATM LANE SIGN   | SIGNAL-TECH        | 5863 (TCL718GR-125)                | CANOPY FASCIA           | 120   | -               | 4        | LED ARRAY       | 3         |
| X                  | BLACK UNIVERSAL FACE EXIT SIGN WITH INTEGRAL BATTERY, RED LETTERS   | DUAL LITE          | LXJR-B-E-I                         | SEE PLANS               | 120   | -               | 3.8      | LED ARRAY       | 4         |
| NOTES:             |   |                    |                                    |                         |       |                 |          |                 |           |
| 1                  | NOTE THAT THESE NUMBERS ARE NOT COMPLETE CATALOG #S. PROVIDE ALL REQUIREMENTS ON SCHEDULE, NOTES, SPECS, AND DRAWINGS COMBINED.   |                    |                                    |                         |       |                 |          |                 |           |
| 2                  | CATALOG SERIES NUMBERS ARE USED TO ESTABLISH A LEVEL OF QUALITY AND NOT INTENDED TO LIMIT COMPETITION. SERIES NUMBERS ARE NOT COMPLETE CATALOG NUMBERS. COMPLY WITH ADDITIONAL REQUIREMENTS IN SPECIFICATIONS AND DRAWINGS.                         |                    |                                    |                         |       |                 |          |                 |           |
| 3                  | PROVIDE TRIPLE GANG SWITCH #TG332 WITH (2) SINGLE POLE/DOUBLE THROW SWITCHES FOR OPEN/CLOSED SIGNS, AND (1) ON/OFF SWITCH FOR CONTROL OF ATM SIGN   |                    |                                    |                         |       |                 |          |                 |           |
| 4                  | PROVIDE WALL, CEILING, OR PENDANT MOUNTING AS INDICATED ON PLANS. PROVIDE NUMBER OF FACES AND ARROWS AS INDICATED.  |                    |                                    |                         |       |                 |          |                 |           |
| 5                  | PROVIDE PROGRAMMED START BALLAST WITH ROOMS THAT HAVE OCCUPANCY SENSORS.  |                    |                                    |                         |       |                 |          |                 |           |
| 6                  | VERIFY CEILING STRUCTURE AND MOUNTING HEIGHT PRIOR TO ORDERING ANY LIGHT FIXTURES.  |                    |                                    |                         |       |                 |          |                 |           |
| 7                  | FIELD DIMENSION COVE LIGHTING PRIOR TO ORDERING TO ENSURE PROPER FIXTURE LENGTHS. NOTIFY ARCHITECT OF ANY DISCREPANCIES IN LENGTHS SHOWN ON DRAWINGS AND ACTUAL FIELD DIMENSIONS. ADJUST LENGTHS OF ANY SPECIFIED FIXTURE AS DIRECTED BY ARCHITECT. |                    |                                    |                         |       |                 |          |                 |           |
| 8                  | PROVIDE POWER SUPPLIES, CONNECTORS, ETC TO CREATE A CONTINUOUS COVE LIGHT.  |                    |                                    |                         |       |                 |          |                 |           |
| 9                  | FINISH BY ARCHITECT FROM MANUFACTURER'S STANDARD FINISHES   |                    |                                    |                         |       |                 |          |                 |           |

