

GENERAL NOTES

- THE FOLLOWING NOTES ARE INTENDED TO BE USED AS OUTLINED SPECIFICATIONS FOR THIS PROJECT. THE REFERENCED STANDARDS ARE CONSIDERED TO BE PART OF THE WORK.
- CONSULT OWNER FOR LOCATIONS AND DIMENSIONS OF OPENINGS, CHASES, INSERTS, REGLETS, SLEEVES, DEPRESSIONS, AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
- ALL DIMENSIONS AND CONDITIONS MUST BE VERIFIED IN THE FIELD. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT BEFORE PROCEEDING WITH THE AFFECTED PART OF THE WORK.
- THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE ONLY AFTER THE STRUCTURAL WORK CONTAINED IN THE STRUCTURAL DRAWINGS IS COMPLETED. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCE TO ENSURE THE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE ADDITION OF NECESSARY SHORING, SHEETING, TEMPORARY BRACING, BUYS OR TIEDOWNS. SUCH MATERIAL SHALL REMAIN THE PROPERTY OF THE CONTRACTOR AFTER COMPLETION OF THE PROJECT.
- SECTIONS AND DETAILS SHOWN ON ANY STRUCTURAL DRAWINGS SHALL BE CONSIDERED TYPICAL FOR SIMILAR CONDITIONS AS DETERMINED BY THE ENGINEER.
- ALL APPLICABLE FEDERAL, STATE, AND MUNICIPAL REGULATIONS SHALL BE FOLLOWED, INCLUDING THE FEDERAL DEPARTMENT OF LABOR OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA).

DESIGN LOADS

- BUILDING CODE: MAINE UNIFORM BUILDING AND ENERGY CODE, INTERNATIONAL RESIDENTIAL CODE, 2009 EDITION ASCE 7-05 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES.
- DESIGN FLOOR LIVE LOADS: 125 PSF
LIGHT STORAGE

FOUNDATION NOTES (SOIL SUPPORTED)

- FOUNDATION DESIGN IS BASED ON SHALLOW SPREAD FOOTINGS BEARING ON SUITABLE UNDISTURBED NATIVE SOILS AND/OR NEW COMPACTED STRUCTURAL FILL EXTENDING TO UNDISTURBED NATIVE SOIL.
- IT IS THE CONTACTOR'S SOLE RESPONSIBILITY TO VERIFY EXISTING SOIL CONDITIONS AND TO BRING ANY DISCREPANCIES TO THE ATTENTION OF THE STRUCTURAL ENGINEER PRIOR TO COMMENCING PLACEMENT OF FOUNDATIONS. SOIL VERIFICATION & ASSOCIATED RECOMMENDATIONS WILL BE BY A GEOTECHNICAL ENGINEER, ENGAGED BY OWNER.
- PRESUMPTIVE BEARING CAPACITY OF 3000 PSF.
- EXTEND BOTTOM OF EXTERIOR FOOTINGS AT LEAST 4 FEET BELOW THE FINAL EXTERIOR GRADE FOR PROTECTION AGAINST FROST.
- ALL PAVEMENT, EXISTING FOUNDATIONS AND UNCONTROLLED GRANULAR FILL SHALL BE REMOVED FROM THE AREA OF THE PLANNED FOUNDATION TO AT LEAST 4 FEET BEYOND THE FOOTING LIMIT.
- COMPACTED STRUCTURAL FILL SHALL BE USED TO BACKFILL TO THE DESIGN FOOTING SUBGRADE AND BENEATH ALL SLABS ON GRADE. STRUCTURAL FILL SHALL BE A CLEAN SAND-GRAVEL MIXTURE MEETING THE FOLLOWING GRADATION:

SCREEN OR SIEVE SIZE	PERCENT PASSING
6 INCH	100
3 INCH	90-100
1/4 INCH	25-90
NO. 40	0-30
NO. 200	0-5
- STRUCTURAL FILL SHALL BE PLACED IN UNIFORM LIFTS NOT EXCEEDING 8 INCHES IN LOOSE THICKNESS AND SHALL BE COMPACTED TO 95 PERCENT OF MAXIMUM DRY DENSITY PER ASTM D1557, MODIFIED PROCTOR TEST. COMPACT ADJACENT TO FOUNDATION WALLS SUPPORTING UNBALANCED FILL (RETAINING WALLS) TO 94 TO 96 PERCENT OF MAXIMUM DRY DENSITY PER ASTM D1557. HAND OPERATED EQUIPMENT SHALL BE USED FOR COMPACTION WITHIN 8 FEET OF NEW FOUNDATION WALL.
- SOILS EXPOSED AT THE BASE OF ALL SATISFACTORY FOUNDATION EXCAVATIONS SHALL BE PROTECTED AGAINST ANY DETRIMENTAL CHANGE IN CONDITION, SUCH AS DISTURBANCE FROM RAIN OR FROST. SURFACE RUNOFF SHALL BE DRAINED AWAY FROM THE EXCAVATIONS SHALL BE ADEQUATELY PROTECTED FROM RAINFALL OR FREEZING CONDITIONS. GROUNDWATER SHALL BE ANTICIPATED FOR EXCAVATIONS AND APPROPRIATE DEWATERING MEASURES SHALL BE EMPLOYED.
- SLOPE FOOTING EXCAVATIONS AS REQUIRED FOR STABILITY AND SAFETY IN ACCORDANCE WITH OSHA REQUIREMENTS. PROVIDE SHEETING OR SHORING IN ACCORDANCE WITH OSHA GUIDELINES. BRACED EXCAVATIONS SHALL BE DESIGNED BY A PROFESSIONAL ENGINEER REGISTERED IN THE STATE OF MAINE.

REBAR LAP SPLICE TABLE

BAR SIZE	LAP LENGTH	
	3,000 PS1	5,000 PS1
#4	36"	32"
#5	48"	42"

CONCRETE NOTES


- CONCRETE WORK SHALL CONFORM TO "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE (ACI 318 LATEST)", AND "SPECIFICATIONS FOR STRUCTURAL CONCRETE (ACI 301-LATEST)". THESE PUBLICATIONS ARE AVAILABLE THROUGH THE AMERICAN CONCRETE INSTITUTE (248) 848-3800.
- GENERAL CONTRACTOR, CONSTRUCTION MANAGER AND/OR OWNER'S CLERK OF THE WORKS SHALL HAVE AVAILABLE ON SITE AT ALL TIMES A COPY OF ACI "FIELD REFERENCE MANUAL SP-15 (LATEST)". THIS PUBLICATION IS AVAILABLE THROUGH THE AMERICAN CONCRETE INSTITUTE (248) 848-3800.
- CONCRETE SHALL BE CONTROLLED CONCRETE, PROPORTIONED, MIXED, AND PLACED IN ACCORDANCE WITH THE PROVISIONS SET FORTH IN ACI 318-LATEST.
- CONCRETE MIX DESIGN:**
FOOTINGS AND FOUNDATION WALLS:
A. STRENGTH: 3000 PSI @ 28 DAYS
B. AGGREGATE: 3/4"
C. W/C RATIO: 0.55 MAX
D. ENTRAINED AIR: 5% TO 7%
E. SLUMP: 4" MAX
EXTERIOR SLABS ON GRADE:
A. STRENGTH: 5000 PSI @ 28 DAYS
B. AGGREGATE: 3/4"
C. W/C RATIO: 0.45 MAX
D. ENTRAINED AIR: 5% TO 7%
E. SLUMP: 4" MAX
NOTE:
A. ADD AIR ENTRAINING ADMIXTURE AT MANUFACTURER'S PRESCRIBED RATE TO RESULT IN CONCRETE AT POINT OF PLACEMENT HAVING THE ABOVE NOTED AIR CONTENT.
B. ADDITIONAL SLUMP MAY BE ACHIEVED BY THE ADDITION OF A MIDRANGE OR HIGH RANGE WATER REDUCING ADMIXTURE. MAXIMUM SLUMP AFTER ADDITION OF ADMIXTURE SHALL BE 6 INCHES AND 8 INCHES RESPECTIVELY.
- ADJUSTMENT TO CONCRETE MIXES: MIX ADJUSTMENTS MAY BE REQUESTED BY THE CONTRACTOR, WHEN CHARACTERISTICS OF THE MATERIALS, JOB CONDITIONS, WEATHER OR OTHER CIRCUMSTANCES WARRANT, AT NO ADDITIONAL COST TO THE OWNER AS ACCEPTED BY THE ARCHITECT. LABORATORY TEST DATA FOR THE REVISED MIX DESIGN AND STRENGTH DATA MUST BE SUBMITTED AND ACCEPTED BY THE ARCHITECT BEFORE INCORPORATING INTO THE WORK.
NOTE:
A. WATER MAY BE ADDED AT THE PROJECT ONLY IF THE MAXIMUM SPECIFIED WATER-CEMENT RATIO AND SLUMP ARE NOT EXCEEDED. CONTRACTOR SHALL HAVE BATCH TICKET INDICATING WATER AND CEMENT MIXED IN THE PLANT, AND SHALL RECORD THE WATER ADDED AS EVIDENCE THAT THE WATER-CEMENT RATIO HAS NOT BEEN EXCEEDED.
B. ADDITIONAL DOSES OF SUPER PLASTICIZER SHOULD BE USED WHEN DELAYS OCCUR AND REQUIRED SLUMP HAS NOT BEEN MAINTAINED. A MAXIMUM OF TWO ADDITIONAL DOSAGES ARE PERMITTED PER ACI 212.3R RECOMMENDATIONS.
- CONCRETE MIXING:
A. JOB-SITE MIXING OF CONCRETE WILL NOT BE PERMITTED.
B. READY-MIX CONCRETE MUST COMPLY WITH THE REQUIREMENTS OF ASTM C94, AND AS SPECIFIED HEREIN. PROVIDE BATCH TICKET FOR EACH BATCH DISCHARGED AND USED IN WORK, INDICATING PROJECT NAME, MIX TYPE, MIX TIME, BATCH QUANTITY, AND PROPORTIONS OF INGREDIENTS.
- CONCRETE SHALL NOT BE PLACED IN WATER OR ON FROZEN GROUND.
- PROVIDE PVC SLEEVES WHERE PIPES PASS THROUGH EXTERIOR CONCRETE OR SLABS CAST ON GRADE. ADJACENT SLEEVES SHALL BE SPACED A MINIMUM OF THREE DIAMETERS APART. NO PENETRATIONS SHALL BE MADE THROUGH FOOTINGS WITHOUT WRITTEN PERMISSION FROM ENGINEER.
- REINFORCING BARS SHALL CONFORM TO ASTM A615 GRADE 60 DEFORMED BARS AND SHALL BE DETAILED, FABRICATED AND PLACED IN ACCORDANCE WITH ACI 315, LATEST EDITION.
- MINIMUM CONCRETE PROTECTIVE COVERING FOR REINFORCEMENT, UNLESS NOTED OTHERWISE, SHALL BE AS FOLLOWS:
A. SURFACES CAST AGAINST AND PERMANENTLY IN CONTACT WITH EARTH, 3.0"
B. FORMED SURFACES IN CONTACT WITH EARTH OF EXPOSED TO WEATHER #5 BARS, 5/8" DIAMETER WIRE, AND SMALLER, 1.5"
- REINFORCEMENT SHALL BE CONTINUOUS AROUND CORNERS AND AT INTERSECTIONS. PROVIDE LAPPED BARS AT NECESSARY SPLICES OR HOOKED BARS AT DISCONTINUOUS ENDS. SEE SCHEDULE S2.0 FOR REQUIRED REBAR LAP SPLICE LENGTHS.
- WELDING OF REINFORCEMENT IS NOT PERMITTED.
- FOR ALL OPENINGS IN CONCRETE WALLS AND SLABS, PROVIDE SUPPLEMENTAL REINFORCING AROUND OPENING AS SHOWN ON THE CONTRACT DOCUMENTS TYPICAL DETAILS.
- PROVIDE A MIN. 15 MIL. POLYOLEFIN GEOMEMBRANE TYPE VAPOR BARRIER UNDER INTERIOR SLABS. CAST ON GRADE. SEE TYPICAL DETAILS FOR SPECIFIC UNDERSLAB PREPARATION REQUIREMENTS.
- CONTRACTION/CONTROL JOINTS SHOWN ON DRAWINGS ARE MANDATORY. OMISSIONS, ADDITIONS, OR CHANGES SHALL NOT BE MADE EXCEPT WITH THE SUBMITTAL OF A WRITTEN REQUEST TOGETHER WITH DRAWINGS OF THE PROPOSED JOINT LOCATIONS FOR APPROVAL BY THE STRUCTURAL ENGINEER.
- CONCRETE SHALL BE PLACED WITHOUT HORIZONTAL CONSTRUCTIONS JOINTS EXCEPT WHERE SHOWN OR NOTED.
- ANCHOR RODS SHALL BE 5/8" DIAMETER HEADED RODS CONFORMING TO ASTM A 307, GRADE 36 KSJ WELDABLE STEEL, UNLESS NOTED OTHERWISE ON THE DRAWINGS. ANCHOR RODS THAT ARE TO BE IN CONTACT WITH PRESSURE TREATED LUMBER SHALL BE HOT-DIPPED GALVANIZED.
- INSTALLATION OF REINFORCEMENT SHALL BE COMPLETE AT LEAST 24 HOURS PRIOR TO THE SCHEDULED CONCRETE PLACEMENT. NOTIFY ARCHITECT AND STRUCTURAL ENGINEER OF COMPLETION AT LEAST 24 HOURS PRIOR TO THE SCHEDULED COMPLETION OF THE INSTALLATION OF REINFORCEMENT.

STRUCTURAL STEEL NOTES


- STRUCTURAL STEEL FABRICATION, ERECTION, AND CONNECTION DESIGN SHALL CONFORM TO AISC "SPECIFICATION FOR THE DESIGN FABRICATIONS, AND ERECTION OF STRUCTURAL STEEL" 13TH EDITION, AND THE "CODE OF STANDARD PRACTICE", LATEST EDITION.
- STRUCTURAL STEEL: STEEL PLATES, SHAPES, AND BARS, SHALL CONFORM TO ASTM A36 UNLESS NOTED OTHER WISE (U.N.O.). STRUCTURAL STEEL SHAPES DESIGNATED ON THE DRAWINGS FOR WIDE-FLANGE SECTIONS: ASTM A992 (ASTM A572 GRADE 50 WITH SPECIAL REQUIREMENTS PER AISC TECHNICAL BULLETIN #3 DATED MARCH, 1997)
- WHERE WELDING IS INDICATED, ALL WELDING SHALL CONFORM TO AWS D1.1-LATEST EDITION. ELECTRODES SHALL CONFORM TO AWS A5.1 E70XX SERIES WITH PROPER ROD TO PRODUCE OPTIMUM WELD (LOW HYDROGEN)
- ALL STEEL SHALL BE FABRICATED AND SHIPPED AS PAINTED WITH THE FABRICATOR'S RUST INHIBITIVE PRIMER, TNE MEC 10-99 OR EQUAL AND TOP COATED WITH TNE MEC SERIES 2 GLOSS ENAMEL OR HOT DIPPED GALVANIZED AS INDICATED ON THE DRAWINGS.

TESTING


- OWNER WILL ENGAGE A QUALIFIED TESTING AGENCY TO CONDUCT PERIODIC TESTS TO CONFIRM CONSTRUCTION IS IN CONFORMANCE WITH SPECIFIED PROCEDURES AND SPECIFICATIONS.
- TESTING SHALL INCLUDE STRUCTURAL FILL GRADATION AND COMPACTION CONCRETE SLUMP, TEMPERATURE, AIR CONTENT AT POINT OF PLACEMENT CONCRETE COMPRESSION TESTS

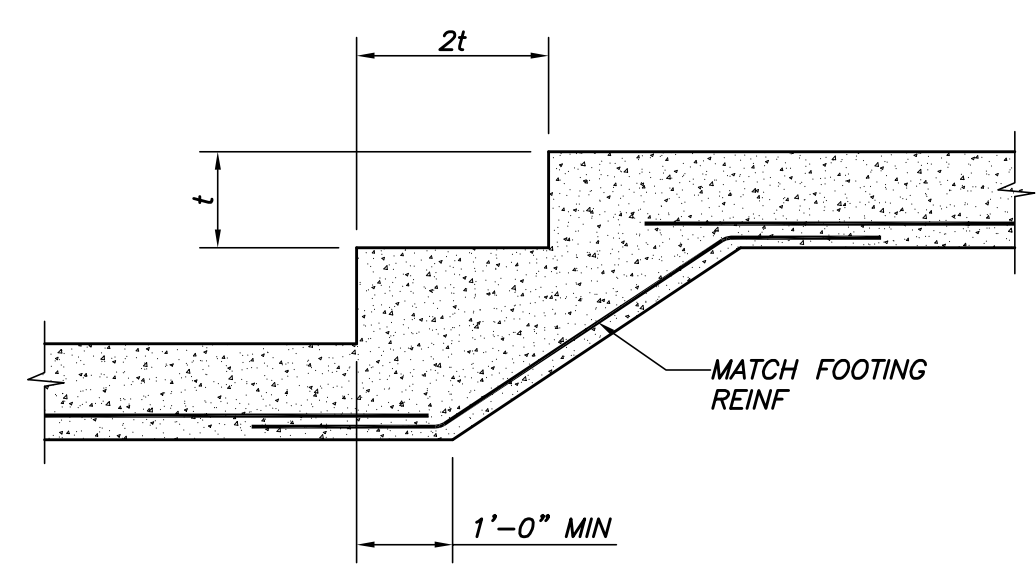


TYP STEP FOOTING DETAIL
N.T.S. t = FOOTING THICKNESS

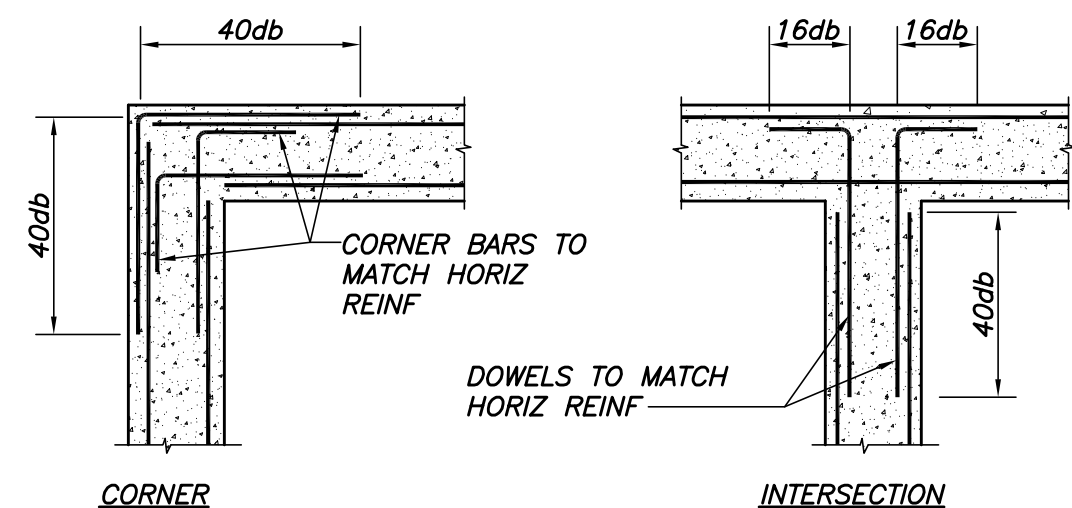

TYP WALL REINF DETAILS
N.T.S.

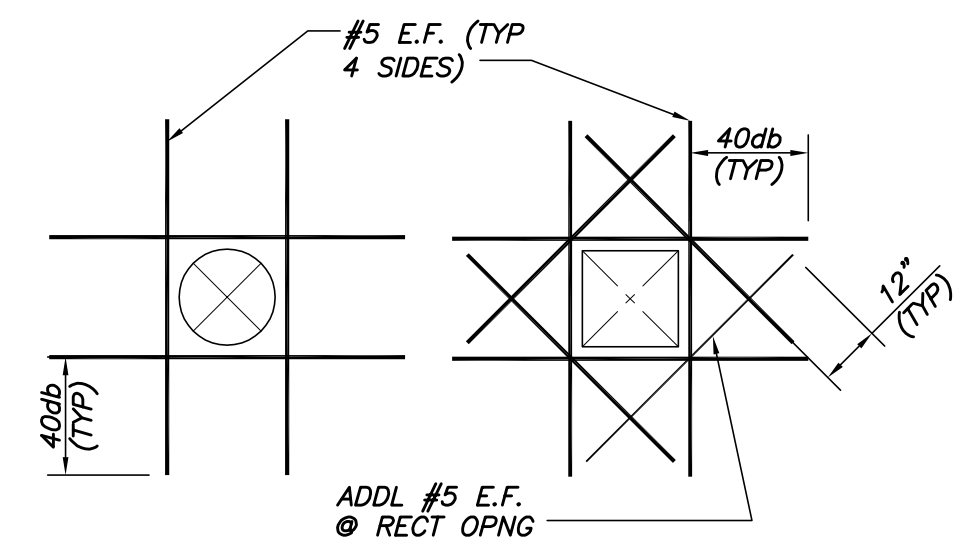

TYP OPENING IN WALL OR SLAB DETAIL
N.T.S.

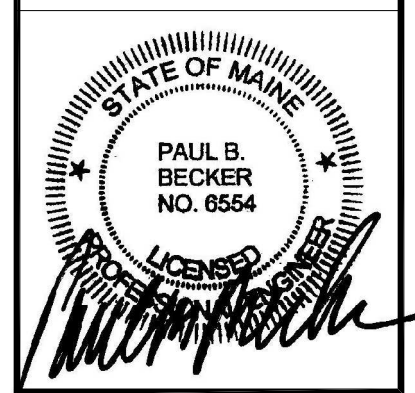

Appr	
Issued For	
Date	
Rev No	

N8 BLDG-EXTERIOR SLABS
 HP HOOD INC., PORTLAND, ME
 GENERAL NOTES & TYP DETAILS

Designed	DSB	Scale	NOTED
Drawn	MSK	Date	7/20/12
Checked	DSB	Becker Job Number	2805

S1.1

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND SHALL REMAIN THE PROPERTY OF BECKER STRUCTURAL ENGINEERS INC. IT SHALL NOT BE REPRODUCED, COPIED, LENT OR DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SPECIFICALLY FURNISHED AND MUST BE RETURNED TO BECKER STRUCTURAL ENGINEERS INC. ON COMPLETION OF WORK, IF REQUESTED.