



Secondary Power Requirements

Typical HPFF8 Power Supply **Calculated at Maximum**

Protected Premises: <u>Nathan Clifford School Redevelopment</u>	Date: <u>3/27/2014</u>
Address: <u>180 Falmouth Street</u>	
City: <u>Portland</u> State: <u>Maine</u>	Zip: <u>04101</u>
Prepared By: <u>BK Systems, Inc.</u>	Phone: <u>603-647-8775</u>
Address: <u>4 Cote Avenue</u>	Email: nikw@bksystemsinc.com
City: <u>Goffstown</u> State: <u>New Hampshire</u>	Zip: <u>03045</u>

Secondary Load Requirements 7.00 Amp Hours

Total Secondary Load from the calculation table below.

Current Draw		Time (hours)	Total (AH)
Secondary Standby Load 0.075 A	x	Required Standby Time 60 hours	4.50
Secondary Alarm Load 8.000 A	x	Required Alarm Time (hours) 0.167 hours	1.34
Total Secondary Load			5.84
Derating factor			x 1.2
Secondary Load Requirements			7.00 AH

Battery Selection 12 Amp Hours


Select batteries from the list below.

12 AH BAT-12120 Battery (12 volt)

- Two
- Four (two 12VDC sets in parallel)

Battery Distribution Chart

Shows amp-hour distribution of your selections.

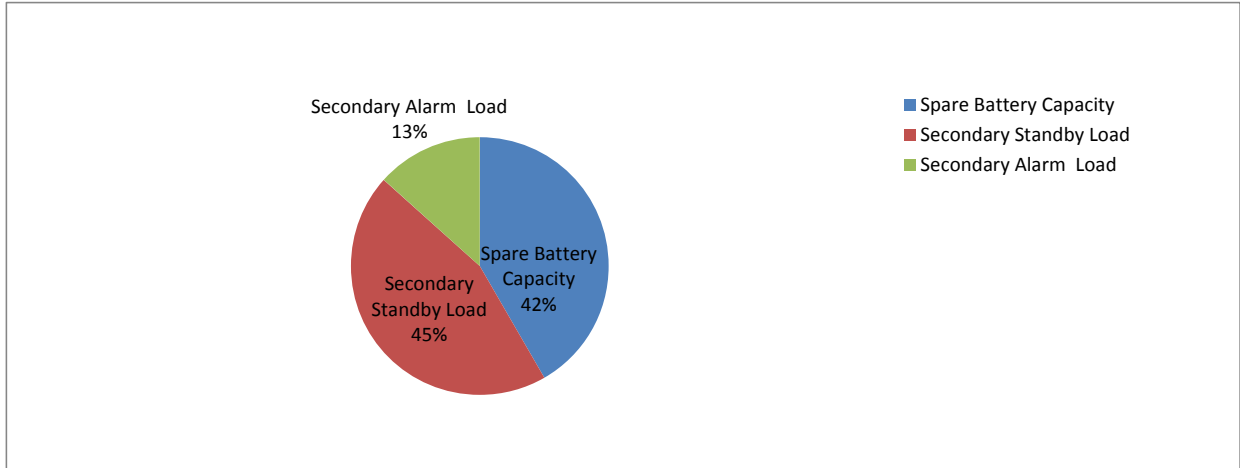

Comments

1. Batteries will fit in the FACP cabinet.
2. Selected battery size meets secondary load requirements.
3. The selected batteries (12AH) are within the charger range of this power supply (7-26AH).

Spare Battery Capacity	5.00	Battery Selection (AH) - Secondary Load Requirements (AH)
Secondary Standby Load	5.40	Secondary Standby Load (AH) * Derating Factor
Secondary Alarm Load	1.60	Secondary Alarm Load (AH) * Derating Factor