



31 Frederic St.
Entry Stair Details
□ = 2"

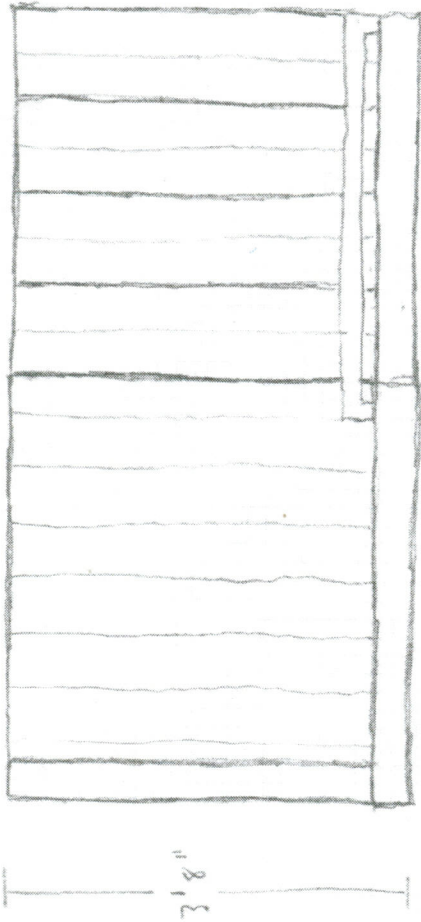

Per Section 1013.2 Guards provide height and opening limitations per code.

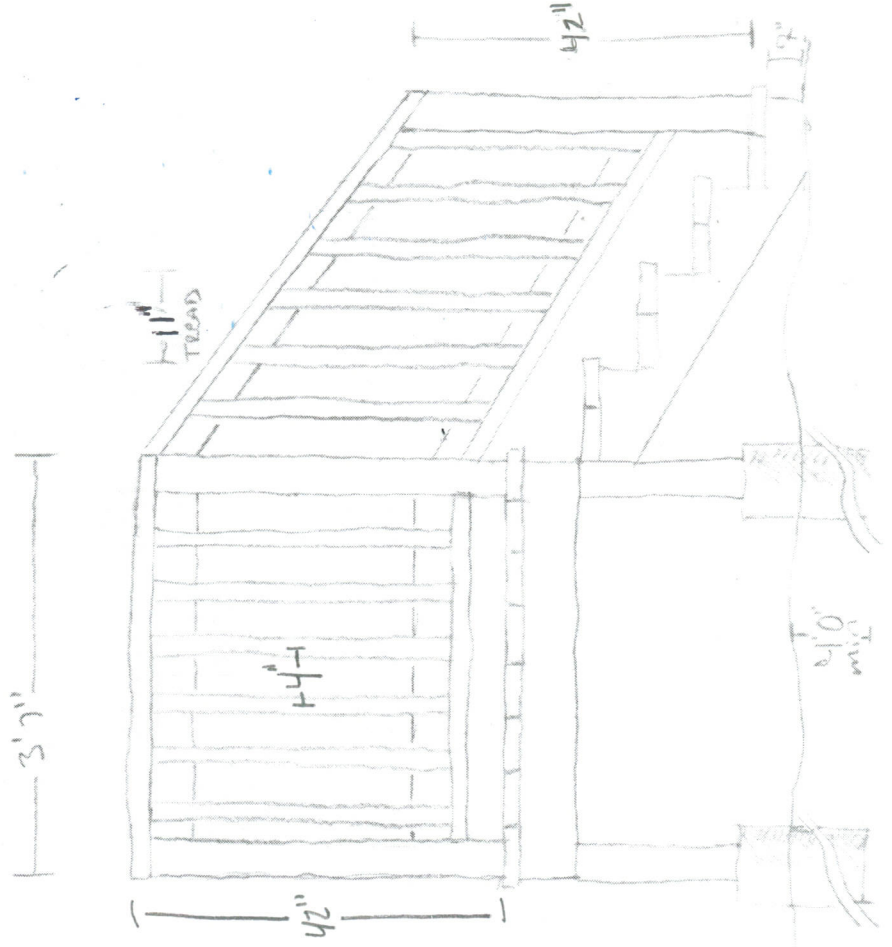

Per Section 1009 of the IBC, the minimum tread depth shall be 11". Please revise to meet code.

Provide framing plan for deck including size and spacing of joists and attachment connection to the house.