FIELD SPLICES MUST BE LOCATED AT LEAST
6 INCHES OUTSIDE THE DRAIN SUMP

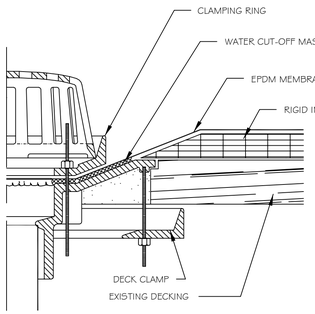



NOTES:

1. REMOVE ALL LEAD AND OTHER FLASHING.
2. ALL BOLTS OR CLAMPS MUST BE IN PLACE TO PROVIDE CONSTANT COMPRESSION ON WATER CUT-OFF MASTIC.
3. CUT THE MEMBRANE SO IT EXTENDS A MINIMUM OF 1/2" (13 mm) FROM THE ATTACHMENT POINTS OF THE DRAIN CLAMPING RING.
4. HOLE IN MEMBRANE MUST EXCEED SIZE OF DRAIN PIPE.
5. INSULATION TAPER SHALL NOT BE STEEPER THAN 6" (150 mm) (VERTICAL) IN 12" (300 mm) (HORIZONTAL).
6. ROOF DRAIN SIZE AND NUMBER OF DRAINS SHALL BE IN ACCORDANCE WITH LOCAL CODES.

C3

C2 DRAIN DETAIL

SCALE: NO SCALE

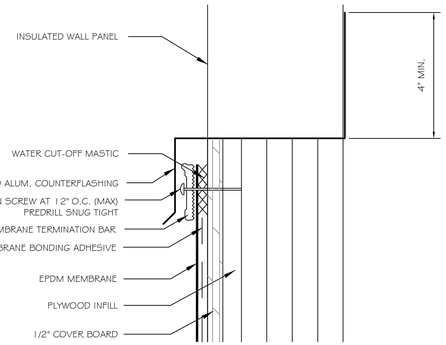

ALLOW 1/4" MIN. TO 1/2" MAX. (6 TO 13 mm) SPACING BETWEEN CONSECUTIVE LENGTHS OF TERMINATION BAR.

NOTES:

1. APPLY ON HARD SMOOTH SURFACE ONLY; NOT FOR USE ON WOOD.
2. WATER CUT-OFF MASTIC MUST BE HELD UNDER CONSTANT COMPRESSION.
3. DO NOT WRAP COMPRESSION TERMINATION AROUND CORNERS.



C1

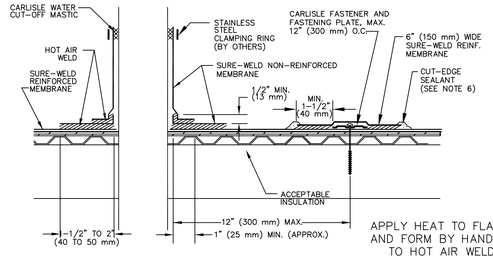

APPLY HEAT TO FLASHING AND FORM BY HAND PRIOR TO HOT AIR WELDING

NOTES:

1. REMOVE ALL LEAD AND OTHER FLASHING BEFORE INSTALLING FIELD FABRICATED PIPE SEAL.
2. TEMPERATURE OF PIPE MUST NOT EXCEED 120° F (49° C).
3. SURE-WELD NON-REINFORCED MEMBRANE WRAPPED AROUND PIPE SHALL HAVE MINIMUM 1-1/2" (40 mm) VERTICAL HOT AIR WELD.
4. INSTALL A MINIMUM OF 4 FASTENING PLATES AROUND PIPES WITH A DIAMETER UP TO 6" (150 mm). ADDITIONAL FASTENING PLATES WILL BE REQUIRED FOR PIPES GREATER THAN 6" IN DIAMETER AND SHALL BE SPACED 12" (300 mm) ON CENTER MAXIMUM.
5. REFER TO "ATTACHMENT I, MEMBRANE FASTENING CRITERIA" FOR PROPER FASTENERS AND PLATES.
6. APPROXIMATELY 1/8" (3 mm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF SURE-WELD REINFORCED MEMBRANE.

OPTIONAL FLASHING



B3

B2 FIELD FABRICATED FLASHING - OPT. #1

SCALE: NO SCALE

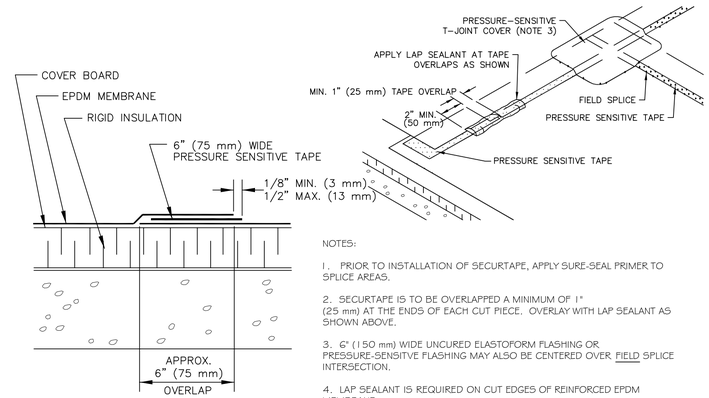

NOTES:

1. PRIOR TO INSTALLATION OF SECURTAPE, APPLY SURE-SEAL PRIMER TO SPLICE AREAS.
2. SECURTAPE IS TO BE OVERLAPPED A MINIMUM OF 1" (25 mm) AT THE ENDS OF EACH CUT PIECE. OVERLAY WITH LAP SEALANT AS SHOWN ABOVE.
3. 6" (150 mm) WIDE UNCURED ELASTOFORM FLASHING OR PRESSURE-SENSITVE FLASHING MAY ALSO BE CENTERED OVER FIELD SPLICE INTERSECTION.
4. LAP SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED EPDM MEMBRANE.

B1 MEMBRANE SPLICE

SCALE: NO SCALE

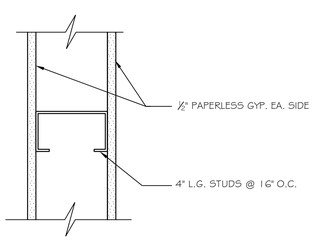

TYP. AT ALL NEW INTERIOR PARTITIONS

A3 NON-RATED PARTITION WALL DETAIL

SCALE: NO SCALE

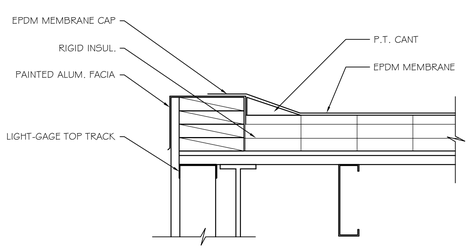

A2 PARAPET CAP FLASHING

SCALE: NO SCALE

FOR USE ON 15 YEAR GOLDEN SEAL WARRANTY PROJECTS. TERMINATION BAR IS NOT REQUIRED ON 5 OR 10 YEAR WARRANTY PROJECTS (REFER TO CARLISLE DETAIL U-9-C).

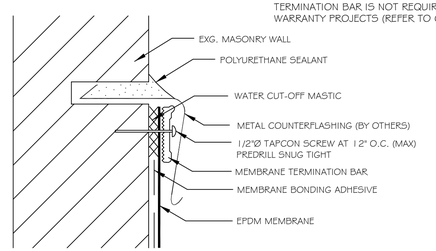

ALLOW 1/4" MIN. TO 1/2" MAX. (6 TO 13 mm) SPACING BETWEEN CONSECUTIVE LENGTHS OF TERMINATION BAR.



NOTES:

1. APPLY ON HARD SMOOTH SURFACE ONLY; NOT FOR USE ON WOOD.
2. WATER CUT-OFF MASTIC MUST BE HELD UNDER CONSTANT COMPRESSION.
3. DO NOT WRAP COMPRESSION TERMINATION AROUND CORNERS.

A1 COUNTER FLASHING DETAIL

SCALE: NO SCALE

STATE OF MAINE
AARON S. WILSON
No. 19429
PROFESSIONAL ENGINEER

ASSOCIATED DESIGN PARTNERS INC.
80 Leighton Road
Falmouth, Maine 04105
Office: (207) 878-1751
Fax: (207) 878-1788
E-Mail: adp@adpengineering.com

THIS DRAWING, DESIGN AND ELECTRONIC FILE ARE THE PROPERTY OF ASSOCIATED DESIGN PARTNERS, INC. THE REPRODUCTION, COPYING OR ANY OTHER USE OF THIS DOCUMENT WITHOUT WRITTEN CONSENT IS PROHIBITED.

PROJECT: BARBER FOODS RENOVATIONS
54-70 SAINT JOHN ST, PORTLAND ME
FOR: BARBER FOODS INC.

SHEET TITLE: ROOFING DETAILS
ISSUED FOR PERMITTING

REVISIONS		
No.	BY	DESCRIPTION	DATE
1			
2			
3			
4			

DATE : 10-28-08
SCALE : AS NOTED
DESIGN BY: ASW
DRAWN BY: RC
FILE #: 08170-A501.DWG
PROJECT NUMBER: 08170
SHEET NO: A501