




CUMBERLAND COUNTY
CORRECTION FACILITY

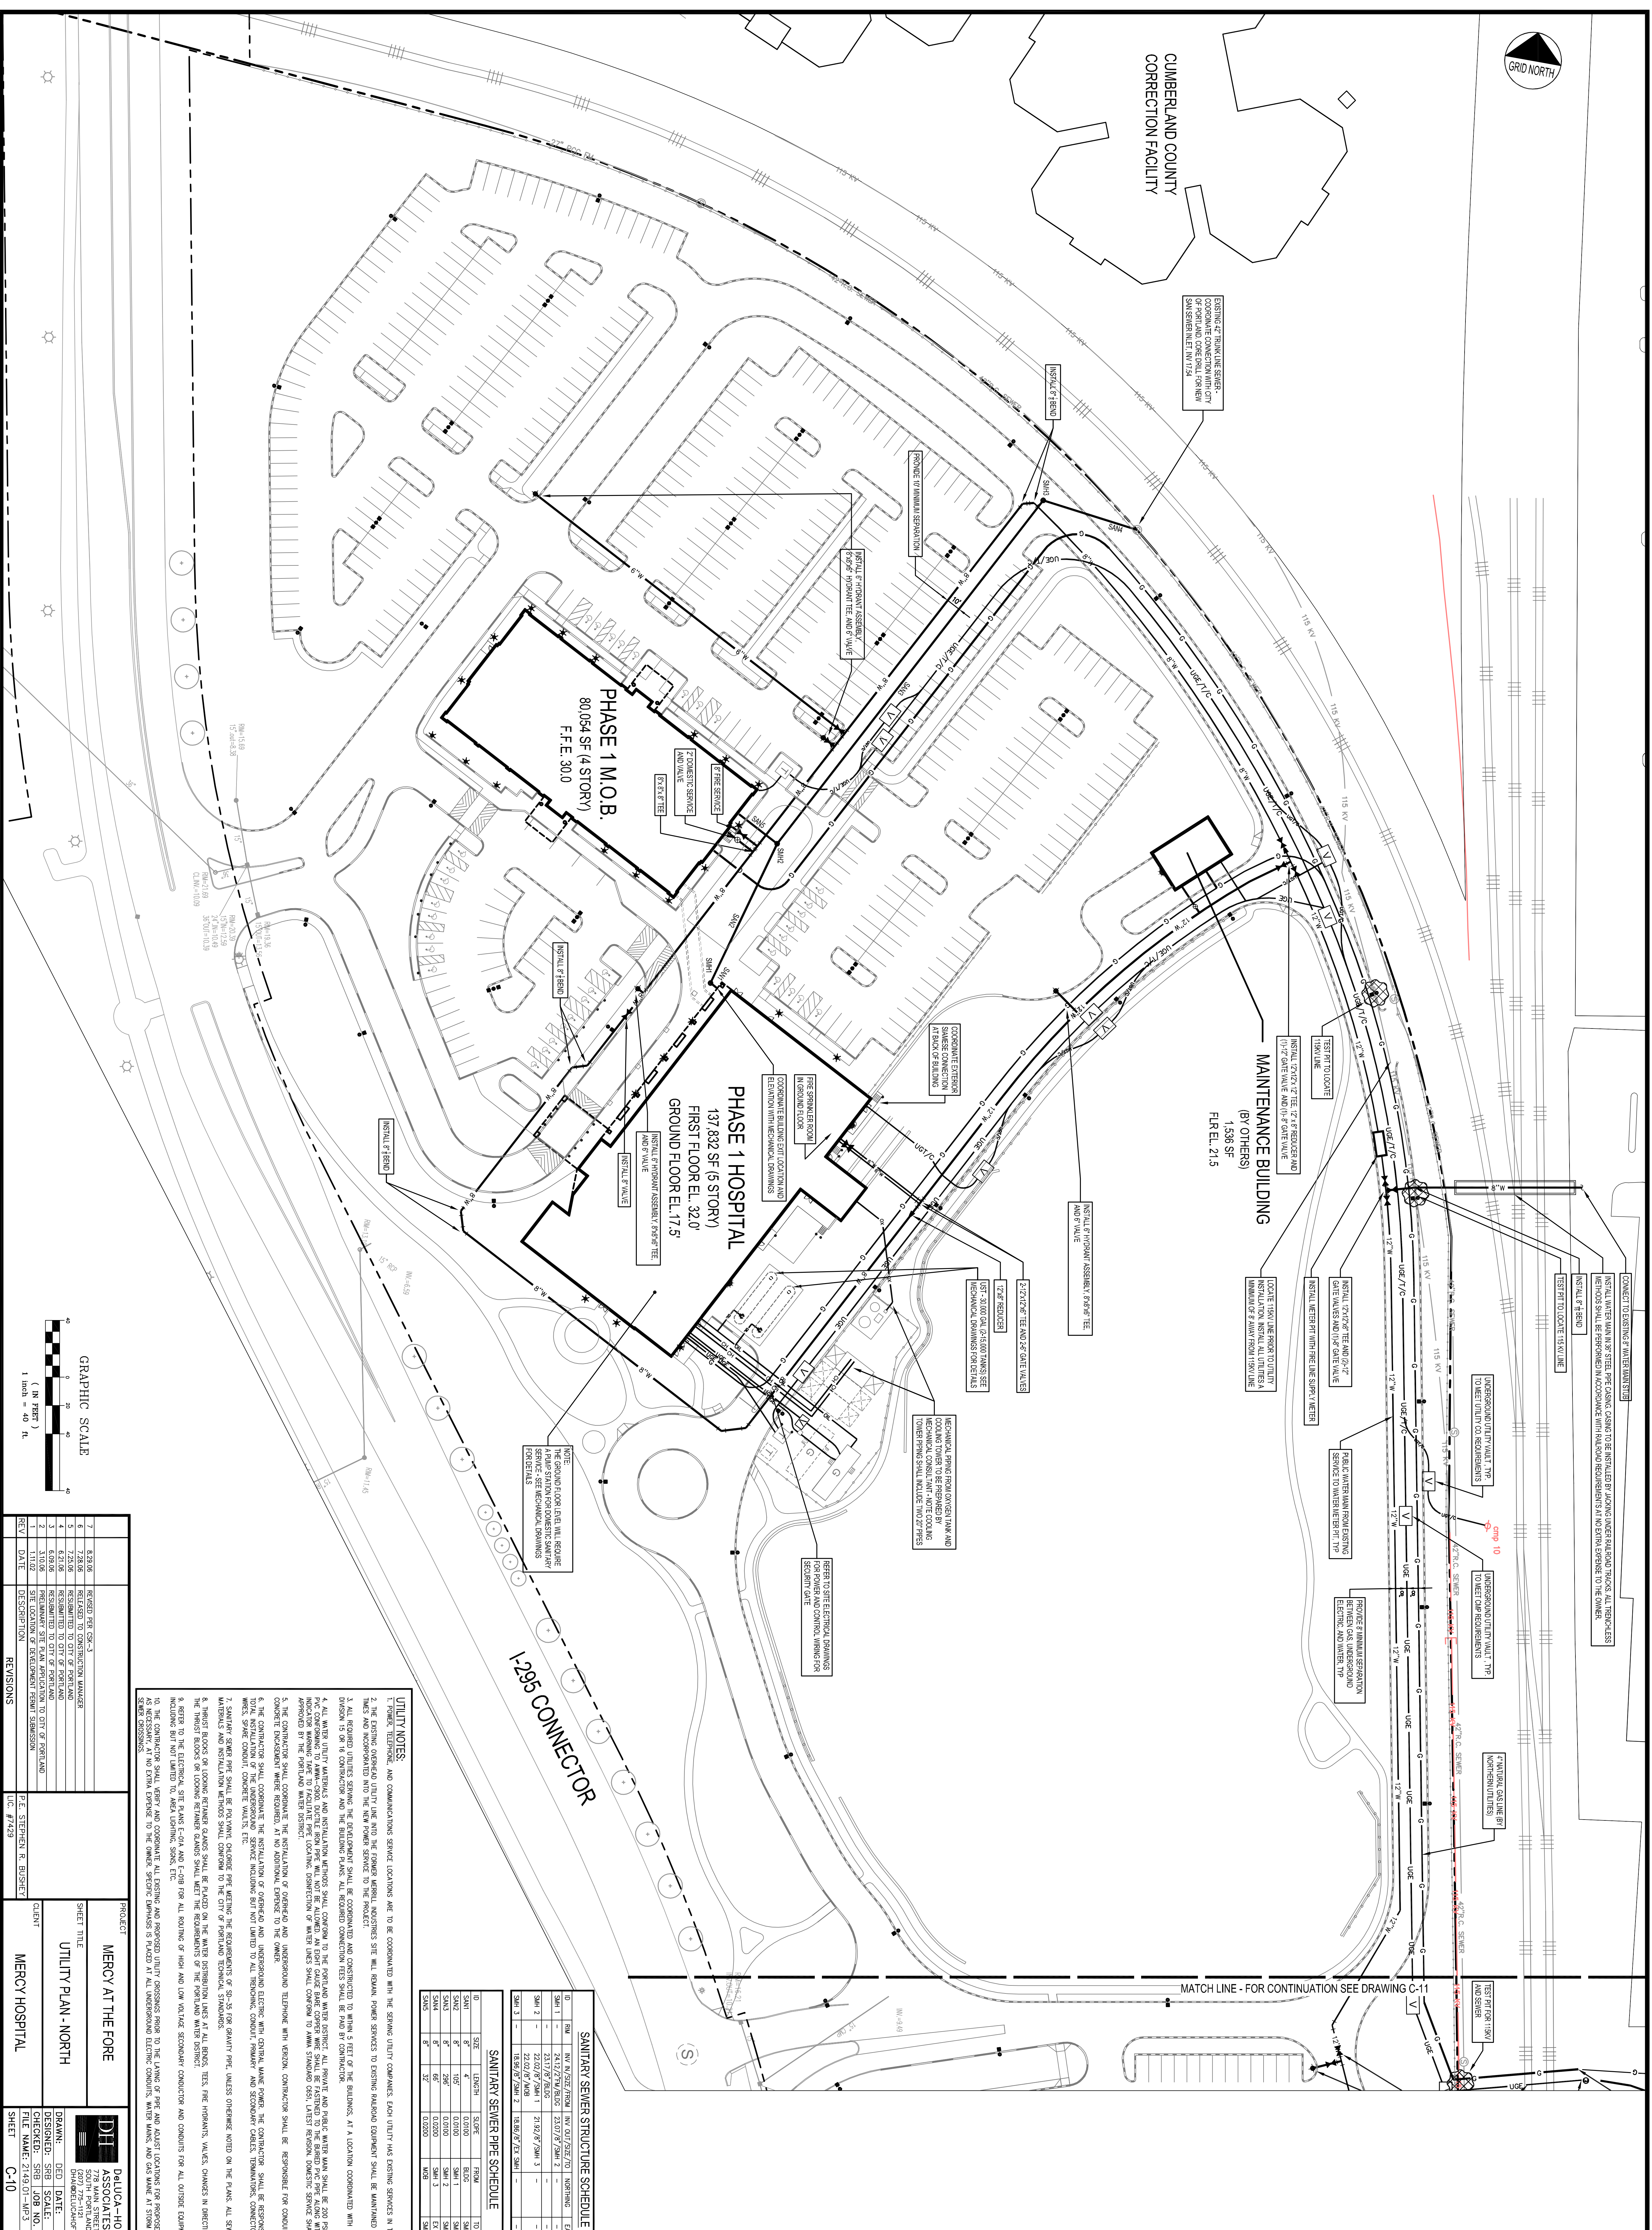

EXISTING 42" TRUNKLINE SEWER -
COORDINATE CONNECTION WITH CITY
SANITARY MAIN (15' DIA)

PROVIDE 6" MINIMUM SEPARATION

INSTALL 8" HORIZONTAL ASSEMBLY
8" DIA. HORIZONTAL AND 2" VALVE

PHASE 1 M.O.B.
80,054 SF (4 STORY)
F.F. EL. 30.0

PHASE 1 HOSPITAL
137,832 SF (6 STORY)
FIRST FLOOR EL. 32.0'
GROUND FLOOR EL. 17.5'

MAINTENANCE BUILDING
(BY OTHERS)
1,536 SF
F.LR EL. 21.5

CONNECT TO EXISTING WATER MAINS
INSTALL WATER MAIN 36" STEEL PIPE CLASSIC COATING TO BE INSTALLED BY JACKING UNDER EXISTING TRENCHES. ALL TRENCHLESS
METHODS SHALL BE PERFORMED IN ACCORDANCE WITH RAILROAD REQUIREMENTS AT THE OWNER'S EXPENSE TO THE OWNER.

INSTALL 12" HORIZONTAL
TEST FIT TO LOCATE 15' TO 20' LINE

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

UNDERGROUND UTILITY VAULT TYPE
TO MEET UTILITY CO. REQUIREMENTS

MATCH LINE - FOR CONTINUATION SEE DRAWING C-11

I-295 CONNECTOR

NO.	SIZE	LENGTH	SCOPES	FROM	TO
SM1	12"	24.12/8'	REAR OF SITE TO	NORTH	EXISTING
SM2	12"	23.17/8'	REAR OF SITE TO	NORTH	EXISTING
SM3	8"	22.02/8'	SM1	SM2	
SM4	8"	22.02/8'	SM1	SM3	
SM5	8"	18.56/8'	SM2	SM3	
SM6	8"	6'	MOB	SM2	

UTILITY NOTES:
1. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF PORTLAND AND THE PORTLAND WATER DEPARTMENT.
2. ALL UTILITIES SHALL BE DEPTH MARKED AND LOCATED PRIOR TO CONSTRUCTION.
3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF PORTLAND AND THE PORTLAND WATER DEPARTMENT.
4. ALL UTILITIES SHALL BE DEPTH MARKED AND LOCATED PRIOR TO CONSTRUCTION.
5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF PORTLAND AND THE PORTLAND WATER DEPARTMENT.
6. ALL UTILITIES SHALL BE DEPTH MARKED AND LOCATED PRIOR TO CONSTRUCTION.
7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF PORTLAND AND THE PORTLAND WATER DEPARTMENT.
8. ALL UTILITIES SHALL BE DEPTH MARKED AND LOCATED PRIOR TO CONSTRUCTION.
9. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY OF PORTLAND AND THE PORTLAND WATER DEPARTMENT.
10. ALL UTILITIES SHALL BE DEPTH MARKED AND LOCATED PRIOR TO CONSTRUCTION.

GRAPHIC SCALE
1" = 40' FT.

NO.	DATE	DESCRIPTION
1	11/01/01	SITE LOCATION OF DEVELOPMENT FROM SUBMISSION
2	11/02/01	PRELIMINARY SITE PLAN APPLICATION TO CITY OF PORTLAND
3	11/02/01	REVISIONS
4	11/02/01	REVISIONS
5	11/02/01	REVISIONS
6	11/02/01	REVISIONS
7	11/02/01	REVISIONS
8	11/02/01	REVISIONS

PROJECT: MERCY AT THE FORE
SHEET TITLE: UTILITY PLAN - NORTH
CLIENT: MERCY HOSPITAL

DALUCA-HOTTMAN ASSOCIATES, INC.
778 MAIN STREET, SUITE B
SOUTH PORTLAND, ME 04106
DH@DALUCAHOTTMAN.COM

DESIGNED: DEB
DATE: 11/01/01
CHECKED: SHB
SCALE: 1"=40'
FILE NAME: 2149.01-MF3
SHEET: C-10