


ITEM	PART NO.	DESCRIPTION
1	7339B	3.0 GAL. MICH. ANSUL AUTOMAN REG. RELEASE
2	413337	NOZZLE, TIP NO. 78073-2V
3	413335	NOZZLE, TIP NO. 66926-IN
4	5373	CARTRIDGE SHOOTING ASSEMBLY (LT-30-R)
5	41736E	TERMINAL DETECTOR PACKAGE
6	7728A	1/2" NPT. SEAL ADAPTER
7	7912	1/2" NPT. COMPRESSION-SEAL ADAPTER
8	4835	REMOTE PULL STATION ASSEMBLY
9	7741H	BLU-TEC GAP SHOOTING ASSEMBLY (12)
10	1838/B	ELECTRIC SWITCH ASSEMBLY (SPST)
11		ANSUL MECHANICAL GAS VALVE

- GENERAL NOTES:
- THIS INSTALLATION IS TO BE MADE IN ACCORDANCE WITH THE R-102 INSTALLATION MANUAL AND IN ACCORDANCE WITH ALL STATE AND LOCAL CODES.
 - THE UNIT SHOWN OFF THE DETECTOR AND REMOTE PULL STATION IS TO BE 30 IN. TO 36 IN. HEIGHT AND SHALL BE MOUNTED IN A VISIBLE AND ACCESSIBLE LOCATION.
 - THIS MECHANICAL GAS VALVE SHALL BE INSTALLED AND OPERATED BY AN AUTHORIZED AND TRAINED DISTRIBUTOR OR SERVICE REPRESENTATIVE.
 - SEE LOCAL CODES AND VARIATIONS IN APPLICATIONS FOR UNIT WALL MOUNTING BY THE "TYPICAL" INSTALLATION.
 - ALL GAS PIPING SHALL BE APPROVED BY THE LOCAL GAS DEPARTMENT AND SHALL BE INSTALLED IN ACCORDANCE WITH ALL LOCAL AND NATIONAL GAS CODES AND SHALL BE INSTALLED IN A VISIBLE AND ACCESSIBLE LOCATION. ALL GAS PIPING SHALL BE INSTALLED TO THE GAS VALVE AND SHALL BE INSTALLED TO THE GAS VALVE AND SHALL BE INSTALLED TO THE GAS VALVE AND SHALL BE INSTALLED TO THE GAS VALVE.
 - ALL GAS PIPING SHALL BE INSTALLED TO THE GAS VALVE AND SHALL BE INSTALLED TO THE GAS VALVE AND SHALL BE INSTALLED TO THE GAS VALVE.

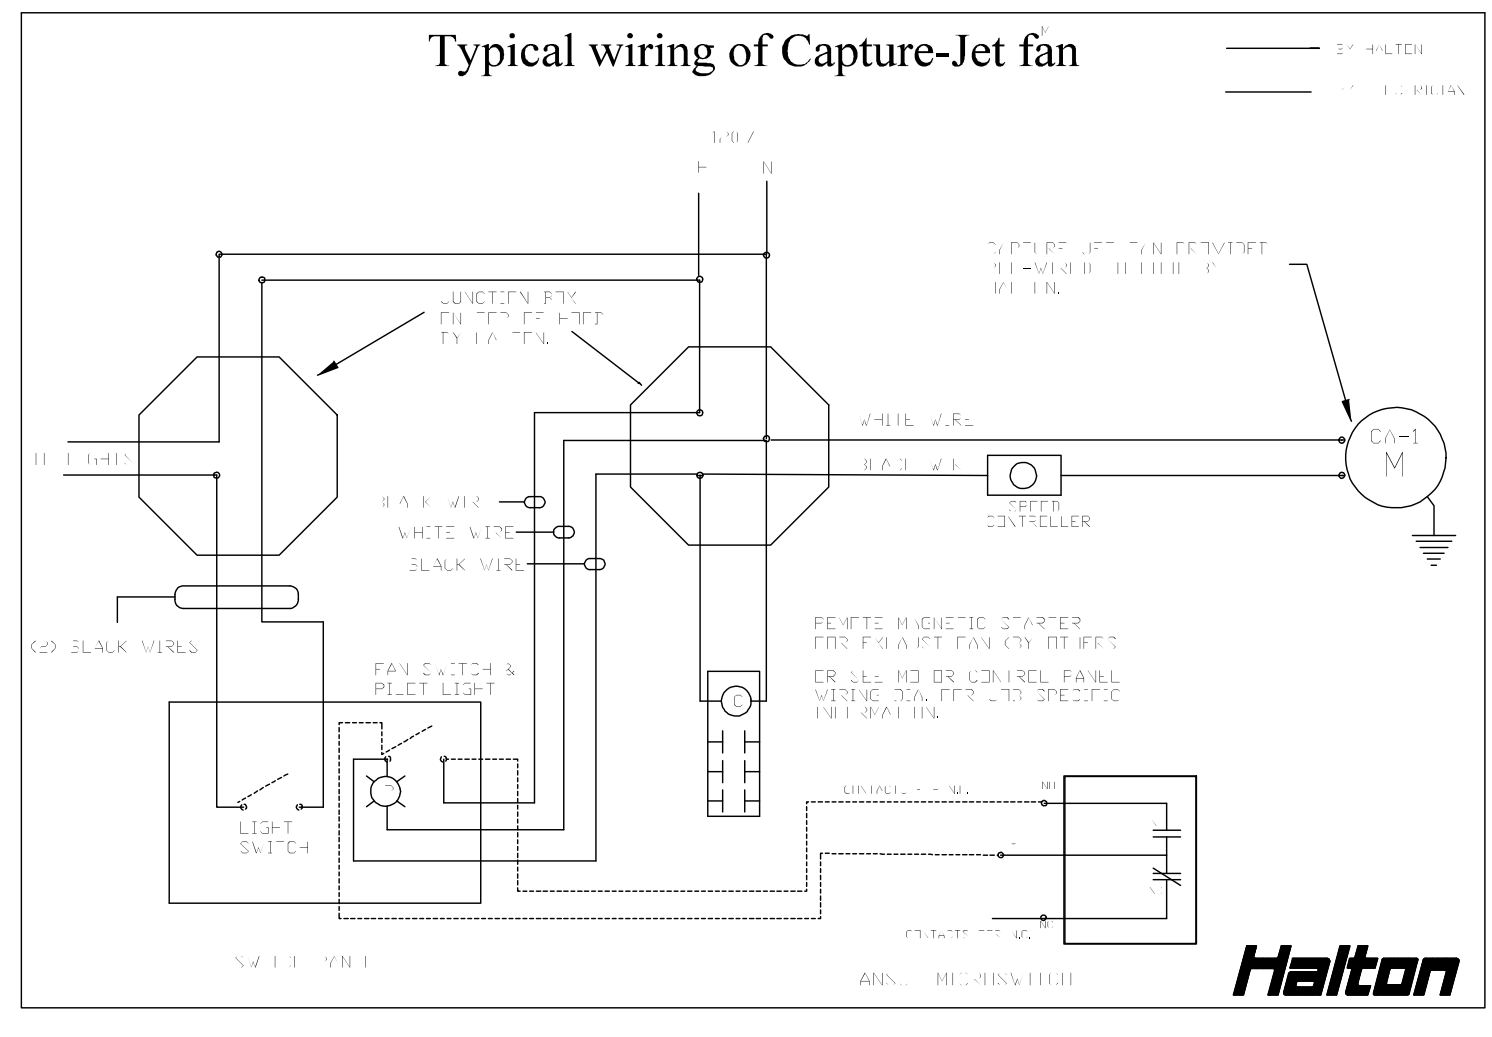

APPROVED DRAWING REQUIRED BEFORE FABRICATION

DRAWING APPROVED

APPROVED AS NOTED

RESUBMIT DRAWING

BY: _____ DATE: _____



REV DATE: 00/00/00

PROJECT: MERCY HOSPITAL

TITLE: GENERAL SPECS

LOCATION: _____

DATE: 08/15/06 DWG#: 13052B

FINAL - ISSUED FOR CONSTRUCTION

Project: _____

Revisions:

1. _____

2. _____

3. _____

4. _____

Job Number: 04166

Date: 11-10-2006

Drawn By: WM

Checked By: RSP

SCALE: N.T.S.

This drawing and the design is the property of Inman Associates, Inc. The reproduction, copying or use of this drawing without written consent is prohibited and any infringement will be subject to legal action.

FIRE SUPPRESSION
DETAIL ITEM #119

NOTE: THIS DRAWING INDICATES THE GENERAL EXTENT OF THE WORK AND IS NOT INTENDED TO INDICATE OR DESCRIBE ANY AND ALL WORK REQUIRED FOR THE FULL PERFORMANCE AND COMPLETION OF THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.