


GENERAL NOTES:
 REFERENCE CIVIL DRAWINGS FOR FINAL DESIGN.
 THE ELECTRICAL DESIGNER SHOULD
 INCORPORATE COMMUNICATIONS RISER CONDUIT
 WITH MECHANICAL, ELECTRICAL AND PLUMBING
 SYSTEMS. LIMITATIONS ON COMMUNICATIONS
 RISER CONDUIT SHALL BE:
 -NO MORE THAN TWO 90 DEGREE BENDS
 BETWEEN PULL BOXES.
 -NO SINGLE PULL LONGER THAN 250'.
 -CONDUIT SHALL BE 1/2" OVER THE PULL.
 -CONDUIT BEND RADIUS SHOULD BE NO MORE
 THAN 10 TIMES OUTER DIAMETER OF CONDUIT.

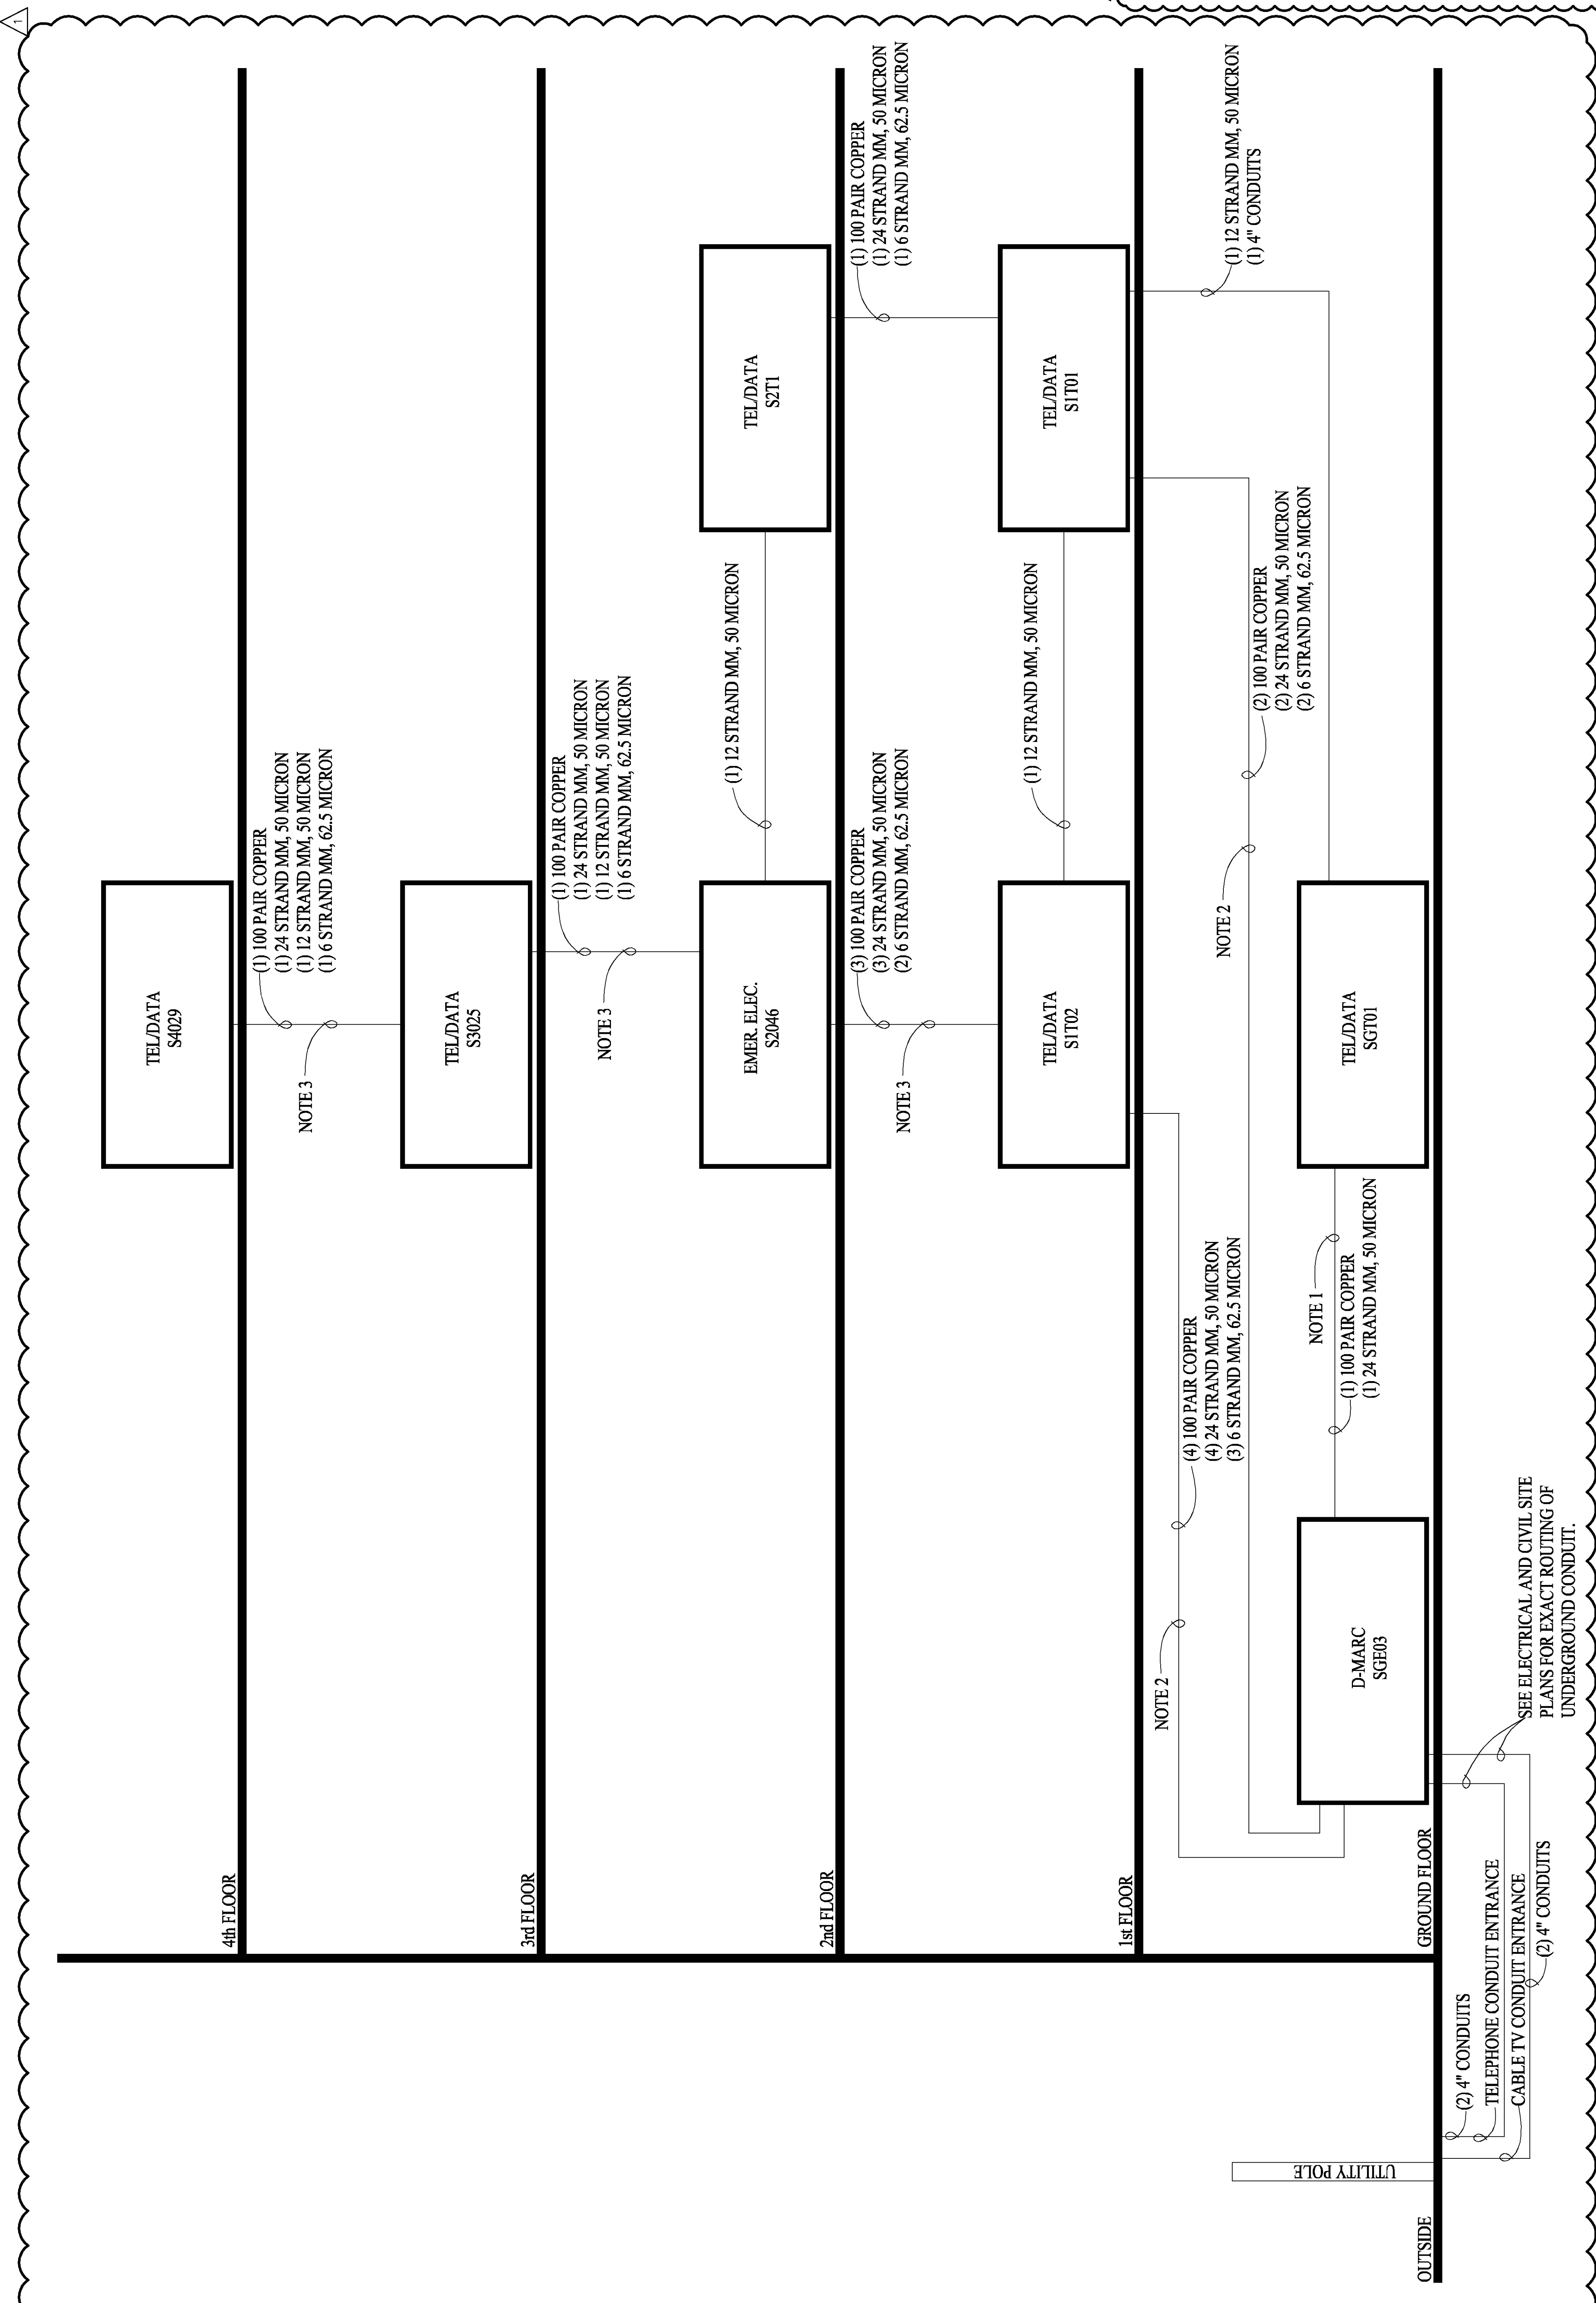

CONDUIT NOTES:

NOTE 1: CONTRACTOR TO PROVIDE SLEEVES IN FLOOR OF COMM ROOMS AS NOTED BELOW. WHEN COMM ROOMS ARE NOT STACKED, CONTRACTORS TO PROVIDE CONDUITS AS NOTED BELOW.

QTY	SIZE	PURPOSE
1	4"	INTERCOM, PA RISER
1	4"	FIBER/COPPER RISER
1	4"	SECURITY RISER
1	4"	SPARE

NOTE 2: CONTRACTOR TO PROVIDE SLEEVES IN FLOOR OF COMM ROOMS AS NOTED BELOW. WHEN COMM ROOMS ARE NOT STACKED, CONTRACTORS TO PROVIDE CONDUITS AS NOTED BELOW.

QTY	SIZE	PURPOSE
1	4"	COPPER RISER
1	4"	FIBER RISER
1	4"	NURSE CALL PA INTERCOM
1	4"	TELEVISION RISER
1	4"	SECURITY RISER
1	4"	SPARE

NOTE 3: CONTRACTOR TO PROVIDE SLEEVES IN FLOOR OF COMM ROOMS AS NOTED BELOW. WHEN COMM ROOMS ARE NOT STACKED, CONTRACTORS TO PROVIDE CONDUITS AS NOTED BELOW.

QTY	SIZE	PURPOSE
1	4"	COPPER RISER
1	4"	FIBER RISER
1	4"	NURSE CALL, PA, INTERCOM
1	4"	TELEVISION RISER
1	4"	SECURITY RISER
1	4"	SPARE