

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
 PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:
General Contractor:
Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 3/30/2007 **Time Cast:** 8:05 **Date Received:** 3/31/2007

Placement Location: 2ND FLOOR INTERIOR DECK SLAB A TO H LINE & 2 TO 3 LINE

Placement Method: PUMP

Placement Vol. (yd³): 240

Cylinders Made By: SEB

Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION

Admixtures: POLYHEED

TEST RESULTS

Slump (in) (C-143): **Slump WR:** 6.0

Load Number: 3

Air Content (%) (C-231): **Air WR:** 2.1

Mixer Number: 173

Air Temp (°F): 33

Ticket Number: 4525694

Conc. Temp (°F) (C-1064): 65

Cubic Yards: 10

Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-45A		6.00	28.27	4/6/2007	Lab	7	4	104.0	3680
702-45B		6.00	28.27	4/27/2007	Lab	28	4	153.0	5410
702-45C		6.00	28.27	4/27/2007	Lab	28	5	163.5	5780
702-45D				Hold	Lab				

Fracture Types



Cone



Cone and Split



Cone and Shear



Shear



Columnar

Remarks:

Report of Concrete Compressive Strength

ASTM C-31 & C-39

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
 PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:
General Contractor:
Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 3/30/2007 **Time Cast:** 9:20 **Date Received:** 3/31/2007

Placement Location: 2ND FLOOR INTERIOR DECK SLAB A TO H LINE & 2 TO 3 LINES

Placement Method: PUMP

Placement Vol. (yd³): 240

Cylinders Made By: SEB

Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION

Admixtures: POLYHEED

TEST RESULTS

Slump (in) (C-143):	Slump WR: 6.0	Load Number: 7
Air Content (%) (C-231):	Air WR: 2.4	Mixer Number: 169
Air Temp (°F): 36		Ticket Number: 4525698
Conc. Temp (°F) (C-1064): 64		Cubic Yards: 10
		Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-46A		6.00	28.27	4/6/2007	Lab	7	4	106.0	3750
702-46B		6.00	28.27	4/27/2007	Lab	28	4	151.5	5360
702-46C		6.00	28.27	4/27/2007	Lab	28	4	149.5	5290
702-46D				Hold	Lab				

Fracture Types



Cone




Cone and Split



Cone and Shear



Shear



Columnar

Remarks:

Report of Concrete Compressive Strength

ASTM C-31 & C-39

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
 PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:
General Contractor:
Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 3/30/2007 **Time Cast:** 10:40 **Date Received:** 3/31/2007

Placement Location: 2ND FLOOR INTERIOR DECK SLAB A TO H LINE & 1 TO 3 LINE

Placement Method: PUMP

Placement Vol. (yd³): 240

Cylinders Made By: SEB

Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION

Admixtures: POLYHEED

TEST RESULTS

Slump (in) (C-143):	Slump WR: 6.0	Load Number: 15
Air Content (%) (C-231):	Air WR: 2.0	Mixer Number: 192
Air Temp (°F): 43		Ticket Number: 4525707
Conc. Temp (°F) (C-1064): 66		Cubic Yards: 10
		Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-47A		6.00	28.27	4/6/2007	Lab	7	4	100.0	3540
702-47B		6.00	28.27	4/27/2007	Lab	28	5	159.0	5620
702-47C		6.00	28.27	4/27/2007	Lab	28	4	158.0	5590
702-47D				Hold	Lab				

Fracture Types



Cone



Cone and Split



Cone and Shear



Shear



Columnar

Remarks:

Report of Concrete Compressive Strength

ASTM C-31 & C-39

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
 PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:

General Contractor:

Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 3/30/2007 **Time Cast:** 11:20 **Date Received:** 3/31/2007

Placement Location: 2ND FLOOR INTERIOR DECK SLAB A TO H LINE & 1 TO 3 LINES

Placement Method: PUMP

Placement Vol. (yd³): 240

Cylinders Made By: SEB

Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION

Admixtures: POLYHEED

TEST RESULTS

Slump (in) (C-143): **Slump WR:** 6

Load Number: 19

Air Content (%) (C-231): **Air WR:** 2.7

Mixer Number: 176

Air Temp (°F): 47

Ticket Number: 4525711

Conc. Temp (°F) (C-1064): 64

Cubic Yards: 10

Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-48A		6.00	28.27	4/6/2007	Lab	7	4	96.0	3400
702-48B		6.00	28.27	4/27/2007	Lab	28	4	150.0	5310
702-48C		6.00	28.27	4/27/2007	Lab	28	4	152.0	5380
702-48D				Hold	Lab				

Fracture Types



Cone




Cone and Split



Cone and Shear



Shear



Columnar

Remarks:

Report of Concrete Compressive Strength

ASTM C-31 & C-39

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
 PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:
General Contractor:
Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 3/30/2007 **Time Cast:** **Date Received:** 3/31/2007

Placement Location: 2ND FLOOR INTERIOR DECK SLAB 1 TO 3 & A TO H LINES

Placement Method: DIRECT

Placement Vol. (yd³): 240

Cylinders Made By: SEB

Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION

Admixtures: POLYHEED

TEST RESULTS

Slump (in) (C-143): **Slump WR:** 6

Load Number: 24

Air Content (%) (C-231): **Air WR:** 2.4

Mixer Number: 170

Air Temp (°F): 44

Ticket Number: 4525718

Conc. Temp (°F) (C-1064): 65

Cubic Yards: 10

Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area (in) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-49A		6.00	28.27	4/6/2007	Lab	7	4	104.0	3680
702-49B		6.00	28.27	4/27/2007	Lab	28	4	142.5	5040
702-49C		6.00	28.27	4/27/2007	Lab	28	4	150.5	5320
702-49D				Hold	Lab				

Fracture Types



Cone




Cone and Split



Cone and Shear



Shear



Columnar

Remarks:

Report of Concrete Compressive Strength

ASTM C-31 & C-39

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
 PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:
General Contractor:
Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 4/20/2007 **Time Cast:** 8:00

Date Received: 4/21/2007

Placement Location: 2ND FLOOR LEFT HALF

Placement Method: PUMP TRUCK

Placement Vol. (yd³): 265

Cylinders Made By: JCM

Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION

Admixtures: POLYHEED 997 /
 POZZUTEC 20 1%

TEST RESULTS

Slump (in) (C-143): 4.5

Load Number: 4

Air Content (%) (C-231): 2.0

Mixer Number: 192

Air Temp (°F): 42

Ticket Number: 4525961

Conc. Temp (°F) (C-1064): 68

Cubic Yards: 10

Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-55A		6.00	28.27	4/27/2007	Lab	7	4	108.5	3840
702-55B				5/18/2007	Lab	28			
702-55C				5/18/2007	Lab	28			
702-55D				Hold	Lab				

Fracture Types



Cone



Cone and Split



Cone and Shear



Shear



Columnar

Remarks:

Report of Concrete Compressive Strength

ASTM C-31 & C-39

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
 PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:

General Contractor:

Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 4/20/2007 **Time Cast:** 4:15

Date Received: 4/21/2007

Placement Location: 2ND FLOOR LEFT HALF

Placement Method: PUMP TRUCK

Placement Vol. (yd³): 265

Cylinders Made By: JCM

Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION

Admixtures: POLYHEED 997 /
 POZZUTEC 20 1%

TEST RESULTS

Slump (in) (C-143): 4.75

Load Number: 10

Air Content (%) (C-231): 1.6

Mixer Number: 140

Air Temp (°F): 46

Ticket Number: 4525971

Conc. Temp (°F) (C-1064): 53

Cubic Yards: 10

Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-56A		6.00	28.27	4/27/2007	Lab	7	4	109.0	3860
702-56B				5/18/2007	Lab	28			
702-56C				5/18/2007	Lab	28			
702-56D				Hold	Lab				

Fracture Types



Cone



Cone and Split



Cone and Shear



Shear



Columnar

Remarks:

Report of Concrete Compressive Strength

ASTM C-31 & C-39

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
 PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:

General Contractor:

Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 4/20/2007 **Time Cast:** 10:30 **Date Received:** 4/21/2007

Placement Location: 2ND FLOOR LEFT HALF

Placement Method: PUMP TRUCK

Placement Vol. (yd³): 265

Cylinders Made By: JCM

Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION

Admixtures: POLYHEED 997 /
 POZZUTEC 20 1%

TEST RESULTS

Slump (in) (C-143): 6
Air Content (%) (C-231): 2.0
Air Temp (°F): 61
Conc. Temp (°F) (C-1064): 58

Load Number: 15
Mixer Number: 179
Ticket Number: 4525981
Cubic Yards: 10
Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-57A		6.00	28.27	4/27/2007	Lab	7	5	102.5	3630
702-57B				5/18/2007	Lab	28			
702-57C				5/18/2007	Lab	28			
702-57D				Hold	Lab				

Fracture Types



Cone



Cone and Split



Cone and Shear



Shear



Columnar

Remarks:

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
 PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:

General Contractor:

Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 4/20/2007 **Time Cast:** 11:20 **Date Received:** 4/21/2007

Placement Location: 2ND FLOOR LEFT HALF

Placement Method: PUMP TRUCK

Placement Vol. (yd³): 265

Cylinders Made By: JCM

Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION

Admixtures: POLYHEED 997 /
 POZZUTEC 20 1%

TEST RESULTS

Slump (in) (C-143): 7

Load Number: 19

Air Content (%) (C-231): 2.1

Mixer Number: 156

Air Temp (°F): 61

Ticket Number: 4525989

Conc. Temp (°F) (C-1064): 58

Cubic Yards: 10

Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-58A		6.00	28.27	4/27/2007	Lab	7	4	105.5	3730
702-58B				5/18/2007	Lab	28			
702-58C				5/18/2007	Lab	28			
702-58D				Hold	Lab				

Fracture Types



Cone




Cone and Split



Cone and Shear



Shear



Columnar

Remarks:

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
 PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:

General Contractor:

Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 4/20/2007 **Time Cast:** 12:15 **Date Received:** 4/21/2007

Placement Location: 2ND FLOOR LEFT HALF

Placement Method: PUMP TRUCK

Placement Vol. (yd³): 265

Cylinders Made By: JCM

Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION

Admixtures: POLYHEED 997 /
 POZZUTEC 20 1%

TEST RESULTS

Slump (in) (C-143): 6.5

Load Number: 24

Air Content (%) (C-231): 2.2

Mixer Number: 190

Air Temp (°F): 68

Ticket Number: 4525994

Conc. Temp (°F) (C-1064): 54

Cubic Yards: 10

Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-59A		6.00	28.27	4/27/2007	Lab	7	5	108.5	3840
702-59B				5/18/2007	Lab	28			
702-59C				5/18/2007	Lab	28			
702-59D				Hold	Lab				

Fracture Types



Cone



Cone and Split



Cone and Shear



Shear



Columnar

Remarks:



Report of Concrete Compressive Strength

ASTM C-31 & C-39

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:

General Contractor:

Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 4/24/2007 **Time Cast:** 6:45 **Date Received:** 4/25/2007
Placement Location: 3RD FLOOR DECK

Placement Method: PUMP
Cylinders Made By: VLT

Placement Vol. (yd³): 240
Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION


Admixtures: POLYHEED 997,
POZZUTEC 20 1%

TEST RESULTS

Slump (in) (C-143):	Slump WR: 6.5	Load Number: 2
Air Content (%) (C-231):	Air WR: 2.3	Mixer Number: 180
Air Temp (°F): 60		Ticket Number: 4526038
Conc. Temp (°F) (C-1064): 68		Cubic Yards: 10
		Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-60A		6.00	28.27	5/1/2007	Lab	7	4	106.5	3770
702-60B				5/22/2007	Lab	28			
702-60C				5/22/2007	Lab	28			
702-60D				Hold	Lab				

Fracture Types

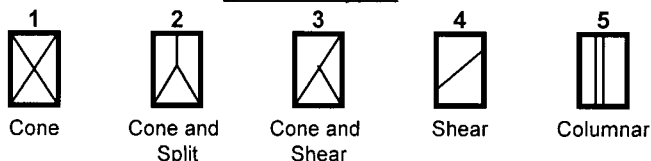

Remarks:

Report of Concrete Compressive Strength

ASTM C-31 & C-39

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
 PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:
General Contractor:
Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 4/24/2007 **Time Cast:** 8:22 **Date Received:** 4/25/2007
Placement Location: 3RD FLOOR DECK

Placement Method: PUMP
Cylinders Made By: VLT

Placement Vol. (yd³): 240
Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION

Admixtures: POLYHEED 997,
 POZZUTEC 20 1%

TEST RESULTS

Slump (in) (C-143): **Slump WR:** 7.25
Air Content (%) (C-231): **Air WR:** 2.1
Air Temp (°F): 60
Conc. Temp (°F) (C-1064): 67

Load Number: 8
Mixer Number: 156
Ticket Number: 4526044
Cubic Yards: 10
Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-61A		6.00	28.27	5/1/2007	Lab	7	4	96.5	3410
702-61B				5/22/2007	Lab	28			
702-61C				5/22/2007	Lab	28			
702-61D				Hold	Lab				

Fracture Types



Cone



Cone and Split



Cone and Shear



Shear



Columnar

Remarks:



Report of Concrete Compressive Strength

ASTM C-31 & C-39

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:

General Contractor:

Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 4/24/2007 **Time Cast:** 8:40 **Date Received:** 4/25/2007
Placement Location: 3RD FLOOR DECK

Placement Method: PUMP
Cylinders Made By: VLT

Placement Vol. (yd³): 240
Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION


Admixtures: POLYHEED 997,
POZZUTEC 20 1%

TEST RESULTS

Slump (in) (C-143):	Slump WR: 6	Load Number: 14
Air Content (%) (C-231):	Air WR: 1.8	Mixer Number: 169
Air Temp (°F): 65		Ticket Number: 4526053
Conc. Temp (°F) (C-1064): 67		Cubic Yards: 10
		Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-62A		6.00	28.27	5/1/2007	Lab	7	4	89.0	3150
702-62B				5/22/2007	Lab	28			
702-62C				5/22/2007	Lab	28			
702-62D				Hold	Lab				

Fracture Types

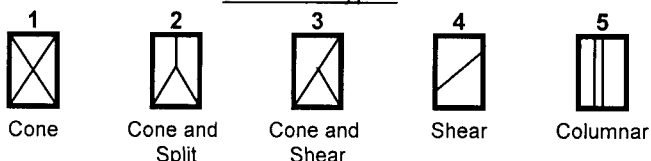

Remarks:



Report of Concrete Compressive Strength

ASTM C-31 & C-39

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:

General Contractor:

Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 4/24/2007 **Time Cast:** 9:50 **Date Received:** 4/25/2007
Placement Location: 3RD FLOOR DECK

Placement Method: PUMP **Placement Vol. (yd³):** 240
Cylinders Made By: VLT **Aggregate Size (in):** 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION

Admixtures: POLYHEED 997,
POZZUTEC 20 1%

TEST RESULTS

Slump (in) (C-143):	Slump WR: 6.25	Load Number: 18
Air Content (%) (C-231):	Air WR: 1.8	Mixer Number: 185
Air Temp (°F): 65		Ticket Number: 4526057
Conc. Temp (°F) (C-1064): 66		Cubic Yards: 10
		Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-63A		6.00	28.27	5/1/2007	Lab	7	4	123.5	4370
702-63B				5/22/2007	Lab	28			
702-63C				5/22/2007	Lab	28			
702-63D				Hold	Lab				

Fracture Types



Cone



Cone and Split



Cone and Shear



Shear



Columnar

Remarks:

Report of Concrete Compressive Strength

ASTM C-31 & C-39

Project Name: PORTLAND - FORE RIVER SHORT STAY HOSPITAL
 PROJECT - MATERIALS TESTING / SPECIAL

Project Number: 06-1069.1

Client: MERCY HOSPITAL

Client Contract Number:
General Contractor:
Concrete Supplier: DRAGON PRODUCTS

PLACEMENT INFORMATION

Date Cast: 4/24/2007 **Time Cast:** 10:45 **Date Received:** 4/25/2007
Placement Location: 3RD FLOOR DECK

Placement Method: PUMP

Placement Vol. (yd³): 240

Cylinders Made By: VLT

Aggregate Size (in): 3/4

INITIAL CURING CONDITIONS

Temperatures

Minimum (°F) **Maximum (°F)**

DELIVERY INFORMATION


Admixtures: POLYHEED 997,
 POZZUTEC 20 1%

TEST RESULTS

Slump (in) (C-143):	Slump WR: 6.0	Load Number: 24
Air Content (%) (C-231):	Air WR: 2.2	Mixer Number: 176
Air Temp (°F): 60		Ticket Number: 4526065
Conc. Temp (°F) (C-1064): 64		Cubic Yards: 10
		Design (psi): 4000

Cylinder Designation	Cylinder Weight (lbs)	Cylinder Diameter (in)	Cross Sectional Area(In) ²	Date Of Test	Cure Type	Age (days)	Fracture Type	Load (kips)	Strength (psi)
702-64A		6.00	28.27	5/1/2007	Lab	7	4	105.0	3710
702-64B				5/22/2007	Lab	28			
702-64C				5/22/2007	Lab	28			
702-64D				Hold	Lab				

Fracture Types

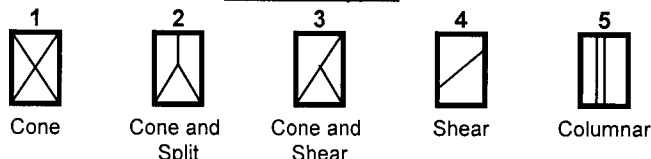

Remarks: