


FIRST LEVEL LIGHTING PLAN

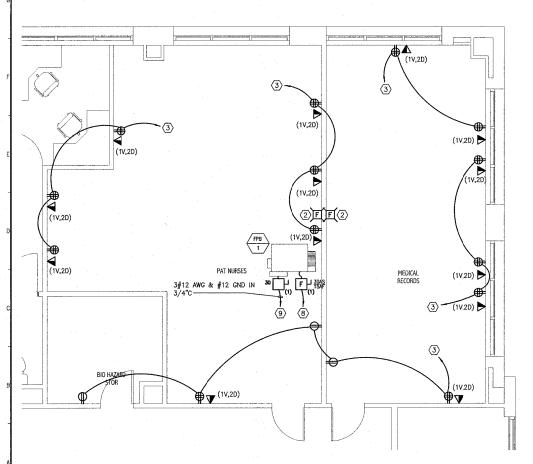

NOTE:

SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES. ALL EQUIPMENT, CONDUIT, CONDUCTORS AND CABLE INSTALLED WITHIN THE CEILING SPACE IS TO BE PLENUM RATED.

KEYED NOTE:

- PROVIDE 2X4 FIXTURE TO MATCH EXISTING HOSPITAL STANDARD FOR OFFICE SPACES. COORDINATE FIXTURE SELECTION WITH
- (2) PROVIDE FIRE ALARM DEVICE TO MATCH EXISTING HOSPITAL STANDARD. CONNECT DEVICE INTO EXISTING FIRE ALARM SYSTEM.
- (3) PROVIDE 120V, 20A CIRCUIT FROM LOCAL 120V NORMAL POWER PANEL PROVIDE 120V, 20A, 1—POLE, BREAKER AS REQUIRED TO ACCOMMODATE CIRCUIT.
- (4) PROVIDE 277V, 20A CIRCUIT FROM LOCAL 277V NORMAL POWER PANEL. PROVIDE 277V, 20A, 1—POLE, BREAKER AS REQUIRED TO ACCOMMODATE CIRCUIT.
- (5) PROVIDE CEILING MOUNTED OCCUPANCY SENSOR (WATT STOPPER DT—300 OR EQUAL). PROVIDE POWER SUPPLY, RELAY AND ALL OTHER NECESSARY EQUIPMENT FOR OPERATION.
- (6) PROVIDE WALL MOUNTED OCCUPANCY SENSOR (WATT STOPPER DW-103 OR EQUAL). PROVIDE POWER SUPPLY, RELAY AND ALL OTHER NECESSARY EQUIPMENT FOR OPERATION.
- (7) PROVIDE 2X4 FIXTURE WITH EMERGENCY BATTERY BACKUP TO MATCH EXISTING HOSPITAL STANDARD FOR OFFICE SPACES. COORDINATE FIXTURE SELECTION WITH OWNER.
- (B) PROVIDE 277V, 20A CIRCUIT FROM LOCAL 277V NORMAL POWER PANEL FOR FPB-1 FAN CIRCUIT. PROVIDE 277V, 20A, 1-POLE, BREAKER AS REQUIRED TO ACCOMMODATE CIRCUIT.
- (9) PROVIDE 480V, 3--PHASE, 20A CIRCUIT FROM LOCAL 480V NORMAL POWER PANEL FOR FPB-1 HEATER CIRCUIT. PROVIDE 480V, 20A, 3--POLE, BREAKER AS REQUIRED TO ACCOMMODATE CIRCUIT.

e Street/P.O. Box Portland, Maine 04 tel. (207) 772--3 fox. (207) 772-1 www.smrtino.









PERMIT SET 07/28/14 日 SUITE E OF RECORD: ROJECT NO: ELECTRICAL PLANS

FIRST LEVEL POWER AND SYSTEMS PLAN 1/4" = 1'-0"

[№].–101