


NOTE:
1. SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES

- KEYED NOTES:**
1. PROVIDE WITH EMERGENCY BATTERY DRIVER OPTION.
 2. SUSPEND TRANSFORMER ABOVE CEILING.
 3. PROVIDE FURNITURE POWER AND COMMUNICATION CONNECTION. COORDINATE WITH SYSTEMS FURNITURE MANUFACTURER.
 4. PROVIDE LEGRAND OR APPROVED EQUAL BRUSHED ALUMINUM POWER POLE WITH TWO COMPARTMENTS AND SYSTEMS FURNITURE CONNECTION. COORDINATE WITH SYSTEMS FURNITURE MANUFACTURER.
 5. REMOVE 20A, 1 POLE BREAKERS IN SPACES LP1-32, 34 & 36. PROVIDE NEW 50A 3 POLE BREAKER IN PLACE OF OLD FOR USE WITH RP1A.
 6. COORDINATE EXACT PANEL LOCATION AND MOUNTING HEIGHT WITH EXISTING DUCT AND SPRINKLER IN ORDER TO MEET DEDICATED ELECTRICAL SPACE REQUIREMENT OF NEC 110.26(E)

REV	DESCRIPTION	DATE
0	PERMIT SET	7-1-16


PERMIT SET
7-1-16
CURRENT ISSUE STATUS:

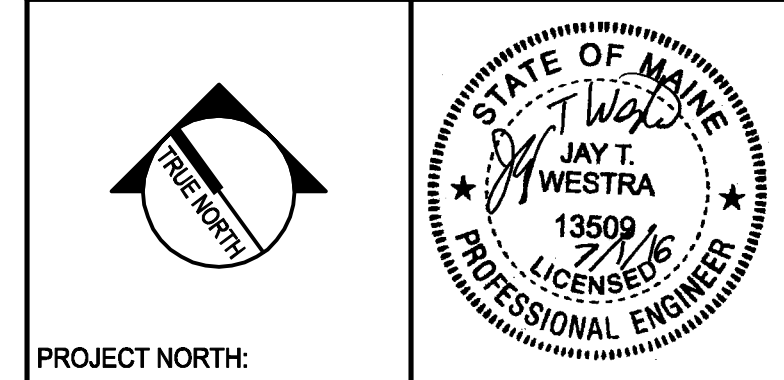

PROJECT NORTH:
SMRT Architects and Engineers
144 Fore Street
Portland, Maine 04104
1.877.700.7678
www.smr1inc.com

MILLER DRUG FITUP
MERCY FORE RIVER MOB
195 Fore River Parkway, Portland, ME 04102

FIRST FLOOR ELECTRICAL PLANS

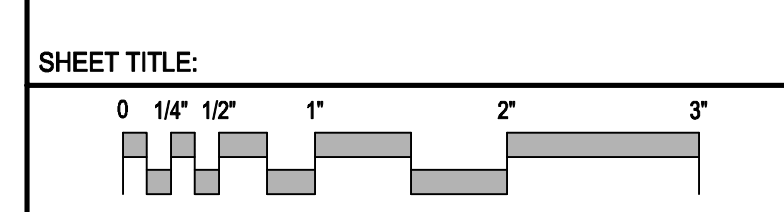

PROJECT MANAGER:	KD	PROJECT NO.:	16087
A/E OF RECORD:	RB		
JOB CAPTAIN:	SHK		
DRAWN BY:	CDS		
SMRT FILE:	E-101-16087	SHEET No.:	E-101