

WALL TYPE SCHEDULE

WALL TYPE		GENERAL WALL TYPE DESCRIPTION	GENERAL PICTORIAL
1	TYPICAL EXTERIOR WALL TYPE	2x6 WOOD STUDS @ 24" O.C. TO UNDERSIDE OF ROOF STRUCTURE 32/16" THICK APA RATED SHEATHING, (1) LAYER TYVEK HOME WRAP [®] AND VINYL SIDING, FAGED SIDE (1) LAYER 5/8" TYPE "X" GMB OPPOSITE SIDE (1) LAYER 5/8" TYPE "X" GMB OPPOSITE SIDE 1/2" RESILIENT CHANNELS @ 16" O.C. CONTINUOUS R-19 FIBERGLASS BATT INSULATION	
2	EXTERIOR/STAIR WALL TYPE	2x6 WOOD STUDS @ 24" O.C. TO UNDERSIDE OF ROOF STRUCTURE 32/16" THICK APA RATED SHEATHING, (1) LAYER TYVEK HOME WRAP [®] AND VINYL SIDING, FAGED SIDE (1) LAYER 5/8" TYPE "X" GMB STAR SIDE (2) LAYER 5/8" TYPE "X" GMB STAR SIDE 1/2" RESILIENT CHANNELS @ 16" O.C. CONTINUOUS R-19 FIBERGLASS BATT INSULATION	
3	1 HOUR FIRE RATED ASSEMBLY UNIT/UNIT WALL TYPE	2x4 STAGGERED WOOD STUDS @ 16" O.C. ON 2x6 WOOD TOP AND BOTTOM PLATES TO UNDERSIDE OF FLOOR DECK ABOVE. 1/2" RESILIENT CHANNELS @ 16" O.C. EACH SIDE AND (1) LAYER OF 5/8" TYPE "X" GMB EACH SIDE. PROVIDE SOLID 2x2 BLOCKING AT CEILING LEVEL. PROVIDE TYPE "MKT" GMB WITHIN ALL BATHROOMS AND BEHIND ALL KITCHEN SINKS.	
4	CORRIDOR/UNIT WALL TYPE	2x6 WOOD STUDS @ 16" O.C. TO UNDERSIDE OF FLOOR TRUSS SYSTEM, 1/2" RESILIENT CHANNELS @ 16" O.C. @ CORRIDOR SIDE ONLY (1) LAYER 5/8" TYPE "X" GMB, EACH SIDE SEALED TIGHT TO UNDERSIDE OF FLOOR DECKING AND/OR ROOF DECKING, EACH SIDE. PROVIDE TYPE "MKT" GMB WITHIN ALL BATHROOMS AND BEHIND ALL KITCHEN SINKS.	
5	ELEVATOR SHEET WALL TYPE	8" CMU BLOCK WALL AIRSPACE 2x6 WOOD STUDS @ 16" O.C. CONTINUOUS BATT INSULATION 1/2" RESILIENT CHANNELS @ 16" O.C. UNIT SIDE ONLY (1) LAYER 5/8" TYPE "X" GMB, UNIT SIDE ONLY	
6	TYPICAL INTERIOR WALL TYPE	2x4 (2x6 IF INDICATED AS SUCH) WOOD STUDS @ 16" O.C. TO UNDERSIDE OF FLOOR TRUSS SYSTEM. (1) LAYER 5/8" TYPE "X" GMB EACH SIDE. CONTINUOUS 2 1/2" BATT INSULATION. PROVIDE TYPE "MKT" GMB WITHIN ALL BATHROOMS AND BEHIND ALL KITCHEN SINKS.	
7	STAIR/CORRIDOR WALL TYPE	2x6 WOOD STUDS @ 16" O.C. TO UNDERSIDE OF FLOOR TRUSS SYSTEM. (2) LAYER 5/8" TYPE "X" GMB ON TIGGED SIDE 1/2" PLYWOOD SHEATHING AND 2 LAYERS OF 5/8" TYPE "X" GMB STAR SIDE. PROVIDE TYPE "MKT" GMB WITHIN ALL BATHROOMS AND BEHIND ALL KITCHEN SINKS.	

GENERAL GMB NOTE:


1. PROVIDE MOISTURE RESISTENT GMB WITHIN ALL BATHROOMS AND BEHIND KITCHEN SINKS.
2. PROVIDE ABUSE RESISTENT GMB AT ALL LOCATIONS WITHIN RESIDENTS UNITS EXCEPT WHERE INDICATED TO HAVE MOISTURE RESISTENT GMB
3. PROVIDE MOISTURE RESISTENT GMB CONTINUOUS BEHIND TUBS
4. PROVIDE MINIMUM OF 1/2" CLEARANCE BETWEEN CONCRETE AND GMB

ROOF AND FLOOR ASSEMBLY TYPES

WALL TYPE		GENERAL WALL TYPE DESCRIPTION
1	TYPICAL ROOF / CEILING ASSEMBLY (P531)	ASPHALT SHINGLES AS SPECIFIED ON 15# FELT UNDERLAMENT AND WATER SHEDDING UNBLOCKED EDGES AND EXTENSIONS 10# DOWNSIDE SHINGLES @ 24" O.C. 5/8" COX PLYWOOD SHEATHING WITH HIBROKONE CLIPS @ UNBLOCKED EDGES PRE-ENGINEERED WOOD ROOF TRUSSES OR TIMBER FRAMING @ 24" O.C. R-38 FIBERGLASS INSULATION 4 MIL POLY VAPOR BARRIER 5/8" TYPE "X" GMB 1/2" RESILIENT CHANNELS @ 16" O.C. 5/8" TYPE "X" GMB
2	TYPICAL FLOOR / CEILING ASSEMBLY @ UNITS (1 HOUR, UL 1528)	5/8" TYPE "X" GMB ON TRUSS BOTTOM CHORD 1/2" RESILIENT CHANNELS @ 16" O.C. 2 1/2" FIBERGLASS SOUND BATT 20" DEEP FLOOR TRUSSES @ 24" O.C. 3/4" TAG ADVANTECH SUBFLOOR, GLED AND SCREWED FINISHED FLOORING MATERIAL AS INDICATED PER SCHEDULED
3	TYPICAL FLOOR / CEILING ASSEMBLY @ CORRIDOR (1 HOUR, UL 1501)	3/4" TAG ADVANTECH SUBFLOOR PLYWOOD, GLED AND SCREWED 2x8 WOOD JOISTS @ 24" O.C. W/ OVERLAP @ BEARING 5/8" TYPE "X" GMB SUSPENDED ACOUSTICAL CEILING WHERE INDICATED
4	TYPICAL GATEDERAL ROOF / CEILING ASSEMBLY	ASPHALT SHINGLES 15# FELT UNDERLAMENT 5/8" COX PLYWOOD SHEATHING WITH HIBROKONE CLIPS @ UNBLOCKED EDGES 2x12 ROOF RAFTERS @ 24" O.C. 10" R-38 FIBERGLASS INSULATION 4 MIL POLY VAPOR BARRIER 5/8" TYPE "X" GMB 1/2" RESILIENT CHANNELS @ 16" O.C. 5/8" TYPE "X" GMB
5	TYPICAL CRAWL SPACE /CEILING ASSEMBLY @ UNIT	2 1/2" FIBERGLASS SOUND BATT 20" DEEP FLOOR TRUSSES @ 24" O.C. 3/4" TAG ADVANTECH SUBFLOOR, GLED AND SCREWED FINISHED FLOORING MATERIAL AS INDICATED PER SCHEDULED
6	TYPICAL CRAWL SPACE / CEILING ASSEMBLY @ STAIR (1 HOUR, UL 1528)	5/8" TYPE "X" GMB ON TRUSS BOTTOM CHORD 1/2" RESILIENT CHANNELS @ 16" O.C. 2 1/2" FIBERGLASS SOUND BATT 20" DEEP FLOOR TRUSSES @ 24" O.C. 3/4" TAG ADVANTECH SUBFLOOR, GLED AND SCREWED FINISHED FLOORING MATERIAL AS INDICATED PER SCHEDULED

WALL TYPE SCHEDULE

SCALE: NONE

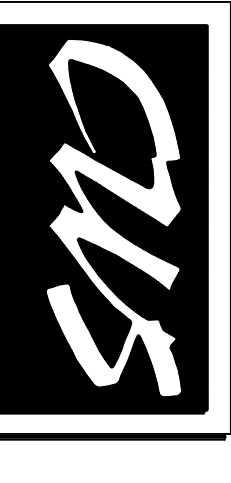

CWS Architects
 Architecture
 Space Planning
 Value Design

134 Cumberland Avenue
 Portland, ME 04101
 Phone: (207)774-4441
 Fax: (207)774-4018
www.CWSArch.com

Owner:
**YC PORTLAND LP,
 C/O AVESTA**
 307 CUMBERLAND AVE
 PORTLAND, MAINE 04101
 (207) 553-7777

Client:
YORK-CUMBERLAND
 HOUSING DEVELOPMENT

LOGAN PLACE
 PORTLAND, MAINE

Project No: 01-409 SR0
 Drawing Title:
WALL TYPES AND DETAILS

Scale: AS NOTED
 Date: FEBRUARY 06, 2004

- Revisions:
- ▷
 - ▷
 - ▷
 - ▷
 - ▷
 - ▷
 - ▷

Drawing Number:
A0.1