


# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services  
Division of Health Engineering, Station 10 SHS  
(207) 287-5672 FAX (207) 287-4172

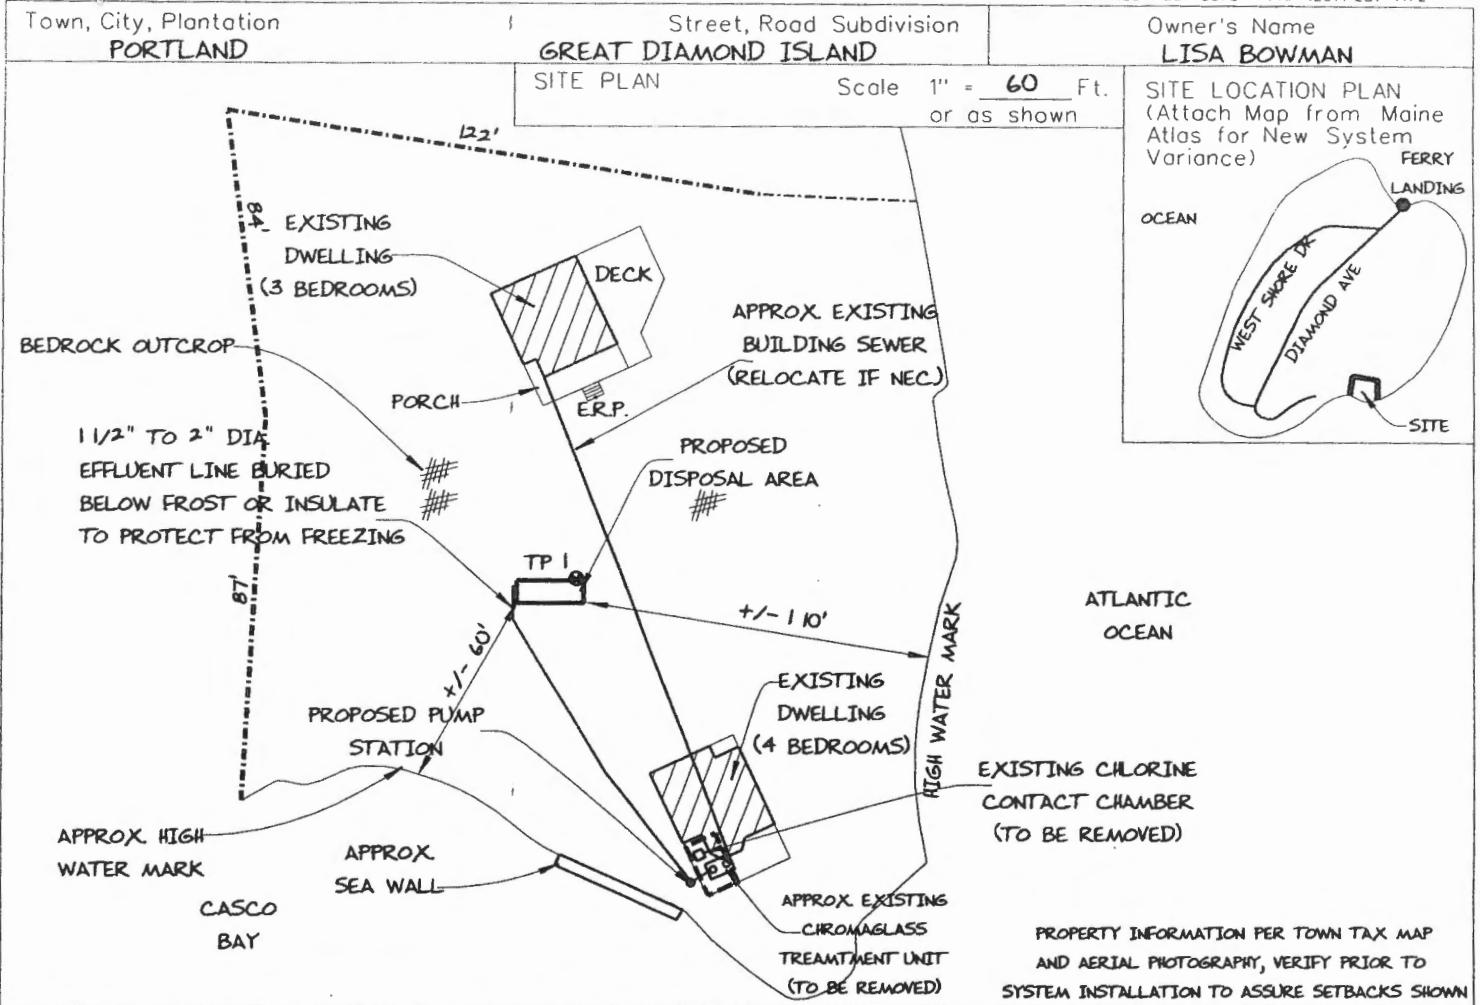

## SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)

Observation Hole TP 1  Test Pit  Boring  
" Depth of Organic Horizon Above Mineral Soil

Texture	Consistency	Color	Mottling
LOAMY		DARK	
FINE		BROWN	
SAND	FRIABLE	YELLOW BROWN	
		LIGHT OLIVE BROWN	
LOAMY		OLIVE BROWN	COMMON, DISTINCT
VERY FINE SAND AND SILT	FIRM		
LIMIT OF EXCAVATION			

Soil Classification: **B** Profile, **C** Condition  
Slope: **0-3%**  
Limiting Factor: **24"**

Ground Water  
 Restrictive Layer  
 Bedrock  
 Pit Depth

Observation Hole \_\_\_\_\_  Test Pit  Boring  
" Depth of Organic Horizon Above Mineral Soil

Texture	Consistency	Color	Mottling
TEST BORINGS IN SYSTEM CORNERS ALL IN EXCESS OF 36" TO BEDROCK			

Soil Classification: \_\_\_\_\_ Profile, \_\_\_\_\_ Condition  
Slope: \_\_\_\_\_ %  
Limiting Factor: \_\_\_\_\_

Ground Water  
 Restrictive Layer  
 Bedrock  
 Pit Depth

*Albert Frick*  
Site Evaluator Signature

163  
SE

3/3/2015  
Date