


SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services
Division of Health Engineering, Station 10 SHS
(207) 287-5672 FAX (207) 287-4172

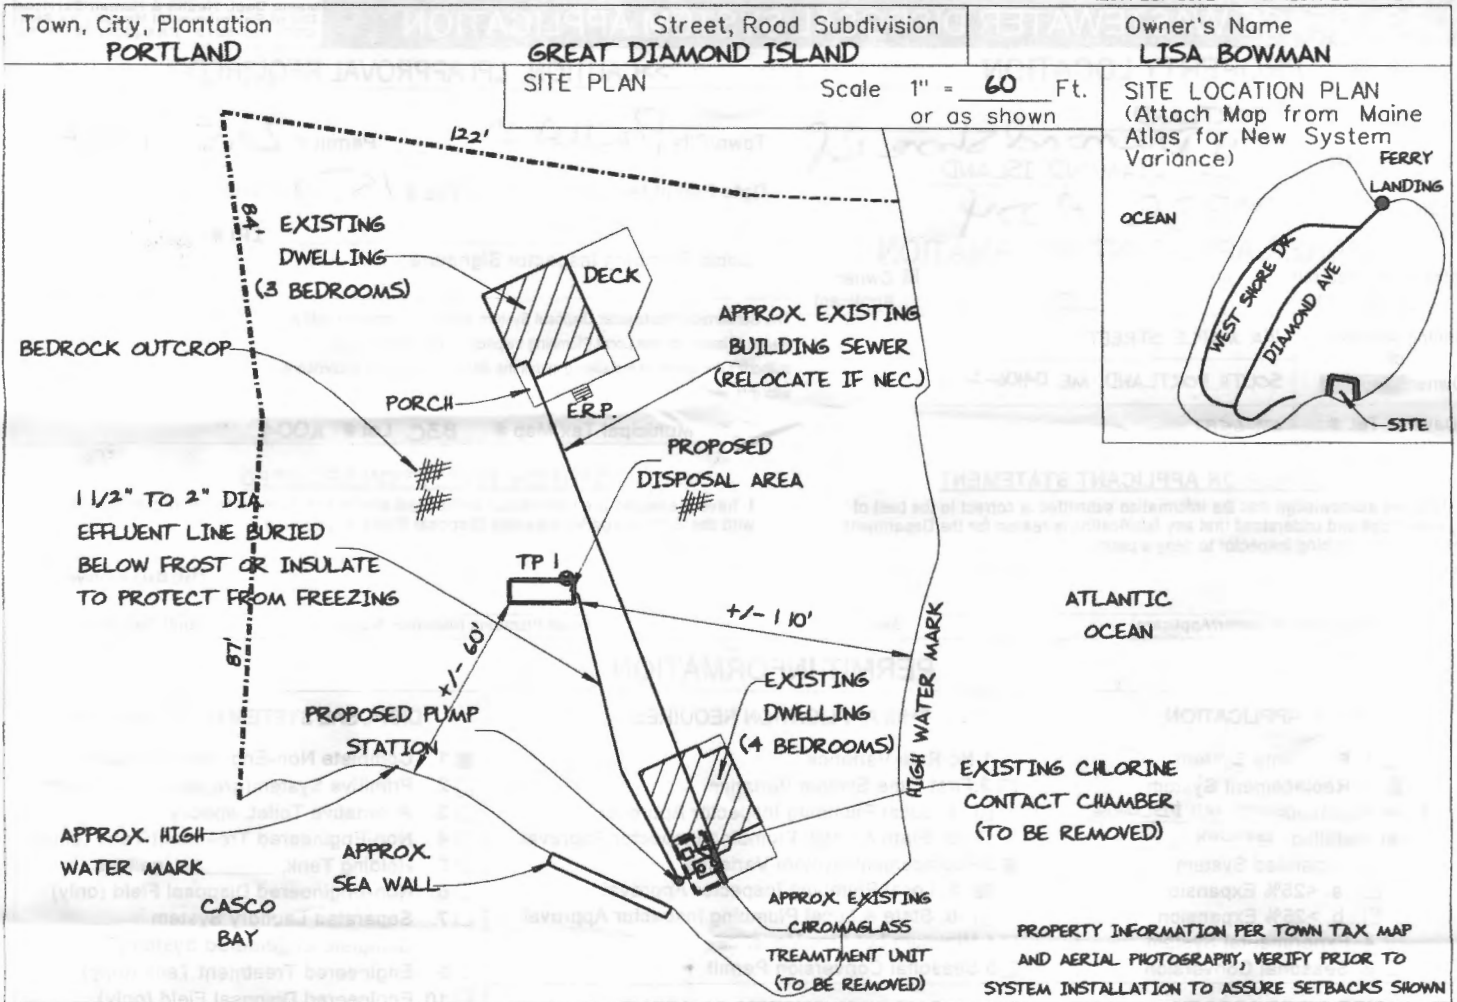

SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)

Observation Hole TP 1 Test Pit Boring
" Depth of Organic Horizon Above Mineral Soil

DEPTH BELOW MINERAL SOIL SURFACE (inches)	Texture	Consistency	Color	Mottling
0	LOAMY		DARK	
	FINE		BROWN	
10	SAND	FRIABLE	YELLOW BROWN	
20			LIGHT OLIVE BROWN	
30	LOAMY		OLIVE BROWN	COMMON, DISTINCT.
	VERY FINE SAND AND SILT	FIRM		
40				
45				
50				

LIMIT OF EXCAVATION

Soil Classification: B Profile, C Condition
Slope: 0-3%
Limiting Factor: 24"
 Ground Water
 Restrictive Layer
 Bedrock
 Pit Depth

Observation Hole _____ Test Pit Boring
" Depth of Organic Horizon Above Mineral Soil

DEPTH BELOW MINERAL SOIL SURFACE (inches)	Texture	Consistency	Color	Mottling
0				
10				
20				
30				
40				
50				

TEST BORINGS IN SYSTEM CORNERS ALL IN EXCESS OF 36" TO BEDROCK

Soil Classification: _____ Profile, _____ Condition
Slope: _____ %
Limiting Factor: _____
 Ground Water
 Restrictive Layer
 Bedrock
 Pit Depth

Albert Frick
Site Evaluator Signature

SE

Date

7/8/2015