




ALL CONCRETE REINFORCING STEEL PER PLANS AND SECTIONS.
 STEP IN TOP OF FOUNDATION WALL IS INDICATED THUS: , AND SHOWS LOWER SIDE OF WALL.
 SEE S-1.0 FOR STRUCTURAL GENERAL NOTES

4. FOOTING TO BEAR 4'-6" MIN BELOW GRADE.

5. T.O. FOOTINGS ARE INDICATED THUS: (XX'-XX")
6. STEP IN TOP OF FOOTING IS INDICATED THUS:


→ AND SHOWS LOWER FOOTING.
7. ALL EXPOSED STEEL TO BE HOT DIP GALV. -TYP.


1. SEE SHEET S1.0 FOR GENERAL STRUCTURAL NOTES

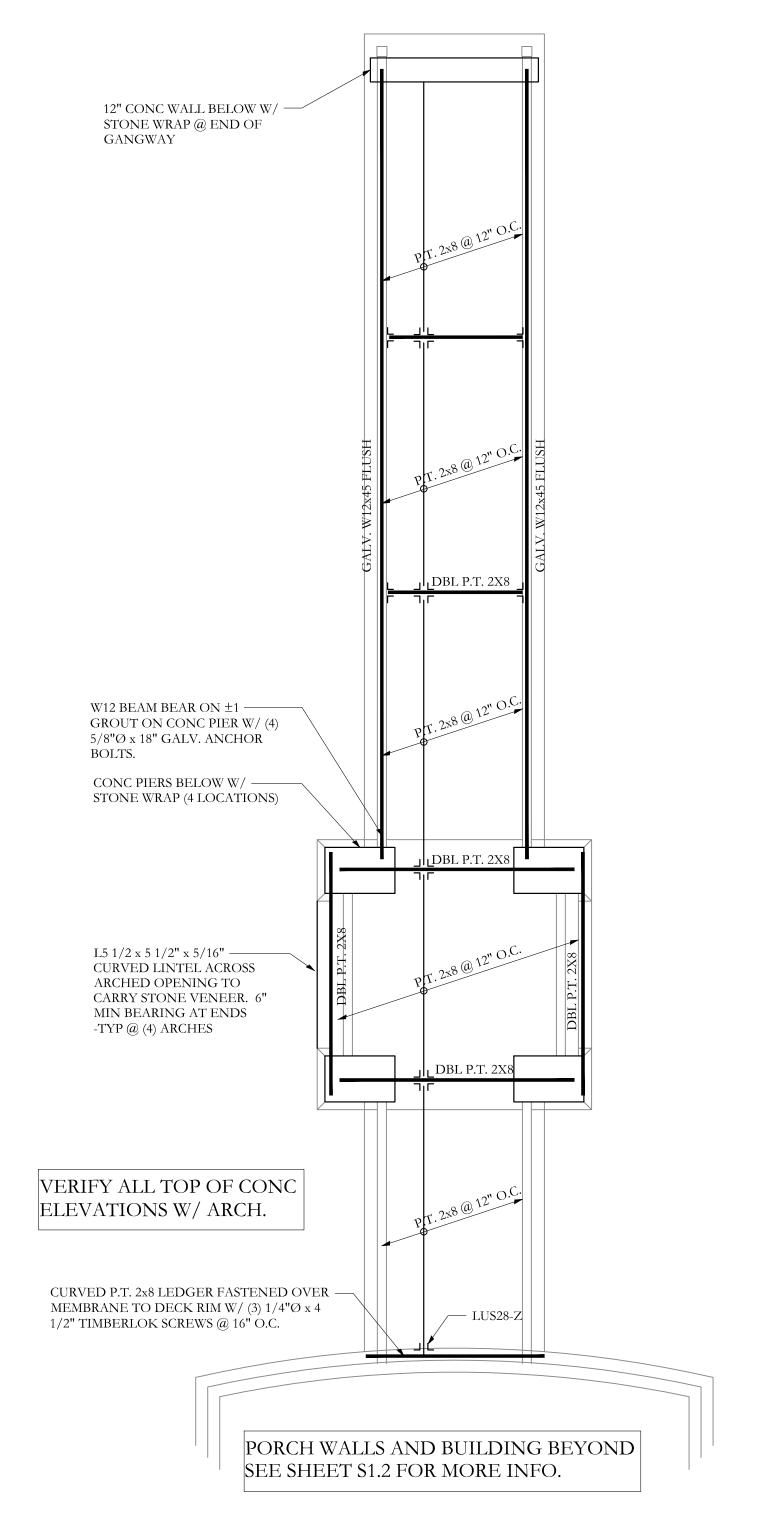








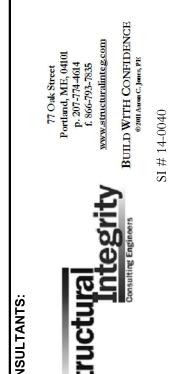

RESIDENCE

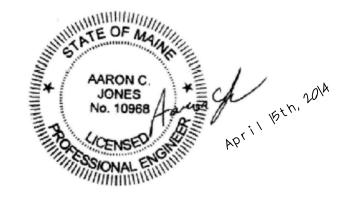

S3.1