


**Rachel Conly**  
Architectural Design

26 Sterling Street  
Peaks Island, Maine 04108  
207.766.5625

**Proposed  
Cross Section**

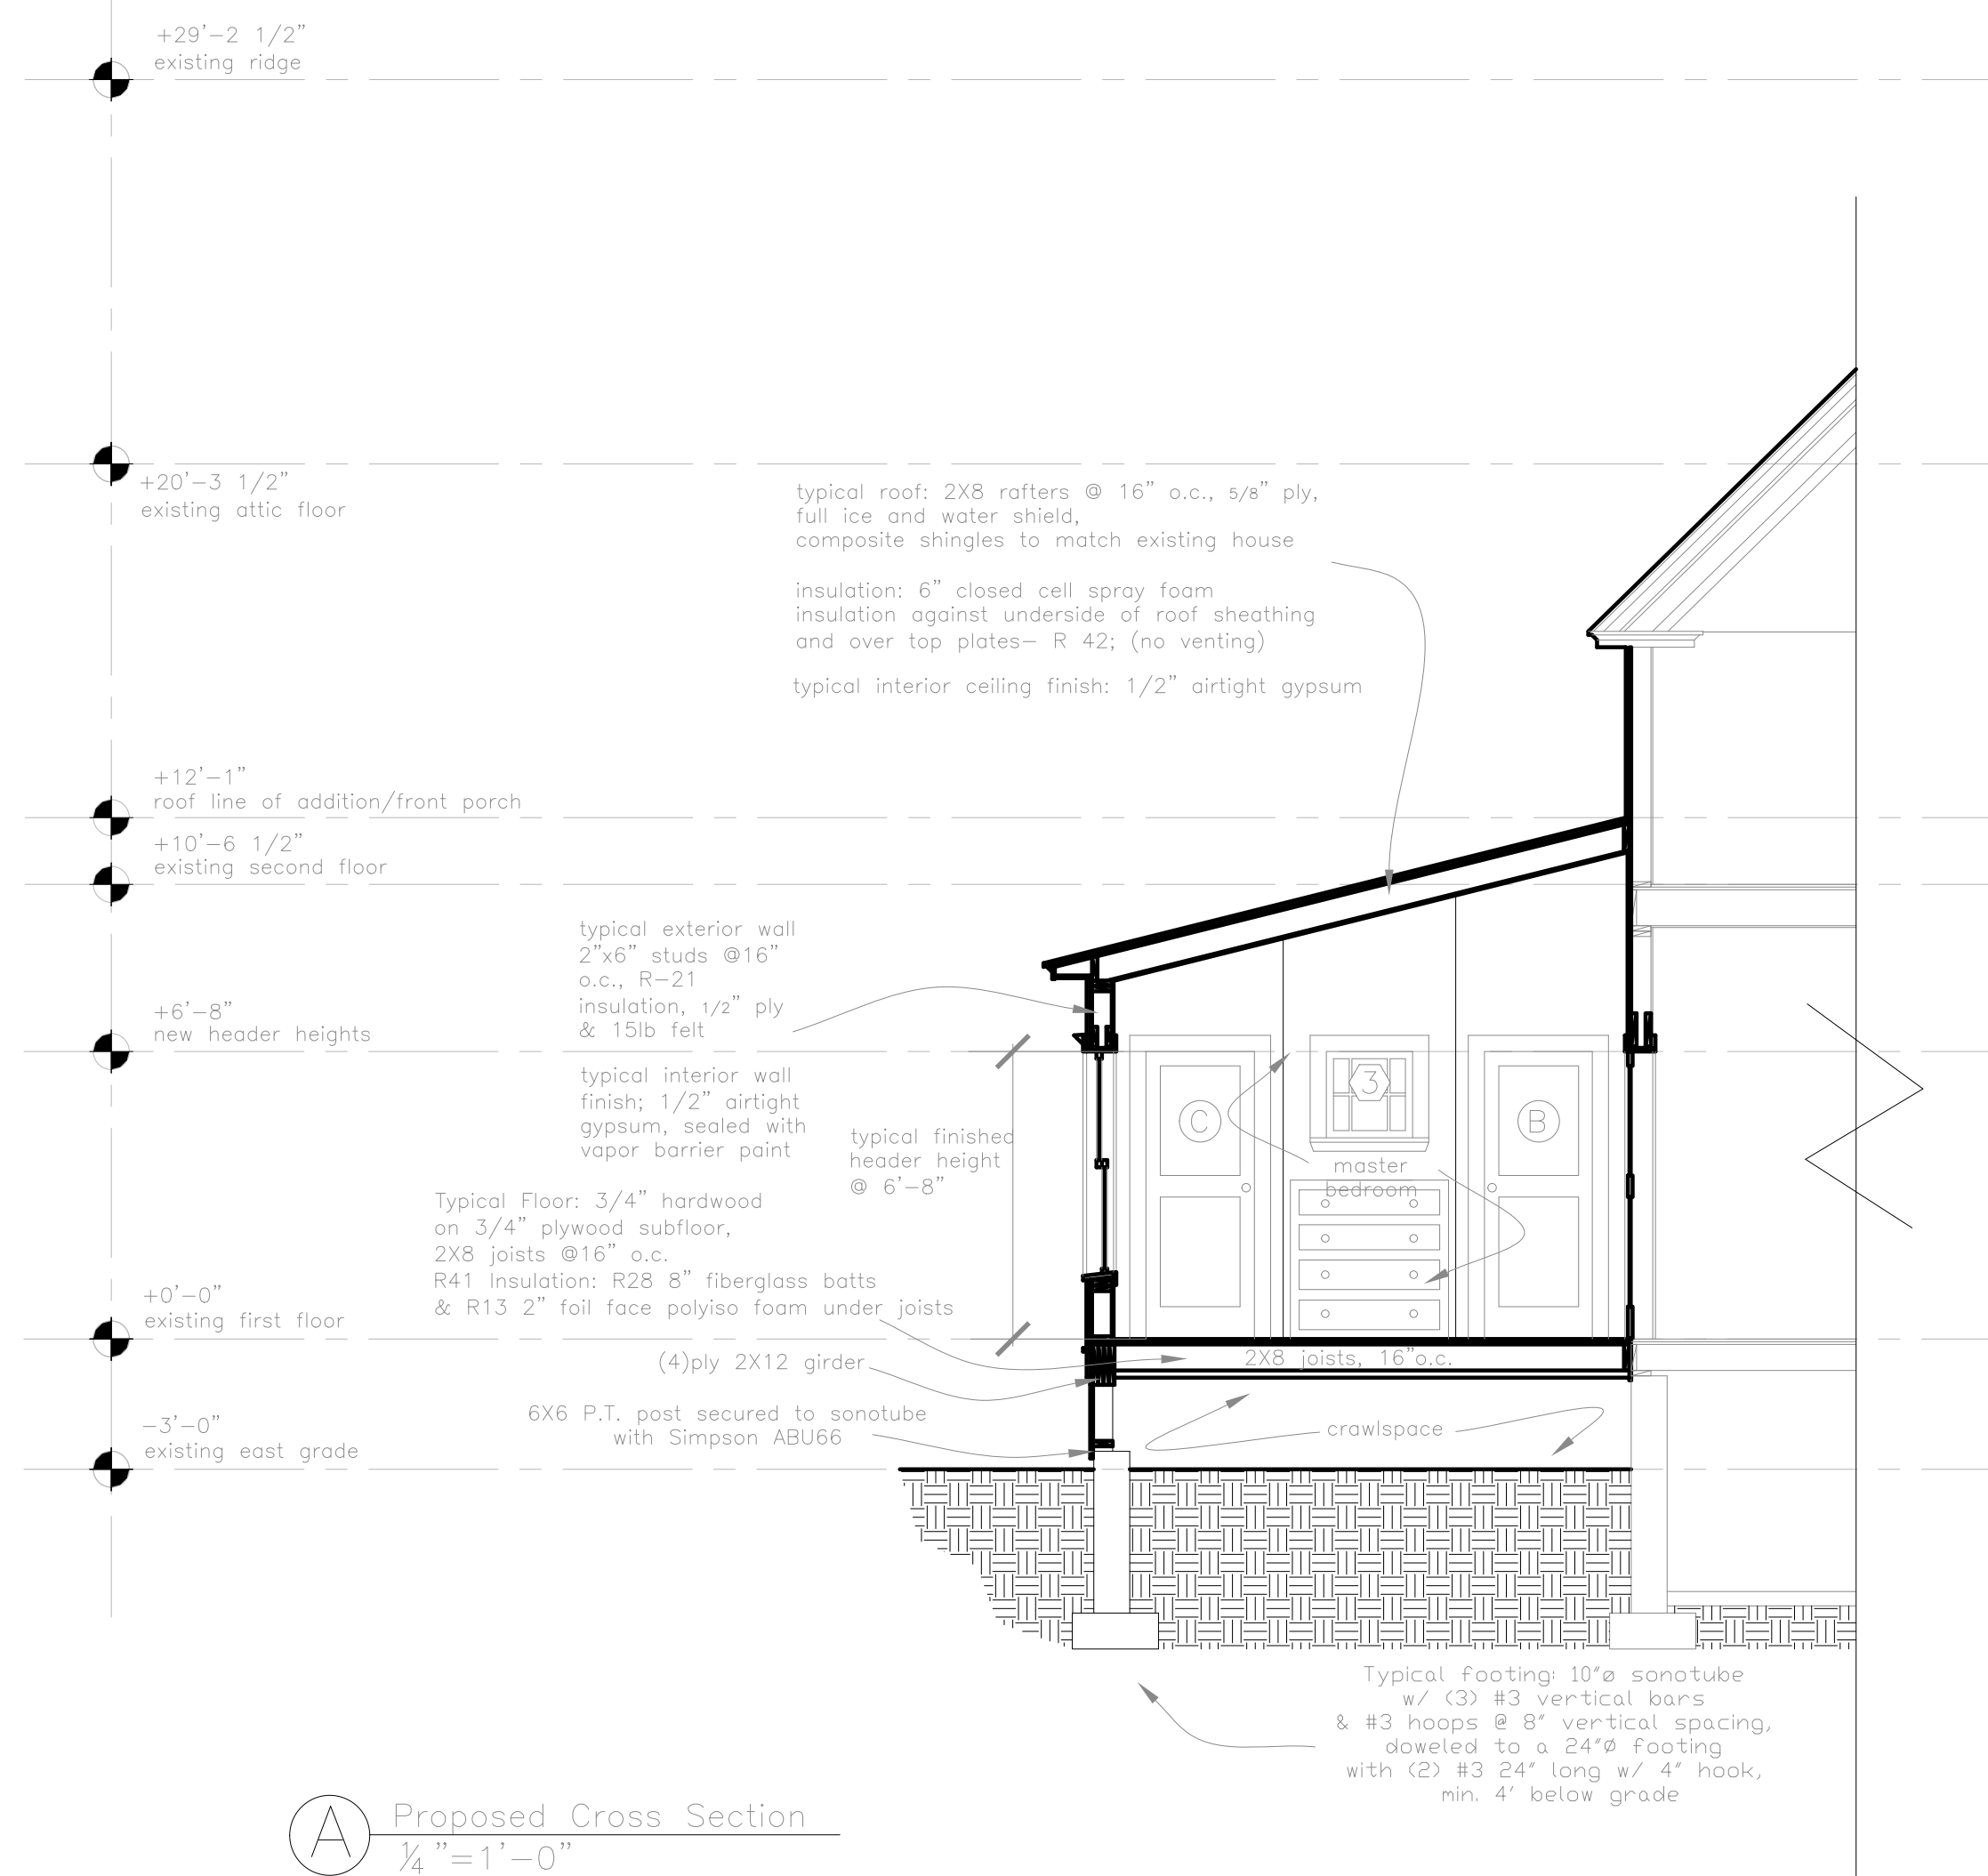

- NOTE:
- 1.) ALL WOOD FRAMING MEMBERS THAT REST ON CONCRETE OR MASONRY EXTERIOR WALLS AND ARE LESS THAN 8" FROM THE EXPOSED GROUND SHALL BE OF A ROT RESISTANT MATERIAL.
  - 2.) ALL WOOD JOISTS OR THE BOTTOM OF A WOOD STRUCTURAL FLOOR WHEN CLOSER THAN 18", OR WOOD GIRDERS WHEN CLOSER THAN 12", TO THE EXPOSED GROUND, SHALL BE OF A ROT RESISTANT MATERIAL.
  - 3.) NEW WOOD SIDING AND/OR SHEATHING TO BE ABOVE GRADE A MINIMUM OF 6" OR ELSE OF A ROT RESISTANT MATERIAL.
  - 4.) ALL DECK/STAIR FRAMING/DECKING TO BE OF ROT RESISTANT WOOD.
  - 5.) SPECIFICATIONS FOR FOUNDATION WORK:
    - A) CONTRACTOR TO SURVEY EXISTING POSTS AND FOOTINGS THAT DO NOT COMPLY WITH ANY OF THE FOLLOWING CRITERIA:
      - 1) POST MIN. SIZE 4X4
      - 2) POST NO MORE THAN 1/4" OUT OF PLUMB
      - 3) POST IS PRESSURE TREATED
      - 4) POST BASE SIMPSON AB-TYPE OR EQUAL INSTALLED PER MANUFACTURER'S RECOMMENDATIONS.
      - 5) TOP OF FOOTING/PIER IS NO MORE THAN 1/2" OUT OF LEVEL
    - B) NEW/REPLACEMENT FOOTINGS SHALL BE MIN 4'-0" DEEP ON SOIL (OR PINNED TO ROCK) WITH 12" SQUARE X 8" THICK FOOTING. PIERS TO BE MIN. 8" SQUARE OR ROUND DOWELED TO FOOTING WITH (2) #3 24" LONG W/ 4" HOOK & (3) #3 VERTICAL BARS & #3 HOOPS AT 8" VERTICAL SPACING

**A** Proposed Cross Section  
1/4" = 1'-0"

PROJECT  
**Mills Residence**  
**9 Sandpiper Rd.**  
**Peaks Island, ME**

DATE 03.18.14	REVISED 05.02.14
SCALE 1/4" = 1'-0"	DRAWN BY <b>Rachel &amp; Harvey</b>

NOTES