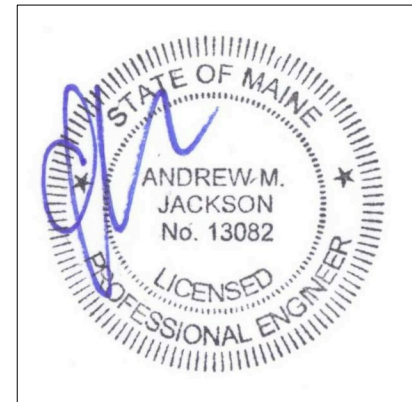
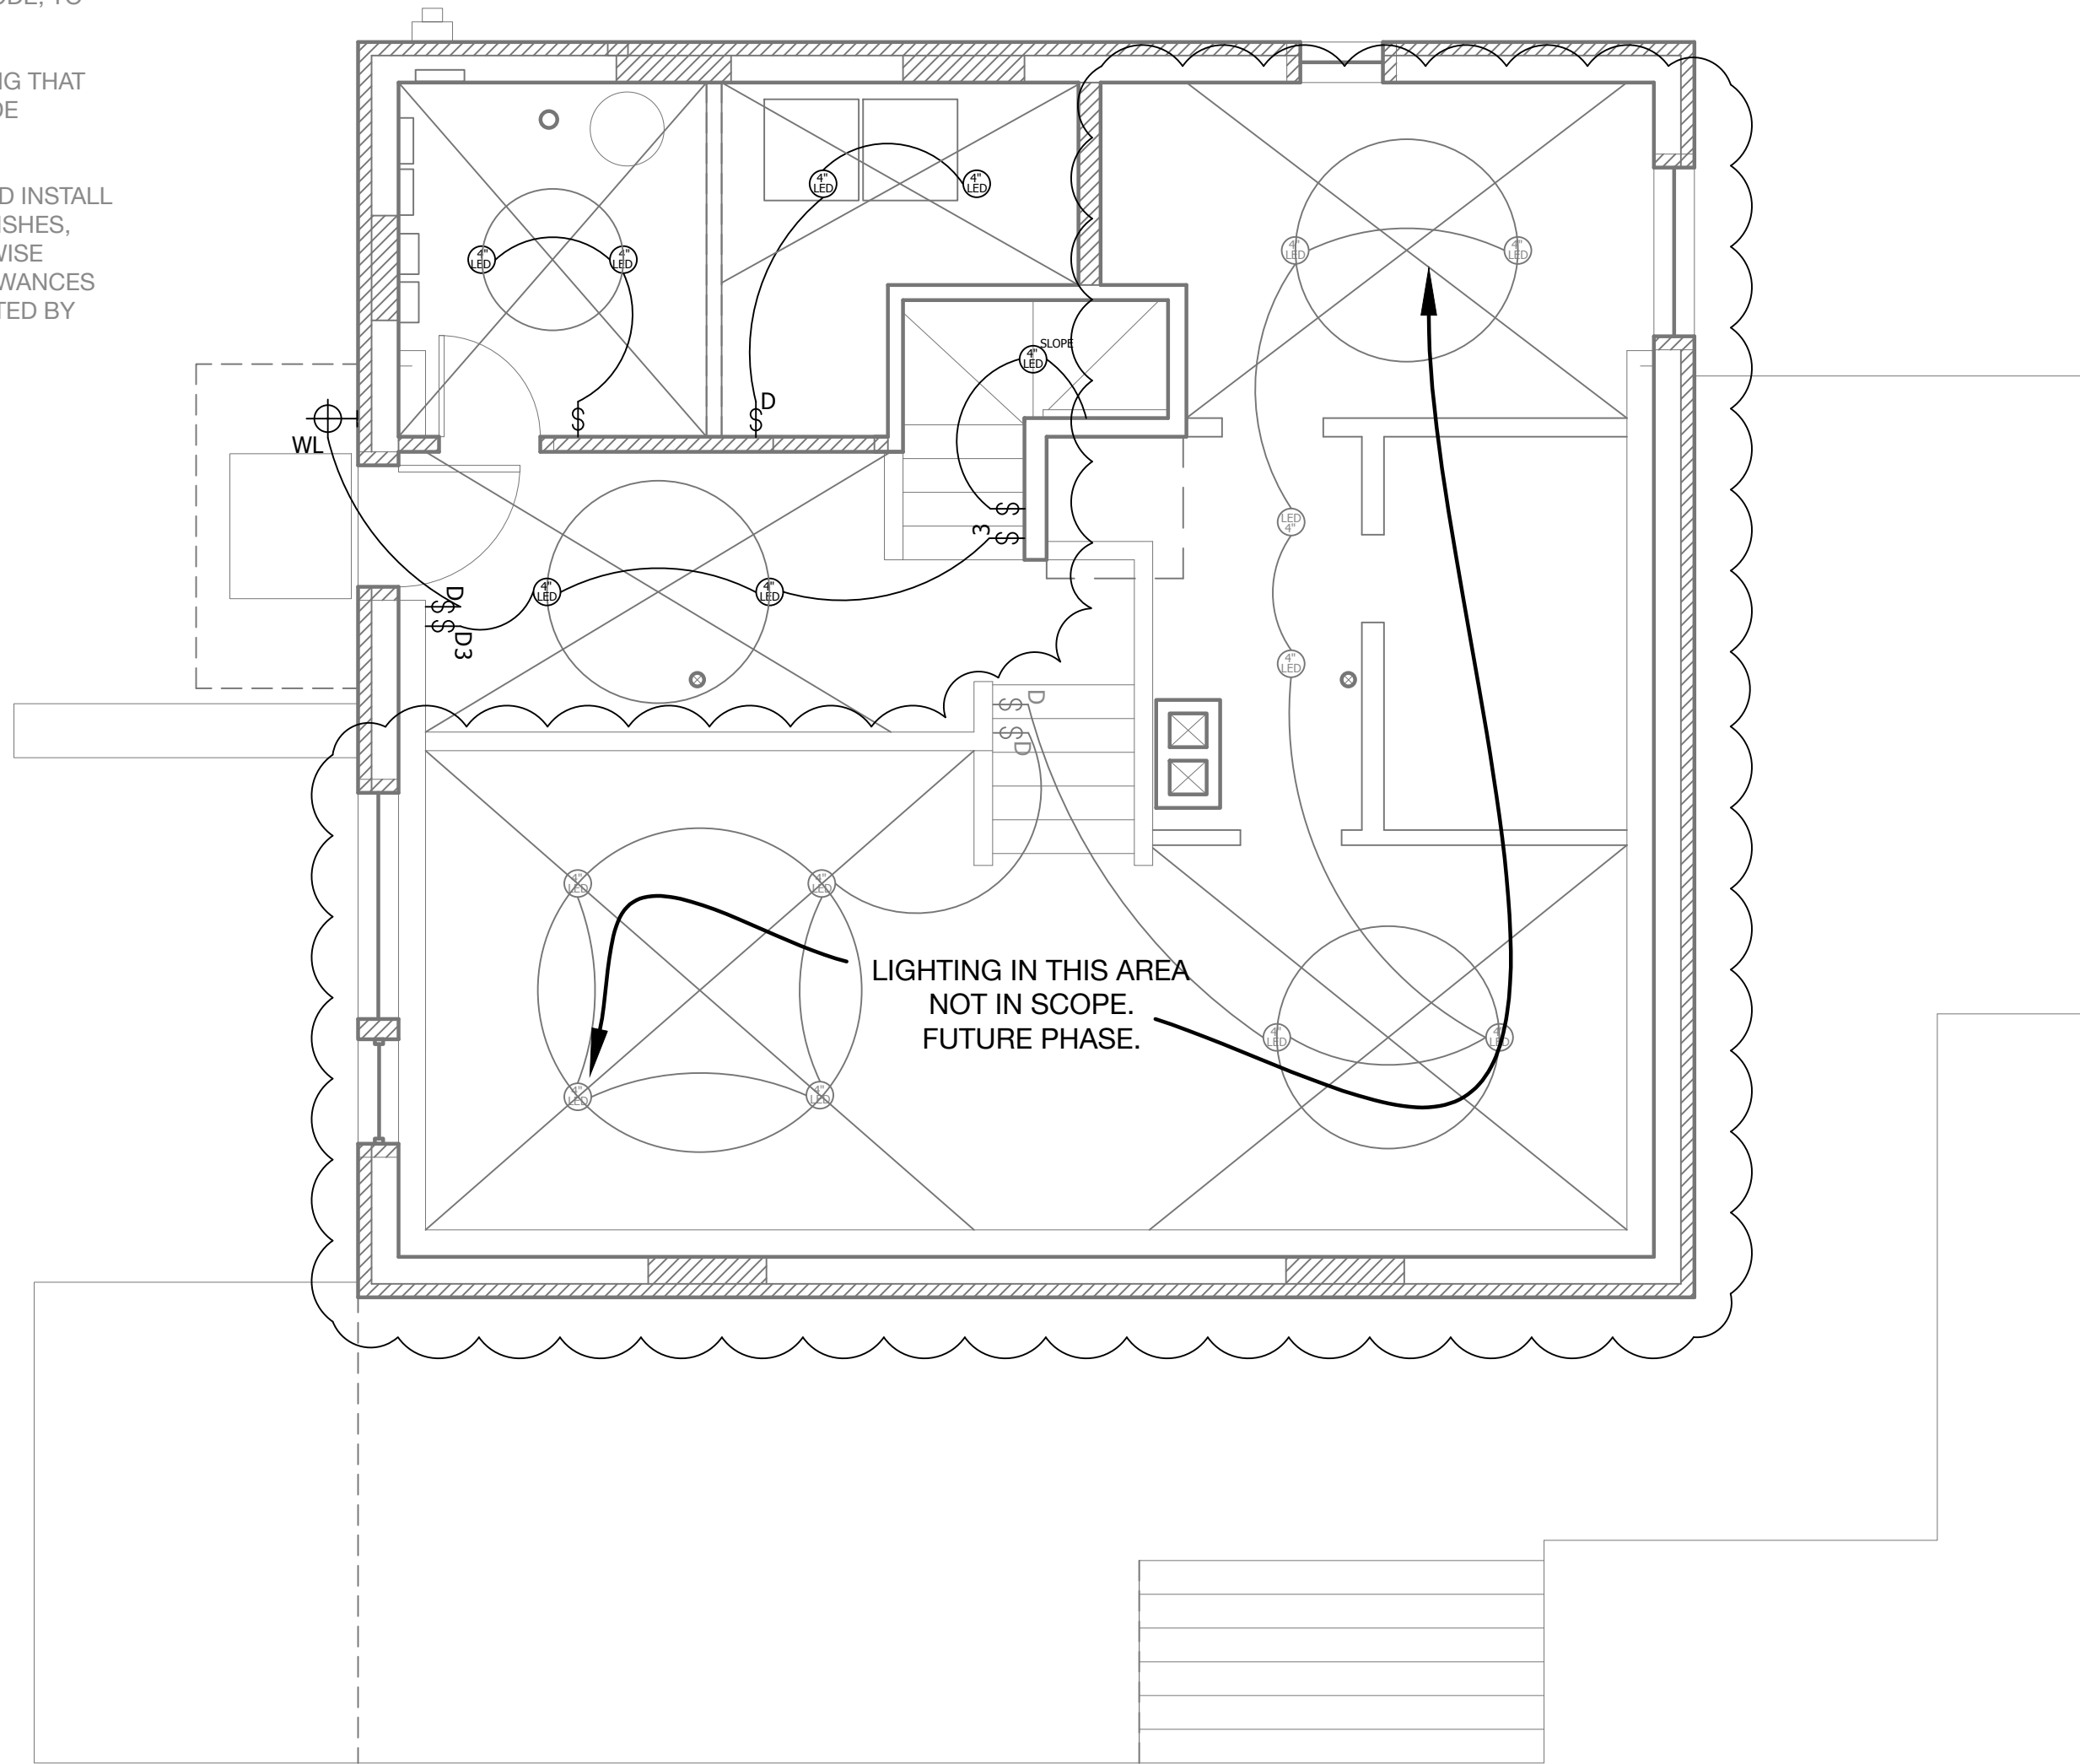


NOTES:

- 1.) ELECTRICAL, MECHANICAL, AND PLUMBING SPECIFICATIONS AND PERMITS BY OTHERS.
- 2.) PROVIDE AFCI CIRCUIT BREAKERS IN ELECTRICAL PANEL AND SUB-PANELS, AS REQUIRED BY CODE, TO PROTECT LISTED ROOM TYPES.
- 3.) CONTRACTOR RESPONSIBLE FOR ENSURING THAT PROJECT MEETS ALL LOCAL ELECTRICAL CODE REQUIREMENTS.
- 4.) CONTRACTOR TO PURCHASE, DELIVER, AND INSTALL ALL PROJECT MATERIALS, COMPONENTS, FINISHES, APPLIANCES AND FIXTURES, UNLESS OTHERWISE NOTED IN CONTRACT. PROVIDE STATED ALLOWANCES IN QUOTE/ESTIMATE FOR ITEMS TO BE SELECTED BY CLIENT AND PAID FOR BY CONTRACTOR.



 EXISTING WALLS  
 NEW WALLS































**Rachel Conly Design LLC**  
 26 Sterling Street  
 Peaks Island, Maine 04108  
 207.766.5625

DATE	NOTES
2016.11.07	
REVISIONS	

1/4" = 1'

**PROJECT**  
**Scott Residence**  
**Peaks Island, ME**  
**04108**

# A Basement Lighting Plan

<p>NOTES:</p> <ul style="list-style-type: none"> <li> DUPLEX RECEPTACLE</li> <li> GFI GROUND FAULT CIRCUIT INTERRUPTER</li> <li> 240 V</li> <li> SWITCH</li> <li> 3-WAY SWITCH</li> <li> DIMMER SWITCH</li> <li> SMOKE DETECTOR</li> <li> CARBON MONOXIDE DETECTOR</li> <li> CEILING MOUNT LIGHT FIXTURE</li> <li> WALL SCONCE LIGHT FIXTURE</li> <li> LOW PROFILE WALL SCONCE LIGHT FIXTURE</li> <li> WET LOCATION WALL SCONCE LIGHT FIXTURE</li> <li> PENDANT LIGHT FIXTURE</li> <li> RECESSED CAN LIGHT FIXTURE</li> <li> COMPACT FLUORESCENT RECESSED CAN LIGHT</li> <li> 3" LED RECESSED CAN LIGHT</li> <li> UNDER-COUNTER LIGHTS</li> <li> TRACK LIGHTING</li> <li> LOCALLY SWITCHED CLOSET RATED LIGHT</li> <li> CEILING FAN WITH INTEGRAL LIGHT</li> <li> CEILING FAN</li> <li> MINIMUM 50 CFM VENT FAN</li> <li> MINIMUM 50 CFM VENT FAN/LIGHT COMBO</li> <li> PHONE JACK</li> <li> DSL JACK</li> <li> CABLE JACK</li> <li> CAT 5 JACK</li> <li> CENTRAL VACUUM PORT</li> </ul>
--

**E2**  
 Proposed  
 Basement  
 Lighting Plan