



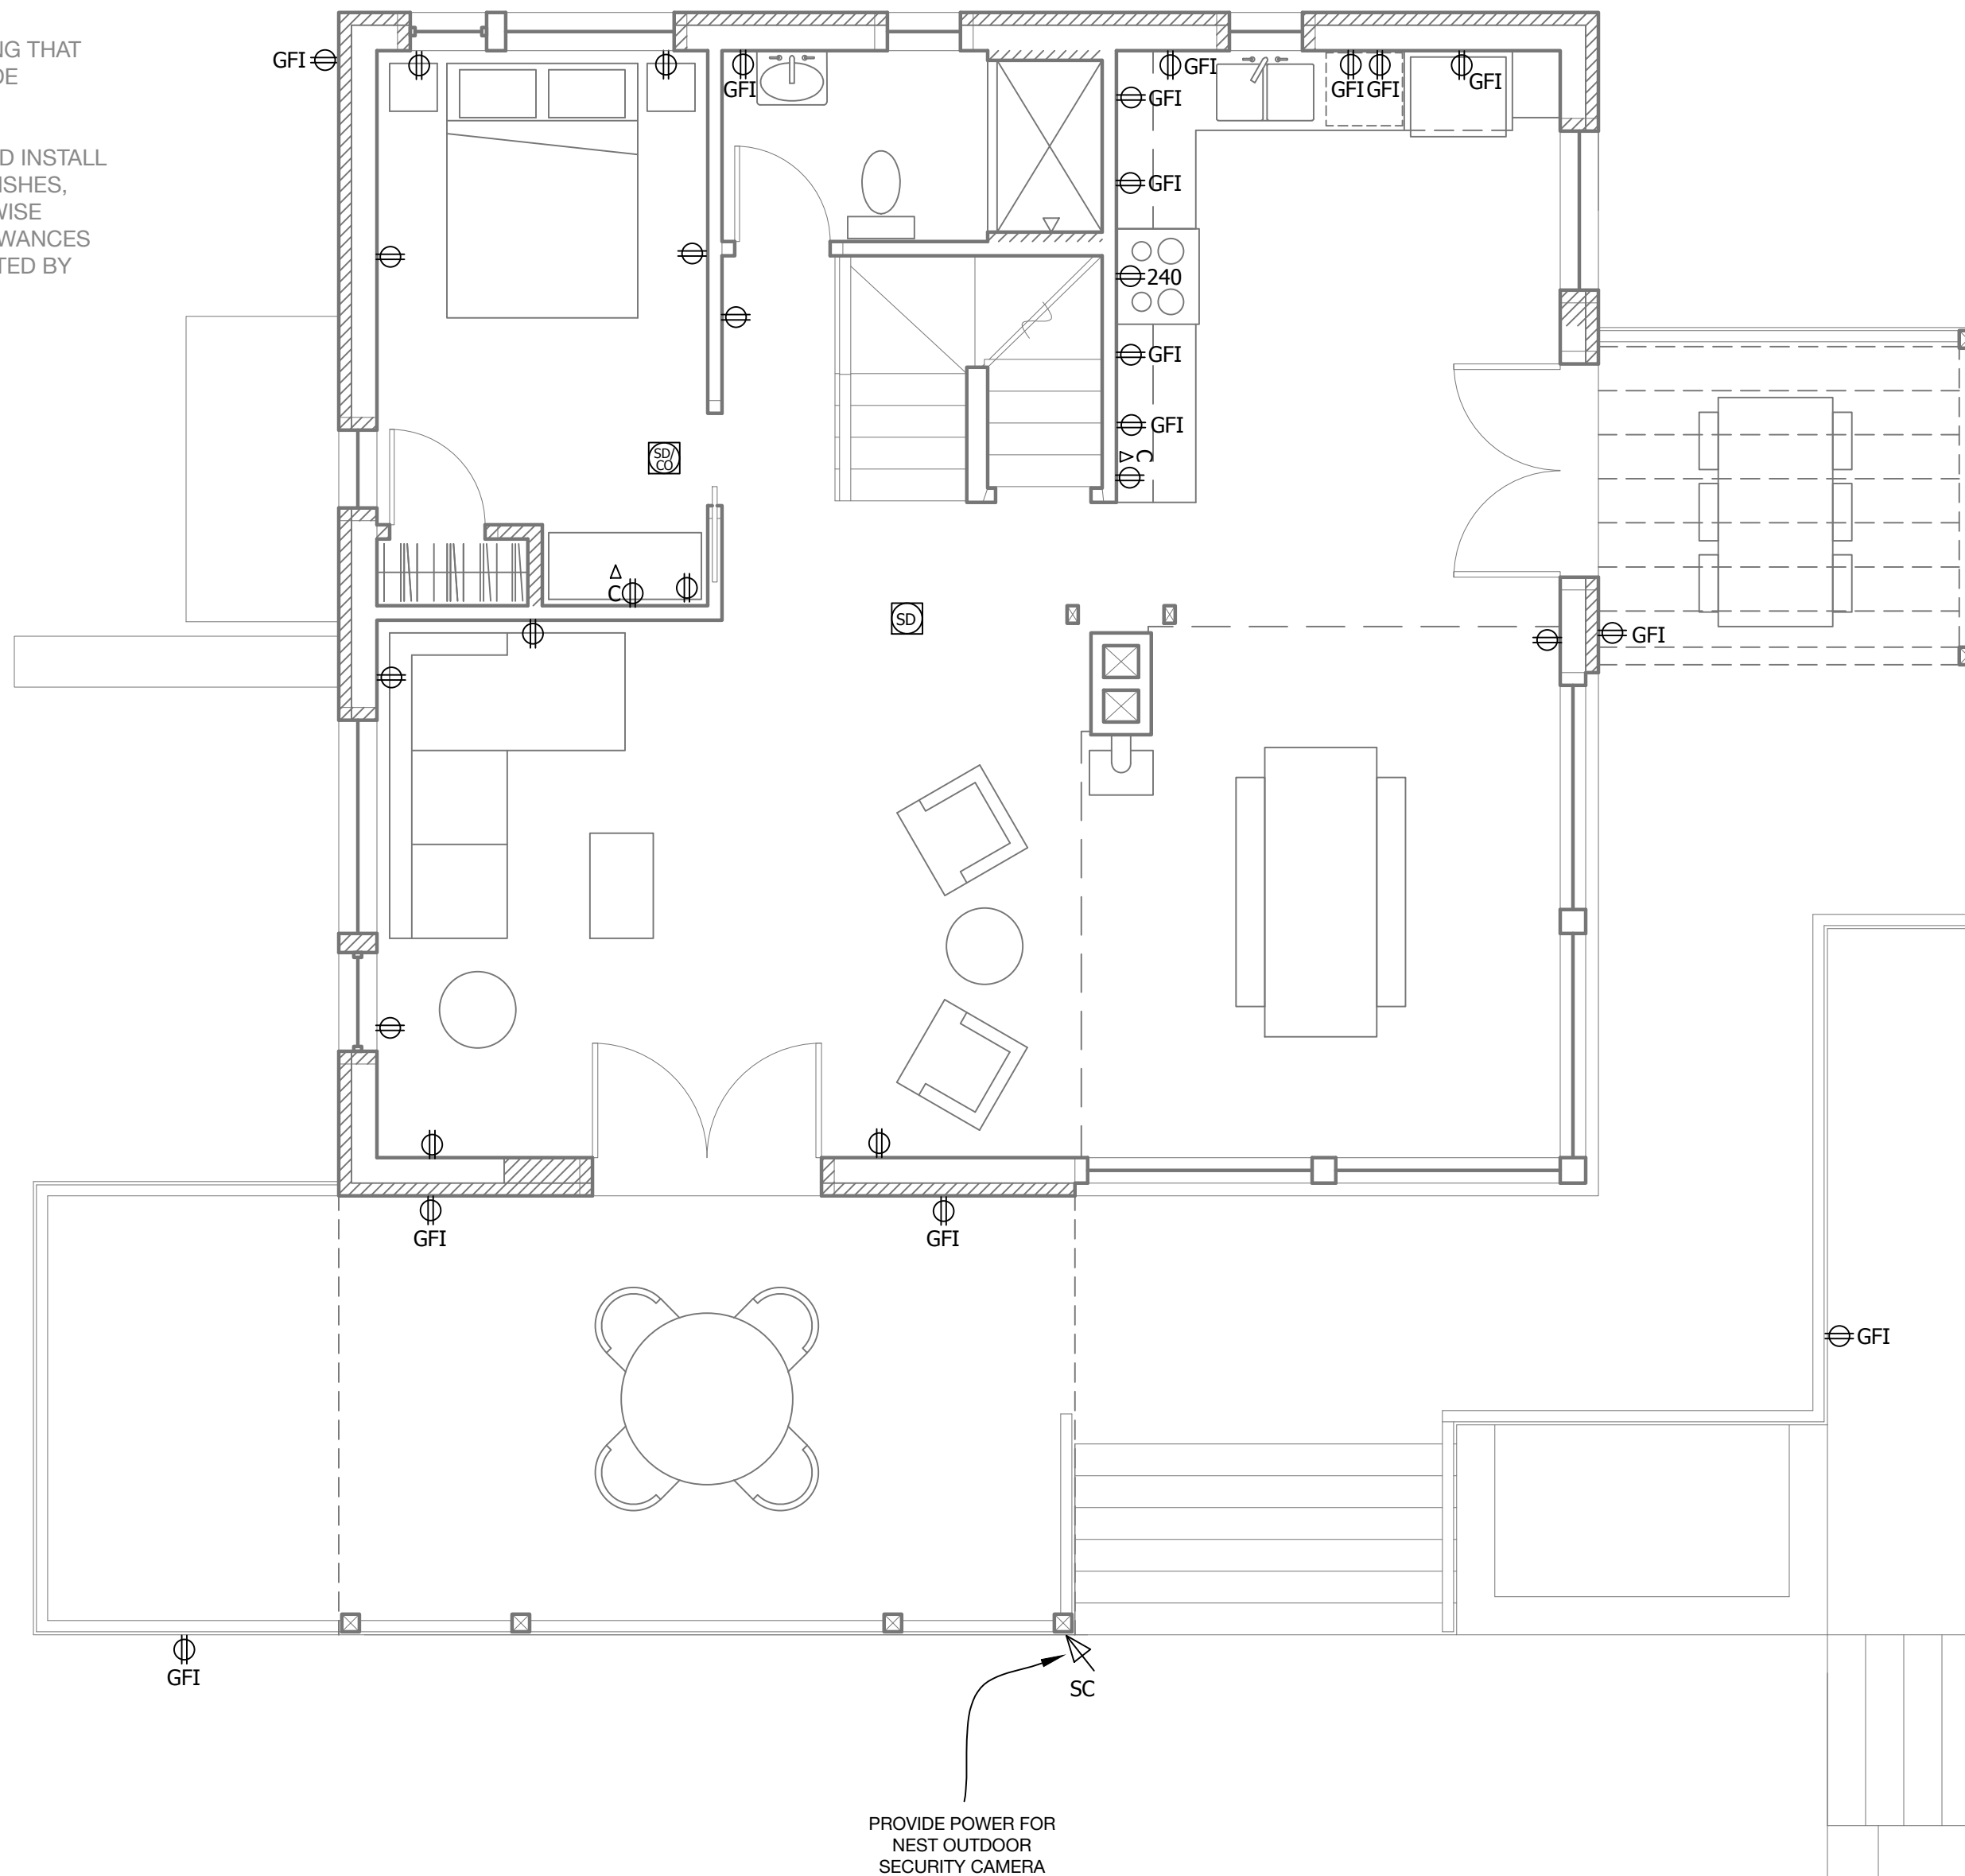

NOTES:

- 1.) ELECTRICAL, MECHANICAL, AND PLUMBING SPECIFICATIONS AND PERMITS BY OTHERS.
- 2.) PROVIDE AFCI CIRCUIT BREAKERS IN ELECTRICAL PANEL AND SUB-PANELS, AS REQUIRED BY CODE, TO PROTECT LISTED ROOM TYPES.
- 3.) CONTRACTOR RESPONSIBLE FOR ENSURING THAT PROJECT MEETS ALL LOCAL ELECTRICAL CODE REQUIREMENTS.
- 4.) CONTRACTOR TO PURCHASE, DELIVER, AND INSTALL ALL PROJECT MATERIALS, COMPONENTS, FINISHES, APPLIANCES AND FIXTURES, UNLESS OTHERWISE NOTED IN CONTRACT. PROVIDE STATED ALLOWANCES IN QUOTE/ESTIMATE FOR ITEMS TO BE SELECTED BY CLIENT AND PAID FOR BY CONTRACTOR.

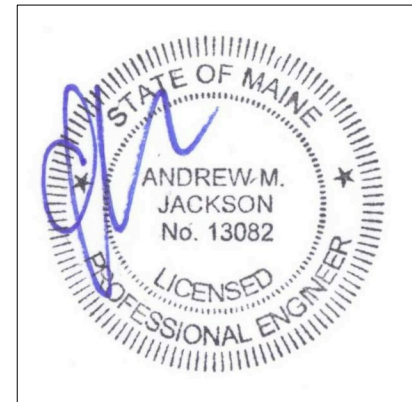

 EXISTING WALLS
 NEW WALLS

Rachel Conly Design LLC
 26 Sterling Street
 Peaks Island, Maine 04108
 207.766.5625




























DATE	NOTES
2016.11.07	
REVIS	

1/4" = 1'

PROJECT
Scott Residence
 Peaks Island, ME
 04108

A Proposed First Floor Power Plan

NOTES:

- | | | | | | | | | | | | | | |
|---|----------------------------------|---|--------------------------|---|--|---|--|---|-------------------------------------|---|---------------------------------|---|------------|
|  | DUPLEX RECEPTACLE |  | 3-WAY SWITCH |  | CEILING MOUNT LIGHT FIXTURE |  | PENDANT LIGHT FIXTURE |  | UNDER-COUNTER LIGHTS |  | CEILING FAN WITH INTEGRAL LIGHT |  | PHONE JACK |
|  | GROUND FAULT CIRCUIT INTERRUPTER |  | DIMMER SWITCH |  | WALL SCONCE LIGHT FIXTURE |  | RECESSED CAN LIGHT FIXTURE |  | TRACK LIGHTING |  | CEILING FAN |  | DSL JACK |
|  | 240 V |  | SMOKE DETECTOR |  | LOW PROFILE WALL SCONCE LIGHT FIXTURE |  | COMPACT FLUORESCENT RECESSED CAN LIGHT |  | LOCALLY SWITCHED CLOSET RATED LIGHT |  | MINIMUM 50 CFM VENT FAN |  | CABLE JACK |
|  | SWITCH |  | CARBON MONOXIDE DETECTOR |  | WET LOCATION WALL SCONCE LIGHT FIXTURE |  | 3" LED RECESSED CAN LIGHT |  | MINIMUM 50 CFM VENT FAN/LIGHT COMBO |  | CENTRAL VACUUM PORT | | |

E3
 Proposed
 First Floor
 Power Plan